



State of Ohio Environmental Protection Agency

**Central District Office**

TELE: (614) 728-3778 FAX: (614) 728-3898  
www.epa.state.oh.us

**REET ADDRESS:**

Lazarus Government Center  
50 W. Town St., Suite 700  
Columbus, Ohio 43215

**MAILING ADDRESS:**

P.O. Box 1049  
Columbus, OH 43216-1049

August 4, 2008

Jeff Lamb  
N K Parts Industries Inc.  
777 South Kuther Road  
Sidney, OH 45365

**Re: Construction Storm Water Inspection at N K Parts**

Dear Mr. Lamb:

This letter is written regarding the storm water inspection that Darrick Tibyash and Adam Knoll, of Ohio EPA, conducted at N K Parts, located at 13434 State Route 287 in Logan County, on July 29, 2008. The Agency understands that these construction activities are currently covered under the General Storm Water Permit Associated with Construction Activities. Based on the site inspection and the General Storm Water Permit, the following items must be addressed:

**Sediment and Erosion Controls:**

- Be aware the General Permit states that all barren areas which remain idle in excess of 21 days must be protected from erosion within seven days of the last earth disturbing activities. In addition, erosion protection must be implemented for all areas of final grade within seven days (See Photo, Figure 1).
- Perimeter sediment controls appeared to be functioning in accordance with the General Storm Water Permit at the time of inspection. The general permit states that all sediment controls will be inspected and maintained every seven days or within 24 hours of a precipitation event equal to or greater than 0.5 inches. A log of inspection(s) must be maintained on site for the agency to review.
- The sediment impoundment associated with this site appeared to be functioning in accordance with the General Storm Water Permit at the time of inspection (See Photo, Figure 2).

Ted Strickland, Governor  
Lee Fisher, Lieutenant Governor  
Chris Korleski, Director

*Ohio EPA is an Equal Opportunity Employer*

Jeff Lamb  
N K Parts Industries Inc.  
Page -2-

If you have any questions regarding this letter or my inspection, please do not hesitate to call me at our Central District Office at (614) 728-3844. In addition, please provide a written response to the action items addressed above within ten days from receipt of this letter. A follow up inspection will be conducted to ensure the minimum conditions of the General Permit have been met.

Sincerely,



Harry Kallipolitis  
Storm Water Coordinator  
Division of Surface Water  
Central District Office

Enclosure

c: Jeff Bohne, Water Quality Supervisor, DSW/CDO

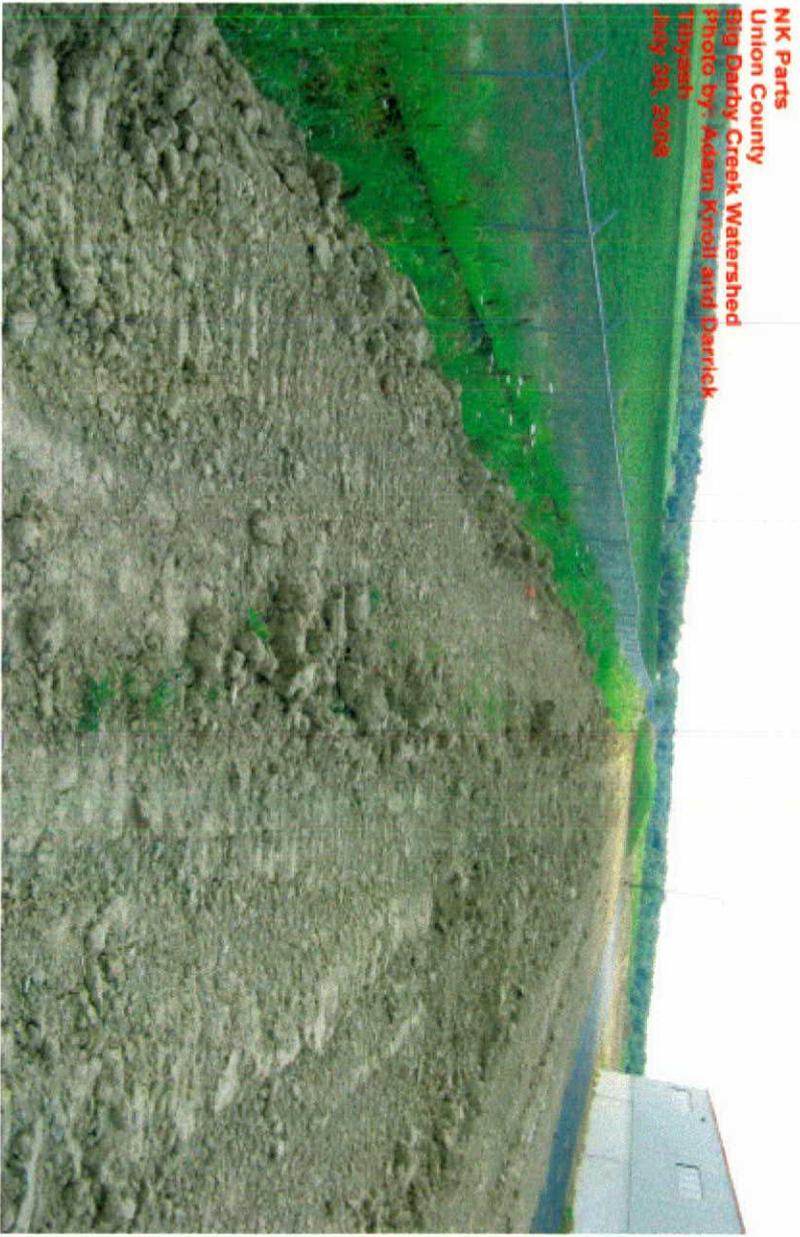


Figure 1 Barren area of site

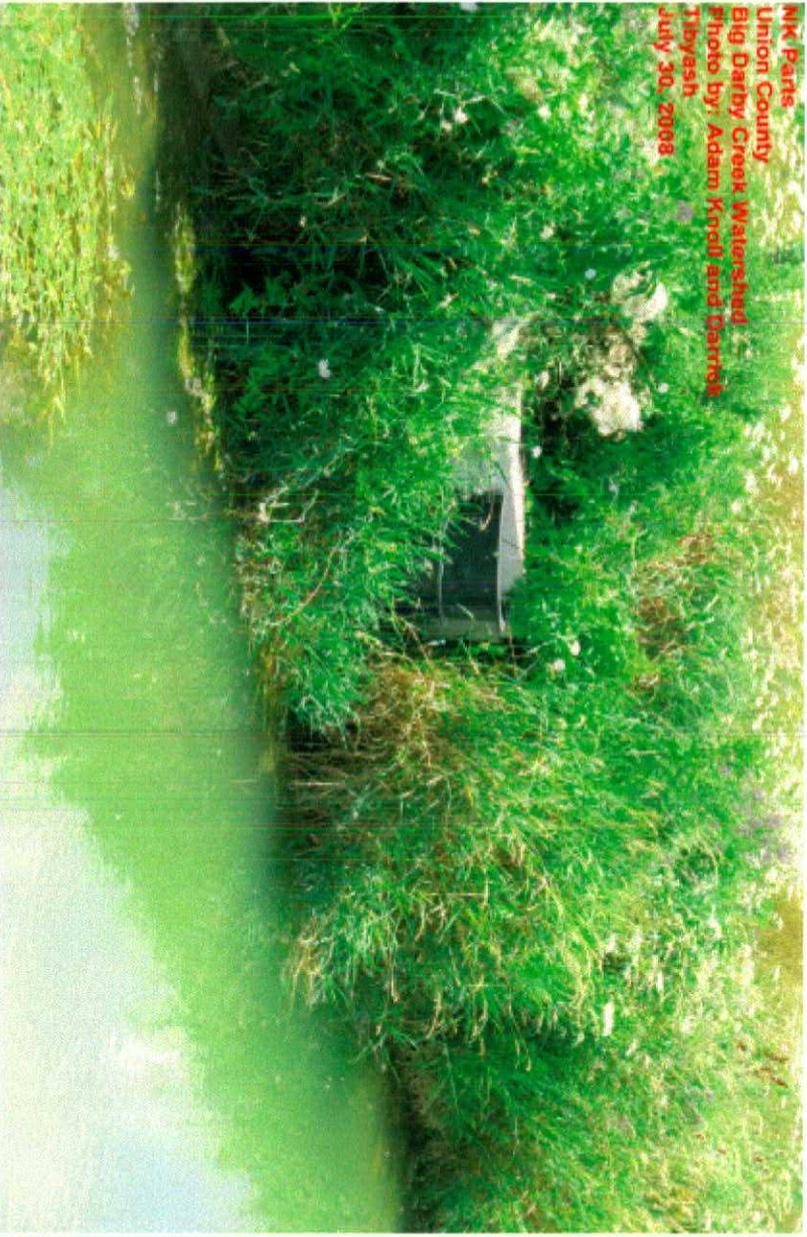


Figure 2 Sediment/fire water reservoir with riser

