



State of Ohio Environmental Protection Agency

STREET ADDRESS:

Lazarus Government Center
50 W. Town St., Suite 700
Columbus, Ohio 43215

Central District Office

TELE: (614) 728-3778 FAX: (614) 728-3898
www.epa.state.oh.us

MAILING ADDRESS:

P.O. Box 1049
Columbus, OH 43216-1049

August 7, 2007

John Lind
Homewood Corp
750 Northlawn Drive
Columbus, OH43214

Re: Holton Run / Franklin County

Dear Mr. Lind:

This letter is written regarding the storm water inspection that Ashley Stemen and Brent Rollins, of Ohio EPA, conducted at Holton Run, located near Orders Road in Franklin County, on August 1, 2007. The Agency understands that these construction activities are currently covered under the General Storm Water Permit Associated with Construction Activities. Based on the site inspection and the General Storm Water Permit, the following items must be addressed:

Sediment and Erosion Controls:

- Be aware that the General Permit states that all barren areas which remain idle in excess of 21 days must be protected from erosion within seven (7) days of the last earth disturbing activities. In addition, erosion protection must be implemented for all areas of final grade within seven (7) days.
- The storm water inlet protection throughout the site will require maintenance and cleaning (see figure 1). Please ensure that maintenance and cleaning of these inlets are implemented within seven (7) days of receipt of this letter.

Ted Strickland, Governor
Lee Fisher, Lieutenant Governor
Chris Korleski, Director

John Lind
Homewood Corp
Page -2-

If you have any questions regarding this letter or my inspection, please do not hesitate to call me at our Central District Office at (614) 728-3851. In addition, please provide a written response to the action items addressed above within ten (10) days from receipt of this letter. A follow up inspection will be conducted to ensure the minimum conditions of the General Permit have been met.

Sincerely,




Gregory L. Sanders
Water Quality Section
Division of Surface Water
Central District Office

Enclosure

c: Jeff Bohne, Water Quality Supervisor, DSW/CDO

GS/ct Hollan Run

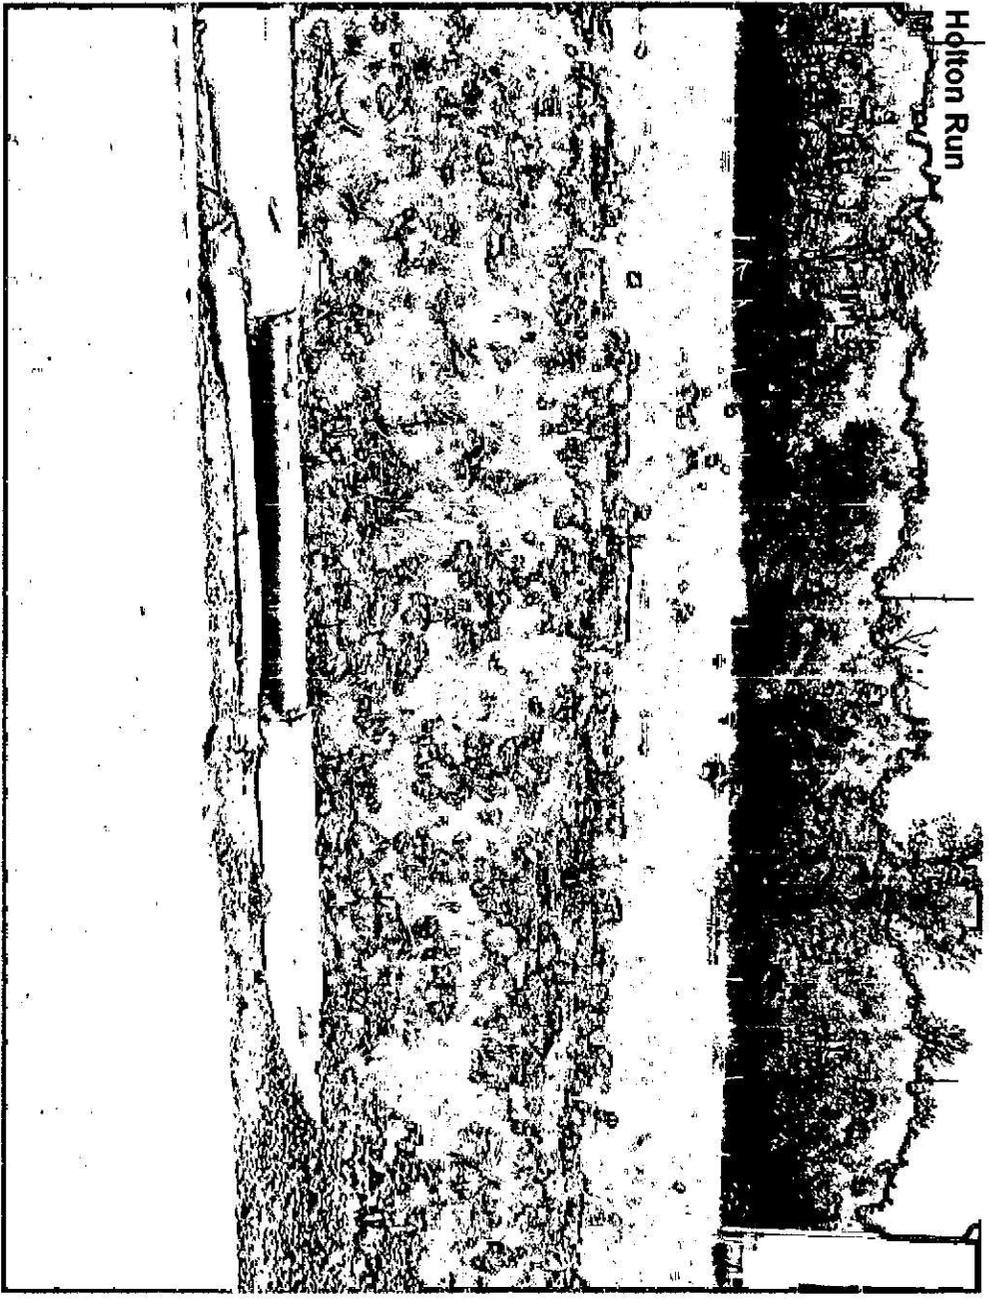

Holton Run

Figure 1





State of Ohio Environmental Protection Agency

STREET ADDRESS:

Central District Office

MAILING ADDRESS:

Lazarus Government Center
50 W. Town St., Suite 700
Columbus, Ohio 43215

TELE: (614) 728-3778 FAX: (614) 728-3898
www.epa.state.oh.us

P.O. Box 1049
Columbus, OH 43216-1049

August 7, 2007

Wayne Zill
Centex Homes
570 Polaris Parkway
Suite 125
Westerville, OH 43082

Re: Claybrooke Crossing, Sections 5 & 6 / Franklin County

Dear Mr. Zill:

This letter is written regarding the storm water inspection that Ashley Stemen and Brent Rollins, of Ohio EPA, conducted at Claybrooke Crossing, Sections 5 & 6, located on Orders Road in Franklin County, on August 1, 2007. The agency understands that these construction activities are currently covered under the General Storm Water Permit Associated with Construction Activities. Based on the site inspection and the General Storm Water Permit, the following items must be addressed:

Sediment and Erosion Controls

- Be aware that the General Permit states that all barren areas which remain idle in excess of 21 days must be protected from erosion within seven (7) days of the last earth disturbing activities. In addition, erosion protection must be implemented for all areas of final grade within seven (7) days.
- The remaining sediment and erosion controls appeared to be functioning in accordance with the General Storm Water Permit at the time of inspection.

Ted Strickland, Governor
Lee Fisher, Lieutenant Governor
Chris Korleski, Director

Wayne Zill
Centex Homes
Page -2-

If you have any questions regarding this letter or the inspection, please do not hesitate to call me at our Central District Office at (614) 728-3851. In addition, please provide a written response to the action items addressed above within ten days from receipt of this letter. A follow up inspection will be conducted to ensure the minimum conditions of the General Permit have been met.

Sincerely,



Gregory L. Sanders
Water Quality Section
Division of Surface Water
Central District Office

c: Jeff Bohne, Water Quality Supervisor, DSW/CDO