



State of Ohio Environmental Protection Agency

Northeast District Office

F

2110 East Aurora Rd.  
Twinsburg, Ohio 44087

TELE: (330) 963-1200 FAX: (330) 487-0769  
www.epa.state.oh.us

Ted Strickland, Governor  
Lee Fisher, Lieutenant Governor  
Chris Korleski, Director

December 11, 2008

RE: STARK COUNTY  
LAWRENCE TOWNSHIP  
TOP O HILL MHP  
4287 MANCHESTER AVE.  
NPDES #3PV00099

Mr. Todd Jones  
Top O Hill MHP  
P.O. Box 669  
Uniontown, OH 44685

Dear Mr. Jones:

On December 10, 2008 a compliance evaluation inspection (CEI) was conducted by this writer of the wastewater treatment system serving the above referenced facility.

At the time of the inspection, the mixed liquor in the aeration tank had a good brown color. Some dark foam was noted on the surface of the tank. The final clarifier was producing a clear effluent. One surface sand filter bed was ponded; the second bed was in good condition. The treatment system was producing a clear effluent.

A review of your Discharge Monitoring Reports (DMRs) covering the period September 2007 through October 2008 revealed the following effluent violations:

Reporting Period	Station	Parameter	Limit Type	Limit	Reported Value	Violation Date
September 2007	001	Total Suspended Solids	30D Conc	12	16.	9/1/2007
September 2007	001	CBOD 5 day	1D Conc	15	5.	9/17/2007
October 2007	001	Fecal Coliform	30D Conc	1000	1500.	10/1/2007
October 2007	001	CBOD 5 day	1D Conc	15	8.	10/29/2007
November 2007	001	CBOD 5 day	1D Conc	15	4.	11/26/2007
December 2007	001	CBOD 5 day	7D Conc	10	13.	12/15/2007
December 2007	001	CBOD 5 day	1D Conc	15	13.	12/19/2007
February 2008	001	CBOD 5 day	1D Conc	15	4.	2/18/2008
March 2008	001	CBOD 5 day	7D Conc	10	13.	3/8/2008
March 2008	001	CBOD 5 day	7D Qty	0.34	.5511	3/8/2008
March 2008	001	CBOD 5 day	1D Conc	15	13.	3/10/2008
March 2008	001	CBOD 5 day	1D Qty	0.51	.5511	3/10/2008
April 2008	001	CBOD 5 day	7D Conc	10	13.	4/15/2008
April 2008	001	CBOD 5 day	1D Conc	15	13.	4/21/2008
May 2008	001	CBOD 5 day	1D Conc	15	9.	5/5/2008
June 2008	001	CBOD 5 day	7D Conc	10	16.	6/8/2008

Mr. Todd Jones  
Top O Hill MHP  
December 11, 2008  
Page 2

Reporting Period	Station	Parameter	Limit Type	Limit	Reported Value	Violation Date
July 2008	001	CBOD 5 day	7D Conc	10	13.	7/15/2008
July 2008	001	CBOD 5 day	7D Qty	0.34	.34936	7/15/2008
July 2008	001	CBOD 5 day	1D Conc	15	13.	7/21/2008
August 2008	001	CBOD 5 day	1D Conc	15	4.	8/11/2008
September 2008	001	CBOD 5 day	1D Conc	15	5.	9/8/2008
October 2008	001	Fecal Coliform	30D Conc	1000	6000.	10/1/2008
October 2008	001	Fecal Coliform	7D Conc	2000	6000.	10/8/2008
October 2008	001	CBOD 5 day	1D Conc	15	10.	10/8/2008

The spent filter sand piled next to the surface sand filter beds must be placed in a dumpster before it washes off site.

Should you have any questions or comments regarding this letter, please contact this office at (330) 963-1197.

Sincerely,




Dean W. Stoll, P.E.  
Environmental Engineer  
Division of Surface Water

DWS/mt

Enclosure

cc: Stark County Health Department, Attn: Todd Ascani

File: Semi-Public/Top O Hill MHP

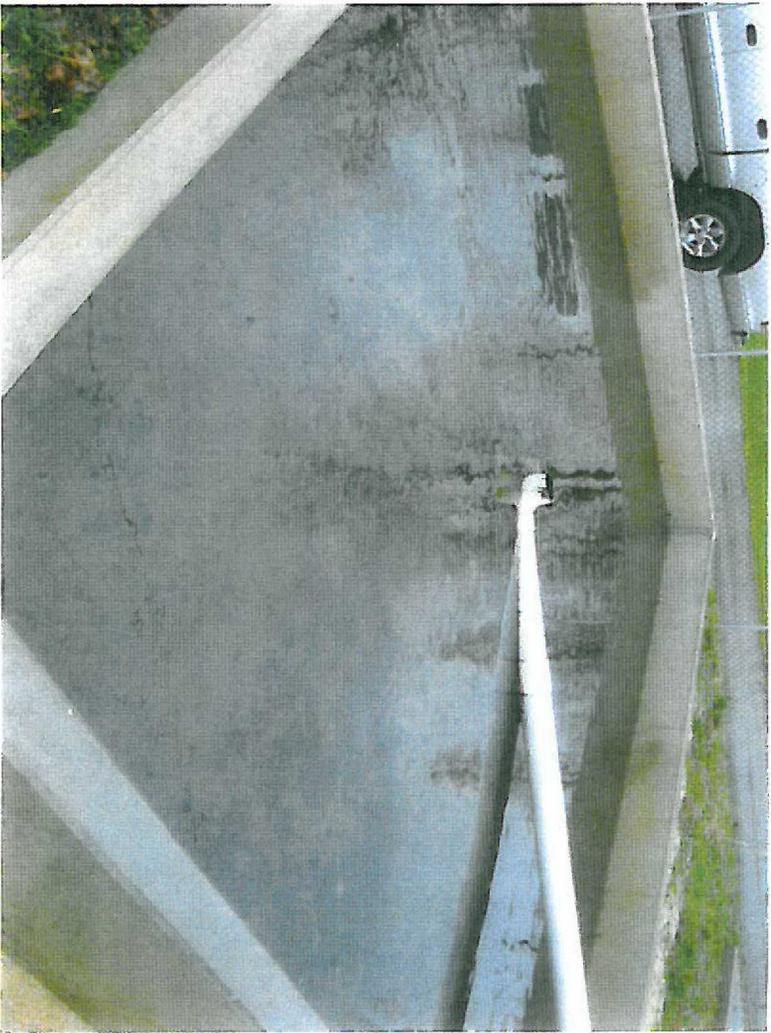

Surface sand filter.



Spent filter sand.