



2110 East Aurora Rd.
Twinsburg, Ohio 44087

TELE: (330) 963-1200 FAX: (330) 487-0769
www.epa.state.oh.us

Ted Strickland, Governor
Lee Fisher, Lieutenant Governor
Chris Korleski, Director

February 7, 2008

RE: STARK COUNTY
WASHINGTON TOWNSHIP
OAKHILL MANOR, INC.
4466 LYNNHAVEN AVE.
NPDES #3PR00177

Ms. Joyce Humphrey, Administrator
Oakhill Manor, Inc.
4466 Lynnhaven Ave.
Louisville, OH 44641

Dear Ms. Humphrey:

On February 6, 2008, this office conducted an inspection of the wastewater treatment plant serving the above referenced facility. Present during the inspection were this writer and Todd Ascani of the Stark County Health Department.

At the time of the inspection, the mixed liquor in the aeration tank has a good color. There was an excessive amount of solids on the surface of the clarifier. The elevation of the skimmer needs to be adjusted so that these solids are returned to the aeration tank.

One surface sand filter bed was completely flooded. A garden hose was placed in this filter bed to drain the water into a field adjacent to the plant. You are not permitted to bypass any portion of the treatment system. The hose must be removed immediately. The contents of this filter bed must be pumped to the second filter bed, which at the time of the inspection, was in very good condition. The contents of the chlorine contact tank were turbid.

A review of your self monitoring reports covering the period October 2006 through December 2007 revealed the following effluent violations:

Reporting Period	Station	Parameter	Limit Type	Limit	Reported Value	Violation Date
October 2006	001	Chlorine, Total Residu	1D Conc	0.019	.1	10/16/2006
January 2007	001	Total Suspended Solids	7D Conc	18	50.	1/22/2007
January 2007	001	pH	1D Conc	6.5	6.	1/31/2007
October 2007	001	Fecal Coliform	30D Conc	1000	3700.	10/1/2007
October 2007	001	Fecal Coliform	7D Conc	2000	3700.	10/22/2007
December 2007	001	Dissolved Oxygen	1D Conc	6.0	5.	12/4/2007
December 2007	001	Dissolved Oxygen	1D Conc	6.0	4.	12/11/2007
December 2007	001	Dissolved Oxygen	1D Conc	6.0	4.	12/18/2007
December 2007	001	Dissolved Oxygen	1D Conc	6.0	4.	12/26/2007

Ms. Joyce Humphrey
Oakhill Manor, Inc.
February 7, 2008
Page 2

You are directed to respond to this office, in writing, as to the measures that will be taken to ensure that the sand filter beds are not bypassed in the future. Should you have any questions or comments regarding this letter, please contact this office at (330) 963-1197.

Sincerely,




Dean W. Stoll, P.E.
Environmental Engineer
Division of Surface Water


DWS/mt

cc: Todd Ascani, Stark County Health Department,

File: Semi-Public/Oakhill Manor

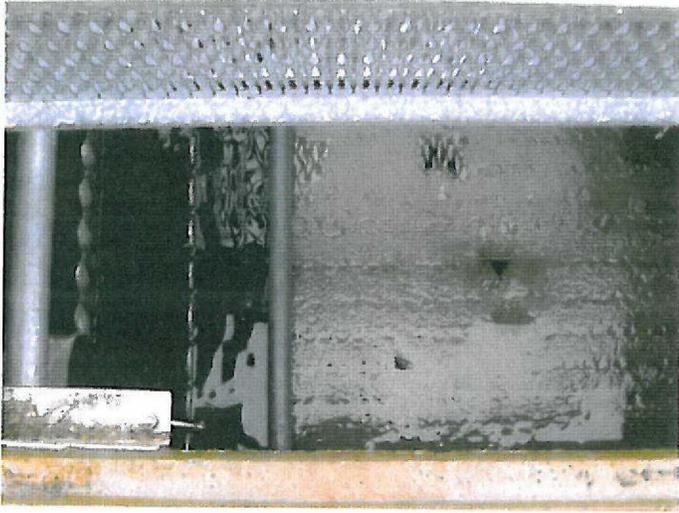

Clarifier – note solids

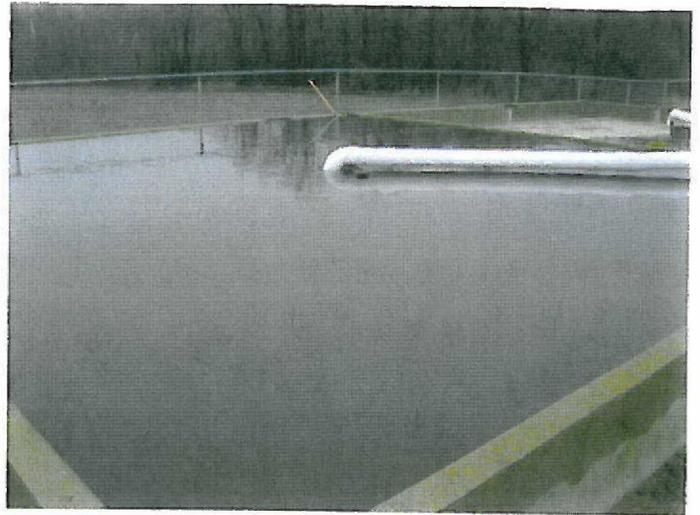

Flooded sand filter bed



Surface sand filter – note garden hose