



Environmental  
Protection Agency

John R. Kasich, Governor  
Mary Taylor, Lt. Governor  
Scott J. Nally, Director

Re: Notice of Violation  
Auglaize County  
Country Club Hills Property Owners Association  
Ohio EPA Permit No. 2PW00007  
NPDES Permit No. OH0125423

September 23, 2011

Mr. Curt Will, President  
Country Club Hills Property Owners Association  
18891 State Route 501  
Wapakoneta, Ohio 45895

Dear Mr. Will:

We are in receipt of your self-monitoring reports covering the months of April through June 2011 for the referenced facility. Our review indicates violations of the conditions of your NPDES permit. The specific instances of noncompliance are attached on a separate sheet. Further review of your self-monitoring reports for the previous six months, ending in June 2011, indicates that you are in significant non-compliance (SNC) with several effluent limitations contained in your NPDES permit. The specific instances of SNC are attached on a separate sheet.

We have received Mr. Leimeister's responses for the above mentioned violations and require no further information at this time.


Please be advised that failure to comply with the effluent limitations and/or monitoring requirements, including adequate laboratory controls, appropriate quality assurance procedures, and records retention, as specified in your Part III-General conditions of your NPDES permit may be cause for enforcement action pursuant to Ohio Revised Code, Chapter 6111. If these violations continue to occur and if satisfactory progress is not made, it may be necessary to initiate enforcement action to achieve compliance.

The Ohio EPA strongly encourages pollution prevention as the preferred approach for waste management. The first priority of pollution prevention is to eliminate the generation of wastes and pollutants at the source (source reduction). For those wastes or pollutants that are generated, the second priority is to recycle or reuse them in an environmentally sound manner. You can benefit economically, help preserve the environment, and improve your public image by implementing pollution prevention programs. For more information about pollution prevention, including fact sheets or U. S. EPA's "*Facility Pollution Prevention Guide*" (EPA/600/R-92.008), please contact the Ohio EPA Pollution Prevention Section at (614)644-3469.

Mr. Curt Will  
September 23, 2011  
Page Two

If there are any questions, please contact me at (419) 373 – 3022.

Sincerely,

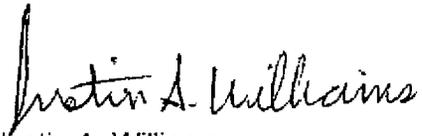

Justin A. Williams  
Division of Surface Water

/cs

Enclosures

pc w/Enclosures: Mr. Wade Leimeister  
~~NWDO – DSW-File~~

Get New Data

Get Detail for Selected Permit

## Facilities in Significant Non-Compliance \*\*

Period: Jan-11 Jun-11

County	Permit #	Facility Name	Major	Station Code	Param Code	Parameter Name	Max % Exceed	# Months Signif Exceed (1)**	# Months Exceed (2)
Auglaize	2PW00007	Country Club Hills Property Owners /		1	00530	Total Suspended Solids	3401.1	2	2
Auglaize	2PW00007	Country Club Hills Property Owners /		1	00610	Nitrogen, Ammonia (NH3)	17279	6	6
Auglaize	2PW00007	Country Club Hills Property Owners /		1	80082	CBOD 5 day	5099.2	5	6

### Footnotes


#### for Significant NonCompliance

\*\* Significant non-compliance with effluent limits occurred if one or more pollutants met the following conditions:

1. During 2 or more months, the reported effluent concentration (or computed load) for a parameter exceeded an effluent limit by:
  - a. 40% for Group 1 pollutants **plus Fecal Coliform**
  - b. 20% for Group 2 pollutants **plus pH, Temperature, whole effluent toxicity**
- or --
2. During 4 or more months, the reported concentration (or computed load) exceeded the limit by > 1%.

Note: This method differs from USEPA Significant Non-compliance (SNC) method in the following ways:

- USEPA only evaluates SNC for average limits. In above analyses, maximum and weekly limits were also considered.



Get New Data

Violations for Country Club Hills Homeowner's Association - April - June 2011

Permit No	Reporting Period	Station	Reporting Code	Parameter	Limit Type	Limit	Reported Value	Violation Date
2PW00007*CD	May 2011	001	00530	Total Suspended Solids	30D Conc	12	13.	5/1/2011
2PW00007*CD	May 2011	001	00530	Total Suspended Solids	1D Qty	0.14	.82369	5/25/2011
2PW00007*CD	May 2011	001	00530	Total Suspended Solids	30D Qty	0.09	.82369	5/1/2011
2PW00007*CD	May 2011	001	00610	Nitrogen, Ammonia (NH3)	1D Conc	1.5	19.2	5/25/2011
2PW00007*CD	May 2011	001	00610	Nitrogen, Ammonia (NH3)	30D Conc	1.0	19.2	5/1/2011
2PW00007*CD	May 2011	001	00610	Nitrogen, Ammonia (NH3)	1D Qty	0.01	1.21653	5/25/2011
2PW00007*CD	May 2011	001	00610	Nitrogen, Ammonia (NH3)	30D Qty	0.007	1.21653	5/1/2011
2PW00007*CD	May 2011	001	31616	Fecal Coliform	1D Conc	2000	13000.	5/25/2011
2PW00007*CD	May 2011	001	31616	Fecal Coliform	30D Conc	1000	13000.	5/1/2011
2PW00007*CD	May 2011	001	80082	CBOD 5 day	1D Conc	15	17.	5/25/2011
2PW00007*CD	May 2011	001	80082	CBOD 5 day	30D Conc	10	17.	5/1/2011
2PW00007*CD	May 2011	001	80082	CBOD 5 day	1D Qty	0.11	1.07714	5/25/2011
2PW00007*CD	May 2011	001	80082	CBOD 5 day	30D Qty	0.08	1.07714	5/1/2011
2PW00007*CD	April 2011	001	00530	Total Suspended Solids	1D Conc	18	25.	4/27/2011
2PW00007*CD	April 2011	001	00530	Total Suspended Solids	30D Conc	12	25.	4/1/2011
2PW00007*CD	April 2011	001	00530	Total Suspended Solids	1D Qty	0.14	3.15101	4/27/2011
2PW00007*CD	April 2011	001	00530	Total Suspended Solids	30D Qty	0.09	3.15101	4/1/2011
2PW00007*CD	April 2011	001	00610	Nitrogen, Ammonia (NH3)	1D Conc	4.5	6.48	4/27/2011
2PW00007*CD	April 2011	001	00610	Nitrogen, Ammonia (NH3)	30D Conc	3.0	6.48	4/1/2011
2PW00007*CD	April 2011	001	00610	Nitrogen, Ammonia (NH3)	1D Qty	0.03	.81674	4/27/2011
2PW00007*CD	April 2011	001	00610	Nitrogen, Ammonia (NH3)	30D Qty	0.02	.81674	4/1/2011
2PW00007*CD	April 2011	001	80082	CBOD 5 day	1D Conc	15	33.	4/27/2011
2PW00007*CD	April 2011	001	80082	CBOD 5 day	30D Conc	10	33.	4/1/2011
2PW00007*CD	April 2011	001	80082	CBOD 5 day	1D Qty	0.11	4.15934	4/27/2011
2PW00007*CD	April 2011	001	80082	CBOD 5 day	30D Qty	0.08	4.15934	4/1/2011
2PW00007*CD	June 2011	001	00610	Nitrogen, Ammonia (NH3)	1D Conc	1.5	13.1	6/27/2011
2PW00007*CD	June 2011	001	00610	Nitrogen, Ammonia (NH3)	30D Conc	1.0	13.1	6/1/2011
2PW00007*CD	June 2011	001	00610	Nitrogen, Ammonia (NH3)	1D Qty	0.01	.08925	6/27/2011
2PW00007*CD	June 2011	001	00610	Nitrogen, Ammonia (NH3)	30D Qty	0.007	.08925	6/1/2011
2PW00007*CD	June 2011	001	80082	CBOD 5 day	30D Conc	10	11.	6/1/2011

