



**Environmental
Protection Agency**

John R. Kasich, **Governor**
Mary Taylor, **Lt. Governor**
Scott J. Nally, **Director**

OH7044512 RICHLAND RURAL LIFE CENTER CNO3 03 02/15/11



February 15, 2011

RICHLAND RURAL LIFE CTR
945 CRALL RD
MANSFIELD, OH 44903

Re: RICHLAND COUNTY
RICHLAND RURAL LIFE CENTER PWS
Transient Noncommunity Water System
PWS ID: OH7044512
STU ID: 7057791

NOTICE OF VIOLATION - ACTION REQUIRED

Subject: Failure to Monitor Drinking Water

Richland Rural Life Center Pws is in violation of Ohio Administrative Code Rule 3745-81-23 for failing to monitor your drinking water during the January 1, 2010 to December 31, 2010 monitoring period and/or report results for the following contaminants: NITRATE (AS N)

In order to return to compliance, Richland Rural Life Center Pws must take the following actions:

1. Immediately collect a sample of your drinking water from the entry point (first tap after treatment).
2. Submit the sample for analysis to a certified laboratory on the enclosed list.
3. Notify your customers using the enclosed instructions and public notice.
4. Complete and return the enclosed verification form to this office.

Your prompt attention to this matter is greatly appreciated. Continued noncompliance may lead to enforcement actions. If you have any questions or if the required sample was tested, please call me at (614) 644-2752.

Sincerely,

Wendy Sheeran
Division of Drinking and Ground Waters

Enclosure: Public Notice; Public Notice Instructions and Verification Form; Laboratory List
cc: Superintendent/Manager; DDAGW-NWDO file; DDAGW-CO file

50 West Town Street, Suite 700
P.O. Box 1049
Columbus, Ohio 43216-1049

614 | 644 2752
614 | 644 2909 (fax)
www.epa.ohio.gov

DRINKING WATER NOTICE

Monitoring requirements not met for Richland Rural Life Center Pws

We are required to monitor your drinking water for specific contaminants on a regular basis. Results of regular monitoring are an indicator of whether or not our drinking water meets health standards. During the January 1, 2010 to December 31, 2010 time period we did not monitor for the following contaminants and therefore cannot be sure of the quality of our drinking water during that time:
NITRATE (AS N).

What Should I Do?

This notice is to inform you that Richland Rural Life Center Pws did not monitor and report results for the presence of the contaminants listed above in the public drinking water system during the January 1, 2010 to December 31, 2010 time period, as required by the Ohio Environmental Protection Agency. You do not need to take any actions in response to this notice.

What Is Being Done?

Upon being notified of this violation, the water supply was required to have the drinking water analyzed for the above mentioned parameters. The water supplier will take steps to ensure that adequate monitoring will be performed in the future.

Additional information may be obtained by contacting Richland Rural Life Center Pws at:

Contact Person: _____

Phone Number: _____

Mailing Address: _____

Please share this information with all the other people who drink this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools and businesses). You can do this by posting this notice in a public place or distributing copies by hand or mail

PWSID: OH7044512 Facility ID: 7057791 Date Distributed: _____

2011 CONTAMINANT MONITORING SCHEDULE

PWS ID: OH7044512 PWS NAME: RICHLAND RURAL LIFE CENTER PWS

PWS TYPE: Transient Noncommunity SOURCE: Ground Water

Groundwater Rule Minimal Treatment System

Effective Date: 1/1/11

THIS SCHEDULE DOES NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378


STATE FACILITY ID: 7057791 FACILITY NAME: RICHLAND RURAL LIFE CTR

Chemicals	Monitoring Requirements	Sample Monitoring Point
NITRATE - 1040	1 Sample(s) between 6/1/2011 and 10/31/2011	Sample should be taken at EP001
NITRITE - 1041	Not Required	

STATE FACILITY ID: DS1 FACILITY NAME: DISTRIBUTION SYSTEM

Chemicals	Monitoring Requirements	Sample Monitoring Point
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Quarterly between 1/1/2011 and 12/31/2011	Sample should be taken at DS000

Where to Collect Samples For a Small Public Water System

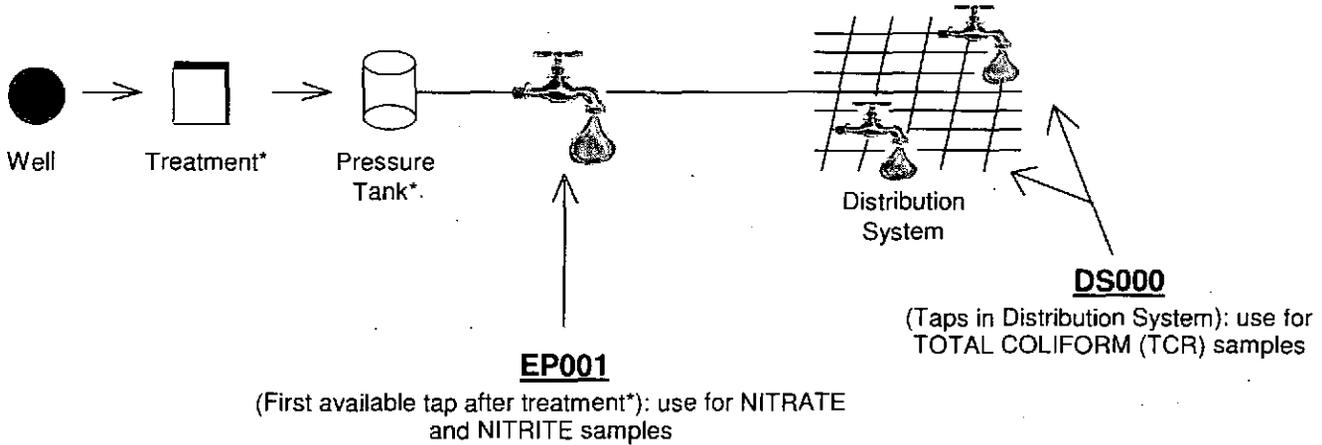

* If system does not have treatment, EP001 is the first tap after the well.

Use for Sample Tracking Purposes				
Nitrate Sample Date(s):				
TCR Quarterly Sample Date(s):	Jan - Mar Sample Date(s)	Apr - Jun Sample Date(s)	Jul - Sept Sample Date(s)	Oct - Dec Sample Date(s)

