



\*4GC0258420090820\*

2009/08/20

4GC02584

CITY OF PICKERINGTON STP



State of Ohio Environmental Protection Agency

REET ADDRESS:

Lazarus Government Center  
50 W. Town St., Suite 700  
Columbus, Ohio 43215

**Central District Office**

TELE: (614) 728-3778 FAX: (614) 728-3898  
www.epa.state.oh.us

MAILING ADDRESS:

P.O. Box 1049  
Columbus, OH 43216-1049

August 20, 2009

Brenda I. Van Cleave  
City of Pickerington  
100 Lockville Road  
Pickerington, OH 43147

**Re: Storm Water Inspection at City of Pickerington Sewage Treatment Plant  
Permit #4GC02584\*AG**

Dear Ms. Van Cleave:

This letter is written in follow-up to a construction storm water inspection by Heather Nichols and Clarissa Lawlis of the Ohio EPA, at City of Pickerington Sewage Treatment Plant located at 525 Hill Road South in Pickerington, Ohio on August 3, 2009. The purpose of the inspection was to evaluate compliance with the General Storm Water Permit Associated with Construction Activities. During the inspection, we noted the following:

**Maintenance of Controls:**

- The perimeter silt fence is functioning as intended. This general permit states that all sediment controls will be inspected and maintained every seven days or within 24 hours of a precipitation event equal to or greater than 0.5 inches. A log of inspection must be maintained on site for the agency to review.
- The north entrance of the site must be stabilized to prevent sediment runoff (See Figure 1).

If you have any questions regarding this letter or the inspection, please do not hesitate to contact me at our Central District Office at (614) 728-3844. Follow-up inspections will be conducted to ensure the conditions of the General Permit are continuing to be met.

Sincerely,


Harry Kallipolitis  
Storm Water Coordinator  
Division of Surface Water  
Central District Office

c: Jeff Bohne, Water Quality Supervisor, DSW/CDO

HK/nsm City of Pickerington Sewage Treatment Plant

Ted Strickland, Governor  
Lee Fisher, Lieutenant Governor  
Chris Korteski, Director





City of Pickerington STP  
Sycamore Creek Watershed  
Photo by: Clarissa Lawile  
August 3, 2009

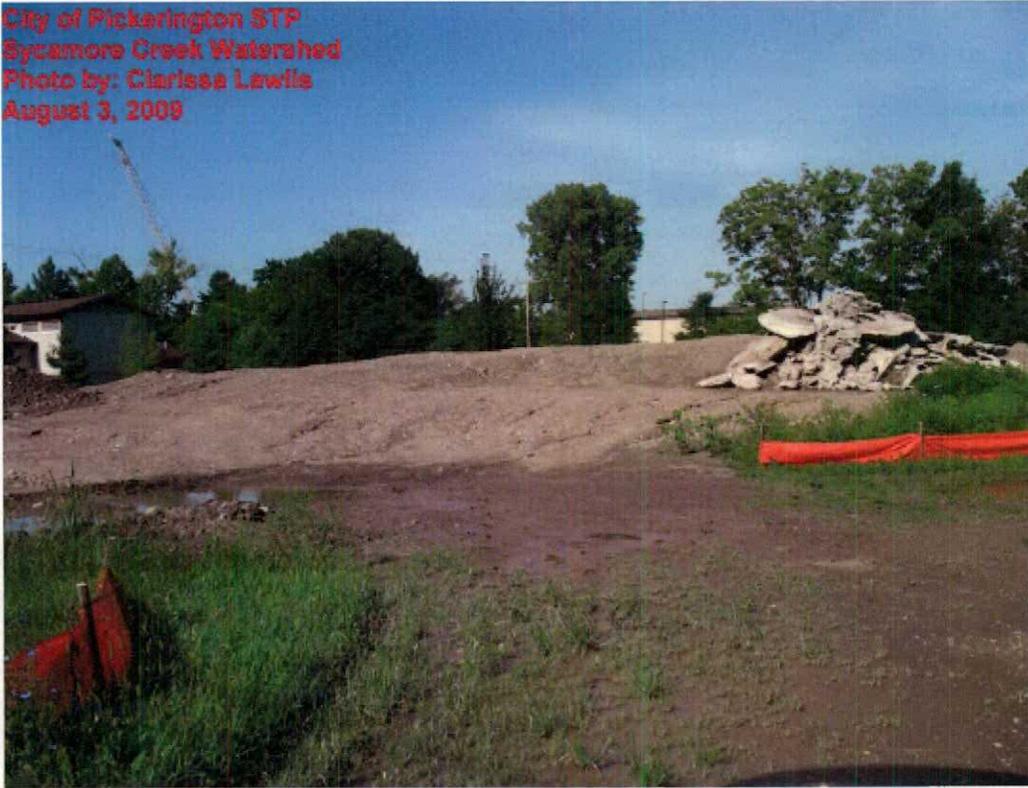


Figure 1 Entrance needs stabilization

