

4/19/2010

State of Ohio Environmental Protection Agency

STREET ADDRESS:

Central District Office

MAILING ADDRESS:

Lazarus Government Center
50 W. Town St., Suite 700
Columbus, Ohio 43215

TELE: (614) 728-3778 FAX: (614) 728-3898
www.epa.state.oh.us

P.O. Box 1049
Columbus, OH 43216-1049

Certified Mail #91 7108 2133 3932 4449 5354

April 14, 2010

Jim Herd
Fairfield Union Local School District
6401 Cincinnati-Zanesville Road
Lancaster, OH 43130

**Re: Third Notice of Violation
Fairfield Union HS / Fairfield County**

Dear Mr. Herd:

This letter is written in follow-up to a construction storm water inspection that I conducted at the Fairfield Union High School and the road-widening project along State Route 22. This site is located at 6401 Cincinnati-Zanesville Road near Rushville, Ohio and the inspection was conducted on April 7, 2010. The purpose of the inspection was to evaluate compliance with the General Storm Water Permit Associated with Construction Activities. Please consider this the third formal notice of violation with your permit. During the inspection, the following items were noted:

Barren Areas: 21 Day Rule:

- Be aware the General Permit states that all barren areas which remain idle in excess of 21 days must be protected from erosion within seven days of the last earth disturbing activities. In addition, erosion protection must be implemented for all areas of final grade within seven (7) days. This regulation directly applies to the areas along Cincinnati-Zanesville Road in front of the old school, as well as an area at the entrance of the new school. Several areas have been barren for several months. Please see attached pictures.
- There was a lot of fugitive dust on the pavement around the old school building near the construction trailer. This fugitive dust must be removed and future fugitive dust prevented.

Ted Strickland, Governor
Lee Fisher, Lieutenant Governor
Chris Korleski, Director

Jim Herd
Fairfield Union Local School District
Page 2

If you have any questions regarding this letter or the inspection, please do not hesitate to contact me at our Central District Office at (614) 728-3851. Follow-up inspections will be conducted to ensure the conditions of the General Permit are continuing to be met. If the issues above are not addressed within seven days, escalated enforcement may be taken.

Sincerely,




Gregory L. Sanders
Environmental Specialist
Division of Surface Water
Central District Office

Enclosure


c: Jeff Bohne, Water Quality Supervisor, DSW/CDO
Jonathan I. Ferbrache, Fairfield Soil and Water Conservation District
Kevin Mohler, Bovis Lend Lease


GS/nsm Fairfield Union HS, April 7, 2010

Fairfield Union School
Stabilize barren areas
Rush Creek Watershed
April 7, 2010
Photo by: Greg Sanders

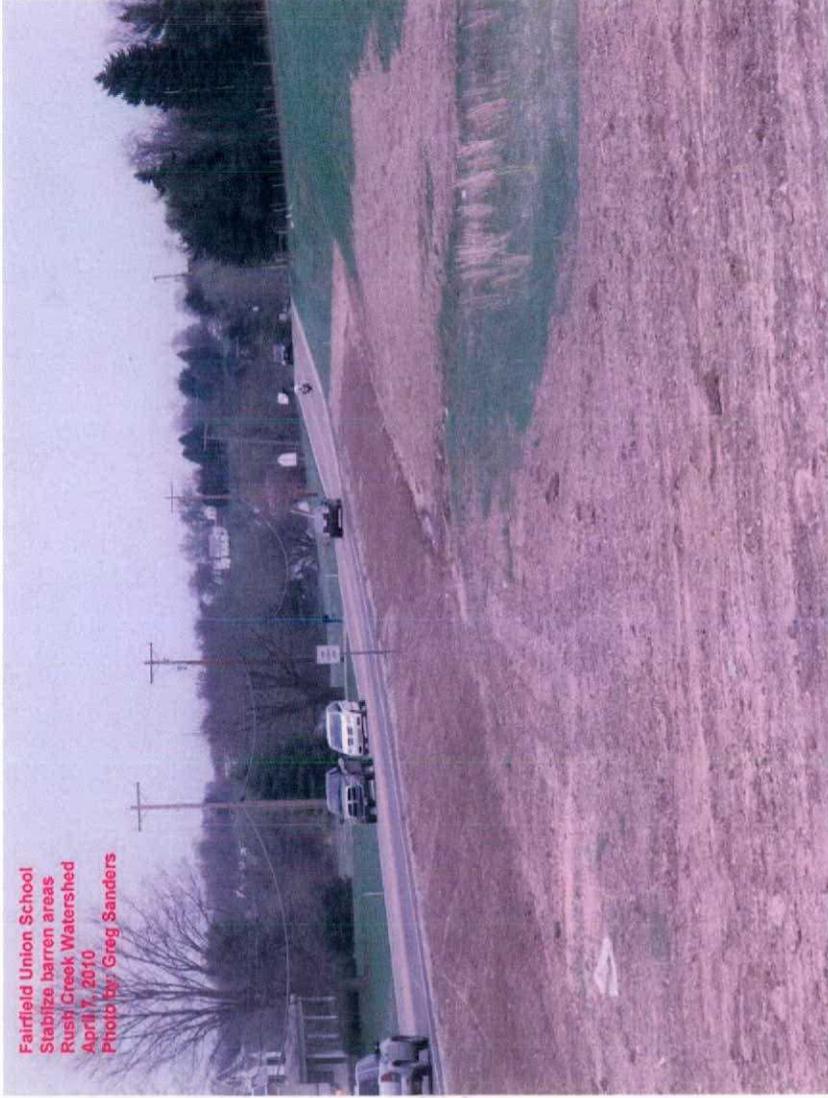

Fairfield Union School
Stabilize barren areas
Rush Creek Watershed
April 7, 2010
Photo by: Greg Sanders

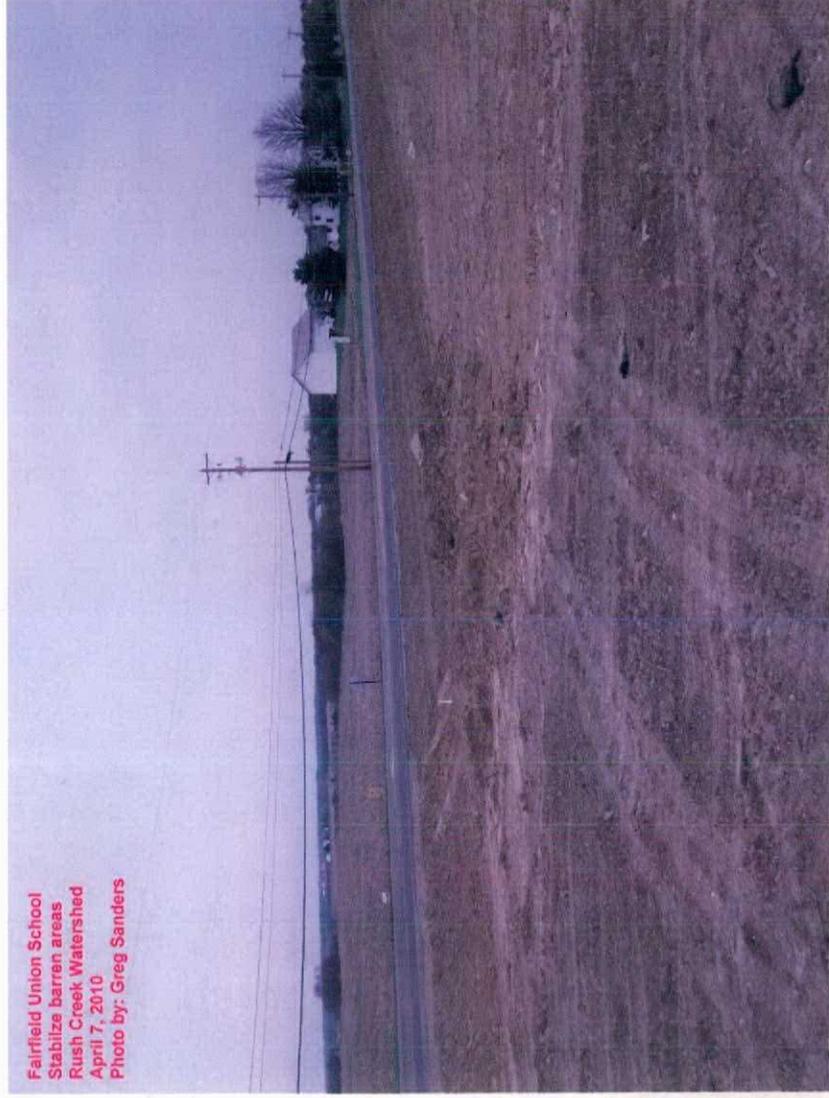



Fairfield Union School
Stabilize barren areas
Rush Creek Watershed
April 7, 2010
Photo by: Greg Sanders



Fairfield Union School
Control fugitive dust
Rush Creek Watershed
April 7, 2010
Photo by: Greg Sanders



100

