



**Environmental
Protection Agency**

John R. Kasich, Governor
Mary Taylor, Lt. Governor
Scott J. Nally, Director



NOTICE OF VIOLATION – ACTION REQUIRED

Re: Ottawa County
Allen Park Mobile Court
Community Water System
PWS ID# 6204112
STU ID# 6256919

January 26, 2012

Mr. Dennis B. Brophy
Pacific NW Property Management
15685 SW 116th Street, #109
King City, Oregon 97224-2695

Dear Mr. Brophy:

The Division of Drinking and Ground Waters (DDAGW) Plant – Distribution Monthly Operating Report (MOR) for the month of December 2011, was received by the Ohio EPA-Northwest District Office (NWDO) as required on January 4, 2011.

Review of the December 2011, MOR indicates that the analytical result (1.4 mg/L) for iron exceeds the secondary maximum contaminant level (MCL). The Ohio Administrative Code (OAC) rule 3745-82-02 establishes the secondary MCL at (0.3 mg/L) for iron. OAC rule 3745-91-09 requires provision of treatment for removal of iron when an excessive amount of this substance is present in the untreated water. Consider the following items to determine why the standard is not being met:

1. Review the sampling location and technique used (i.e. was the sample pulled too soon after backwash events?)
2. Review the operation/maintenance of the filtering units (i.e. what is the head loss across the whole unit, is the filter media cemented or is channeling of the media occurring?)
3. Provide additional units/new equipment, or change treatment sequence. *


* **Note:** Plan approval by this agency is required whenever a substantial change is made to the water system.

Mr. Dennis B. Brophy
January 26, 2012
Page 2

Further review of the December 2011, MOR indicates that the total chlorine residual concentration (0.08 mg/L), which was measured at the same time the routine total coliform bacterial sample was collected, was below the minimum acceptable standard for chlorine residuals at least one day during the month. The sum of the free and combined chlorine residuals is considered to be the total chlorine residual. OAC rule 3745-83-01 requires that each community water system maintain a minimum of 0.2 milligrams per liter (mg/L) free chlorine residual or 1.0 mg/L combined chlorine residual measured at representative points throughout the distribution system.

If you have any questions regarding this letter, or any other matter involving your PWS, then contact me directly by telephone at (419) 373-3088 or via electronic messaging at jack.schwartz@epa.state.oh.us.

Sincerely,

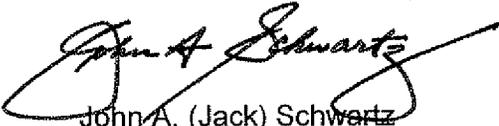

John A. (Jack) Schwartz
Environmental Specialist 2
Public Drinking Water Unit
Division of Drinking and Ground Waters

JAS/lir

pc: Lorell Anderson, Park Manager
Zach Danzer, Maintenance Manager
Joseph L. St. Clair, Operator
Ottawa County Health Department
DDAGW, NWDO Correspondence File

ec: Linda S. Benham, Environmental Supervisor, DDAGW, NWDO
Justin Bowerman, DOCC, DDAGW, NWDO