



State of Ohio Environmental Protection Agency

STREET ADDRESS:

W. Zarus Government Center
50 W. Town St., Suite 700
Columbus, Ohio 43215

Central District Office

TELE: (614) 728-3778 FAX: (614) 728-3898
www.epa.state.oh.us

MAILING ADDRESS:

P.O. Box 1049
Columbus, OH 43216-1049

August 26, 2010

Donna Denning
Kno-Ho-Co Community Action Commission
120 North Fourth Street
Coshocton, OH 43812

**Re: Construction Storm Water Inspection at Heart of Ohio Estates / Knox County
Permit Number 4GC03174*AG**

Dear Ms. Denning:

This letter is written in follow-up to a construction storm water inspection conducted by Stephen Riley and Megan Reising of Ohio EPA at Heart of Ohio Estates located at the end of Cleveland Avenue, Centerburg, Ohio on August 05, 2010. The purpose of the inspection was to evaluate compliance with the General Storm Water Permit Associated with Construction Activities. The following was noted:

Sediment and Erosion Control:

- There is a lack of erosion controls around the outlet on the east side of the property (Figure 1). Please install control measures to this area to minimize uncontrolled discharges to waters of the state.

Post Construction Requirements:

- The General Storm Water Permit requires specific post construction water quality treatment for all sites. Guidance regarding the post construction requirements is found at: <http://www.epa.state.oh.us/dsw/storm/CGPPCQA.aspx>. Please submit to my attention (email preferred at harry.kallipolitis@epa.state.oh.us) which practice will be installed at this site to ensure compliance with the General Permit. Please include all design criteria and calculations in your submission.

If you have any questions regarding this letter or my inspection, please do not hesitate to contact me at our Central District Office at 614-728-3844 or email at harry.kallipolitis@epa.state.oh.us.

Sincerely,

Harry Kallipolitis
Storm Water Coordinator
Division of Surface Water
Central District Office


Enclosure

c: Jeff Bohne, Water Quality Supervisor, DSW/CDO

HK/nsm Heart of Ohio Estates 8-5-10

Ted Strickland, Governor
Lee Fisher, Lieutenant Governor
Chris Korleski, Director





Heart of Ohio Estates
Licking River Watershed
Photo by Stephen Riley and Megan Reising
August 5, 2010

Note: Lack of controls around outlet

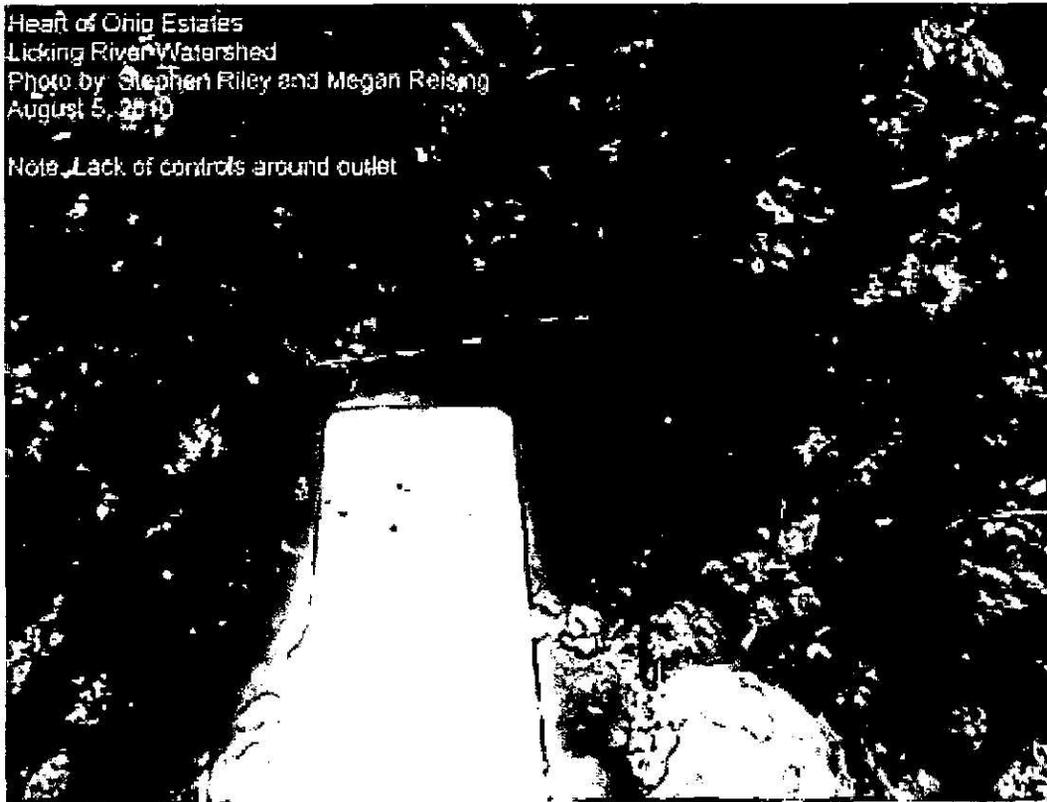


Figure 1: Lack of controls around outlet

