



State of Ohio Environmental Protection Agency

STREET ADDRESS:

Lazarus Government Center
50 W. Town St., Suite 700
Columbus, Ohio 43215

Central District Office

TELE: (614) 728-3778 FAX: (614) 728-3898
www.epa.state.oh.us

MAILING ADDRESS:

P.O. Box 1049
Columbus, OH 43216-1049

June 21, 2010

Jerry Lee
7434 Wyndale Court
Dublin, OH 43016

Re: Dollar General Store – Alum Creek Drive / Franklin County

Dear Mr. Lee:

This letter is written regarding the storm water inspection that I conducted at the Dollar General Store located at 4050 Alum Creek Drive, Columbus, Ohio, on June 17, 2010. The Ohio EPA has approved this site for coverage under the General Storm Water Permit associated with Construction Activities. I will be conducting future storm water inspections to ensure compliance with the General Permit. Please be aware the Agency will be ensuring the following conditions are addressed:

Sediment and Erosion Controls:

- Silt fence is needed during earth disturbances to keep your soil from running into Ohio Waterways during a rain event. During the inspection it was noted that silt fence was installed on this site, but in need of repair in several areas. Please address this issue within seven (7) days. Silt fence must be inspected every week or after a significant rain event. A log of the inspections must be kept on-site. Please see attached pictures.
- Please be aware the General Permit states that all barren areas which remain idle in excess of 21 days must be protected from erosion within seven days of the last earth disturbing activities. In addition, erosion protection must be implemented for all areas of final grade within seven (7) days. There were several areas that needed to be stabilized or re-seeded. Please see attached pictures.
- A concrete wash-out pit must be installed on site for your concrete wash-out material.

If you have any questions regarding this letter or the inspection, please do not hesitate to call me at our Central District Office at (614) 728-3851.


Sincerely,

Gregory L. Sanders
Environmental Specialist
Division of Surface Water
Central District Office


c Jeff Bohne, Water Quality Supervisor, DSW/CDO

GS/nsm Dollar General Store – Alum Creek Drive, June 17, 2010

Ted Strickland, Governor
Lee Fisher, Lieutenant Governor
Chris Korleski, Director



Dollar General Store
Repair silt fence
Big Walnut Creek Watershed
June 17, 2010
Photo by: Greg Sanders

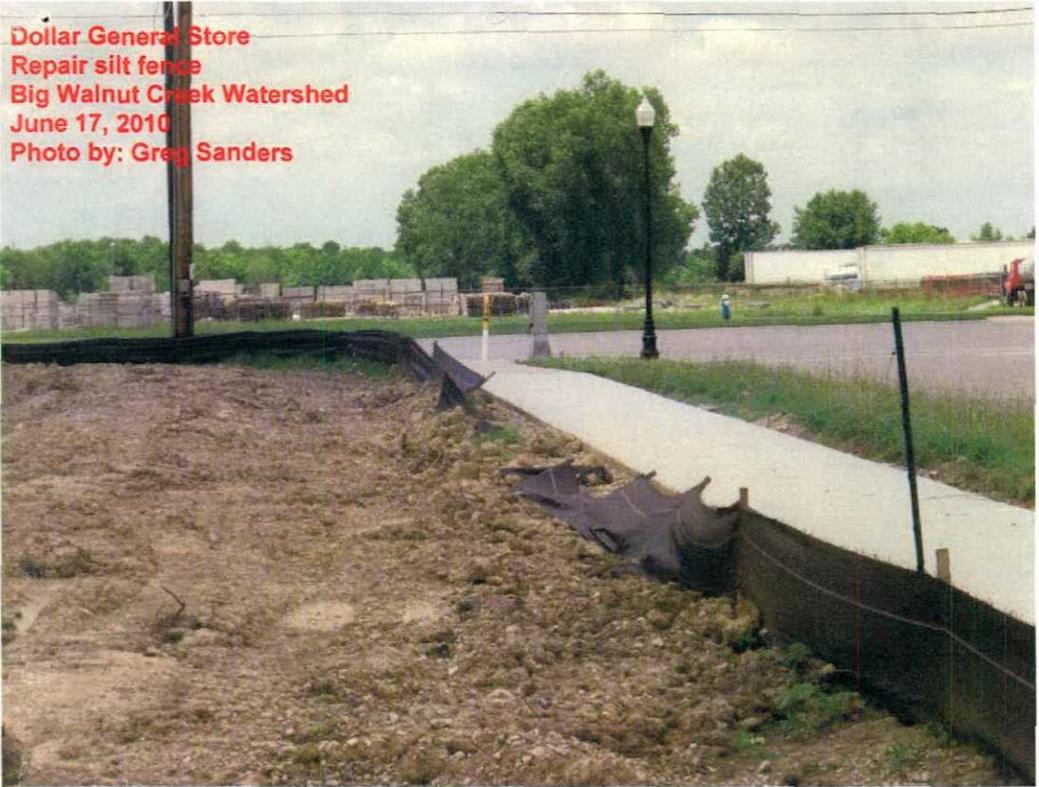

Dollar General Store
Repair silt fence
Big Walnut Creek Watershed
June 17, 2010
Photo by: Greg Sanders



