



State of Ohio Environmental Protection Agency

STREET ADDRESS:

Central District Office

MAILING ADDRESS:

Lazarus Government Center
50 W. Town St., Suite 700
Columbus, Ohio 43215

TELE: (614) 728-3778 FAX: (614) 728-3898
www.epa.state.oh.us

P.O. Box 1049
Columbus, OH 43216-1049

April 13, 2010

Mr. James Salyer
6372 126th Ave.
Largo, FL 34643

**Re: 4PY00001/OH0105902
Reconnaissance Inspection
Greentree WWTP
Madison County**

Dear Mr. Salyer:

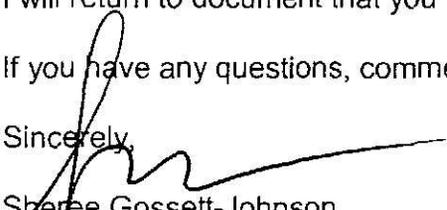
This inspection was conducted on April 12, 2010, by Ohio EPA personnel. The purpose of this inspection was to evaluate the condition and operating capabilities of the wastewater treatment plant (WWTP) as well as to offer technical assistance to aid you in achieving high quality effluent and compliance with your National Pollutant Discharge Elimination System (NPDES) permit. At the time of the inspection the piled used slow sand filter sand area around the outfall was unacceptable and in violation of your NPDES permit. In addition, the Big Darby tributary was full of trash and tires see attached pictures.

To avoid escalated enforcement, on or before Friday, April 16, 2010, remove the sand, trash and tires and take them to the landfill. Provide a dumpster so that the staff can bag the used filter sand and toss into the dumpster.

I will return to document that you have corrected the inappropriate method of slow sand filter sand.

If you have any questions, comments or concerns, please call me at (614) 728-3847.

Sincerely,



Sherree Gossett-Johnson
Environmental Specialist II
Compliance/Enforcement Section
Division of Surface Water

Attachment

c: Greentree MHP Manager, Vicky Joos
Andrew Griner, Wenelco

SGJ/nsm Greentree10

Ted Strickland, Governor
Lee Fisher, Lieutenant Governor
Chris Korleski, Director

NOV Bar Code Separator Sheet Template – use this sheet to correct permit number information when errors are found



4PD0000220110822

- Type the correct permit number and date in both lines
- Highlight the upper line
- Change the font to Code3of9High



Environmental
Protection Agency

John R. Kasich, Governor
Mary Taylor, Lt. Governor
Scott J. Nally, Director

FILE COPY

August 22, 2011

Allen Dawson, WWTP Superintendent
Washington Court House WWTP
1210 South Elm Street
Washington C.H. OH 43160

**Re: Washington Court House WWTP
NPDES Permit 4PD00002/ OH0028002
Compliance Evaluation Inspection
Fayette County
Notice of Violation**

Dear Mr. Dawson:

On August 10, 2011, a Compliance Evaluation Inspection was conducted at the Washington Court House WWTP. Present for the inspection were Ralph Fast representing Washington Court House, John Owen and myself of the Ohio EPA, Central District Office, Division of Surface Water.

The purpose of the inspection was to evaluate compliance with the terms and conditions of your NPDES permit and to evaluate the operation and maintenance of the plant. At this time the wastewater treatment plant and the associated collection system were unsatisfactory. As soon as possible, submit to this office the following:

1. The collection system has continued to have sanitary sewer overflows. Provide this office with a comprehensive plan to eliminate the sanitary sewer overflows.
2. If the flow that does enter the plant's influent pump station exceeds the headwork's capacity it then bypasses secondary treatment. By-passing secondary treatment is prohibited by your NPDES permit. Submit a permit to install application for the upgrade.
3. The screening facility does not have adequate capacity. Submit a permit to install application for the upgrade.
4. The preliminary treatment facility does not have adequate capacity. Submit a permit to install application for the upgrade.

5. The aeration tanks need to be modified to provide adequate treatment. Submit a permit to install application for the upgrade.
6. Wet weather equipment includes aeration tanks, aerobic digesters, and wet weather settling tanks need to be constructed. Submit a permit to install application for the upgrade.

Enclosed is a copy of the NPDES Compliance Inspection Report and attachments. If you have any questions or comments concerning the enclosed inspection report, please contact me at (614) 728-3847 or e-mail at sheree.gossett-johnson@epa.ohio.gov.

Sincerely,



Sheree Gossett-Johnson
Environmental Specialist II
Compliance and Enforcement
Division of Surface Water
Central District Office

c: Mr. Dennen, City Manager
Lawrence Helkowski, AGO

NPDES Compliance Inspection Report

SECTION A: NATIONAL DATA SYSTEM CODING

Permit #	NPDES #	Inspection Type	Inspector	Facility Type
4PD00002	OH0028002	CEI	S	
Inspection Date	Entry Time	Exit Time	Notice of Violation	Significant Non-Compliance
8/10/2011	1:00PM	2:00 PM	Yes	Yes

SECTION B: FACILITY DATA


Name and Location of Facility Inspected	Permit Effective Date
Washington Court House WWTP 1210 South Elm Washington Court House, Ohio 43160	7/1/2010
	Permit Expiration Date
	3/31/2015
Name(s) and Title(s) of On-Site Representatives	Phone Numbers
Allen Dawson, WWTP Superintendent	(740) 636-2383
Name and Title of Responsible Official	Phone Number
Joseph Dennen	(740) 636-2383

SECTION C: AREAS EVALUATED DURING INSPECTION

Key: S = Satisfactory, M = Marginal, U = Unsatisfactory, N = Not Evaluated

U	NPDES Compliance	Influent bypass's ,sanitary overflows, effluent violations
M	Operations & Maintenance	The equipment is inadequate and cannot be maintained.
M	Facility Site Review	Over land rather than underground sewer pipes are a safety hazard for the operators.
U	Collection System	Sanitary sewer overflows
S	Flow Measurement	
U	Receiving Waters	By-passes of sanitary sewage before secondary treatment.
S	Laboratory	

Signatures

	8/19/11		8/19/11
Sheree Gossett-Johnson, Inspector Compliance & Enforcement Division of Surface Water Central District Office	Date	Erin Sherer, Reviewer Compliance & Enforcement Supervisor Division of Surface Water Central District Office	Date

Compliance Data for Washington Court House WWTP between 1/1/2010 to 7/1/2011

Summary

Permit Effluent Limit Violations: 22
 Permit Effluent Code Violations: 2
 Permit Effluent Frequency Violations: 0
 Compliance Schedule Violations: 0
 Bypass from influent headworks: 8
 Sanitary Sewer Overflows: 6

Limit Violations						
Reporting Period	Station	Parameter	Limit Type	Limit	Reported Value	Violation Date
March 2010	001	Total Suspended Solids	30D Conc	12	24.3846	3/1/2010
March 2010	001	Total Suspended Solids	30D Qty	273	1468.42	3/1/2010
March 2010	001	Total Suspended Solids	7D Conc	18	74.25	3/8/2010
March 2010	001	Total Suspended Solids	7D Qty	409	4665.03	3/8/2010
March 2010	001	Dissolved Oxygen	1D Conc	6.0	4.6	3/13/2010
March 2011	001	Total Suspended Solids	30D Qty	273	296.916	3/1/2011
March 2011	001	Total Suspended Solids	7D Qty	409	733.382	3/8/2011
April 2011	001	Total Suspended Solids	30D Conc	12	13.1666	4/1/2011
April 2011	001	Total Suspended Solids	30D Qty	273	734.053	4/1/2011
April 2011	001	Mercury, Total (Low Le	30D Conc	12	12.05	4/1/2011
April 2011	001	Mercury, Total (Low Le	30D Qty	0.0002	.00048	4/1/2011
April 2011	001	Total Suspended Solids	7D Conc	18	27.6666	4/8/2011
April 2011	001	Total Suspended Solids	7D Qty	409	1731.33	4/8/2011
April 2011	001	Total Suspended Solids	7D Qty	409	782.486	4/15/2011
May 2011	001	Chlorine, Total Residu	1D Conc	0.019	.12	5/4/2011
May 2011	001	Dissolved Oxygen	1D Conc	6.0	3.6	5/11/2011
May 2011	001	Chlorine, Total Residu	1D Conc	0.019	.05	5/20/2011
May 2011	001	Chlorine, Total Residu	1D Conc	0.019	.05	5/21/2011

May 2011	001	Chlorine, Total Residu	1D Conc	0.019	.05	5/28/2011
May 2011	001	Chlorine, Total Residu	1D Conc	0.019	.05	5/29/2011
June 2011	001	Chlorine, Total Residu	1D Conc	0.019	.05	6/23/2011
June 2011	001	pH, Minimum	1D Conc	6.5	6.4	6/30/2011

Code Violations				
Reporting Period	Station	Parameter	Reported Value	Violation Date
May 2011	001	Fecal Coliform	AK	5/12/2011
May 2011	001	E. coli	AK	5/12/2011

NOV Bar Code Separator Sheet Template – use this sheet to correct permit number information when errors are found



4PT0010420110802

- Type the correct permit number and date in both lines
- Highlight the upper line
- Change the font to Code3of9High



Environmental
Protection Agency

John R. Kasich, Governor
Mary Taylor, Lt. Governor
Scott J. Nally, Director

August 2, 2011

Ervin Baldwin, Maintenance Supervisor
Tolles Career & Technical Center
7877 US Highway 42 South
Plain City, OH 43064

**Re: Tolles Career & Technical Center
NPDES Permit 4PT00104/ OH0121096
Reconnaissance Inspection
Madison County
Notice of Violation**

Dear Mr. Baldwin:


On July 19, 2011, a Reconnaissance Inspection was conducted at the Tolles Career & Technical Center. Present for the inspection were Suzanne Matz and myself of the Ohio EPA, Central District Office, Division of Surface Water.

The purpose of the inspection was to evaluate compliance with the terms and conditions of your NPDES permit and to evaluate the operation and maintenance of the plant. The plant appeared to have a gray cast to the aeration portion indicating low amounts of biomass. In addition the effluent was turbid.

After review of your effluent data, numerous violations were found. At this time your compliance status is considered in "significant non-compliance (SNC)". Once a facility reaches this status, escalated enforcement may be initiated which may include a monetary penalty.

Please contact the Compliance and Assistance unit, Jon van Dommelen at (614) 644-2011, immediately, for plant operation assistance. If you have any questions or comments concerning the enclosed inspection report, or attachments, please contact me at (614) 728-3847 or e-mail at sheree.gossett-johnson@epa.ohio.gov.

Sincerely,



Sheree Gossett-Johnson
Environmental Specialist II
Compliance and Enforcement
Division of Surface Water
Central District Office

SGJ/nsm tolles tech 2011

Central District Office
50 West Town Street, Suite 700
P.O. Box 1049
Columbus, OH 43216-1049

614 | 728 3778
614 | 728 3898 (fax)
www.epa.ohio.gov


NPDES Compliance Inspection Report

SECTION A: NATIONAL DATA SYSTEM CODING				
Permit #	NPDES #	Inspection Type	Inspector	Facility Type
4PT00104	OH0121096	RI	S	2
Inspection Date	Entry Time	Exit Time	Notice of Violation	Significant Non-Compliance
7/19/2011	4:00 PM	5:00 PM	Yes	Yes

SECTION B: FACILITY DATA	
Name and Location of Facility Inspected	Permit Effective Date
Tolles Career & Technical Center 7877 US Highway 42 South Plain City, OH 43064	3/1/2007
	Permit Expiration Date
	2/29/2012
Name(s) and Title(s) of On-Site Representatives	Phone Numbers
School District Superintendent	(614) 873-4666
Name and Title of Responsible Official	Phone Number
Ervin Baldwin, Maintenance Supervisor	(614) 873-4666

SECTION C: AREAS EVALUATED DURING INSPECTION		
Key: S = Satisfactory, M = Marginal, U = Unsatisfactory, N = Not Evaluated		
U	NPDES Compliance	Numerous effluent violations.
M	Operations & Maintenance	
S	Facility Site Review	
N	Collection System	
N	Flow Measurement	
U	Receiving Waters	Turbid effluent.
N	Laboratory	

Comments:

Signatures			
			
Sheree Gossett-Johnson, Inspector Compliance & Enforcement Division of Surface Water Central District Office	Date 7/24/11	Erin Sherer, Reviewer Compliance & Enforcement Supervisor Division of Surface Water Central District Office	Date 7/22/11

Compliance Data for Tolles Career & Technical Center between 5/1/2010 to 5/30/2011

Summary

Permit Effluent Limit Violations: 17

Permit Effluent Code Violations: 0

Permit Effluent Frequency Violations: 0

Compliance Schedule Violations: 0

Limit Violations						
Reporting Period	Station	Parameter	Limit Type	Limit	Reported Value	Violation Date
June 2010	001	Fecal Coliform	30D Conc	1000	1600.	6/1/2010
July 2010	001	Fecal Coliform	30D Conc	1000	1400.	7/1/2010
August 2010	001	Dissolved Oxygen	1D Conc	5.0	4.9	8/30/2010
September 2010	001	Fecal Coliform	30D Conc	1000	2200.	9/1/2010
September 2010	001	Fecal Coliform	7D Conc	2000	2200.	9/1/2010
October 2010	001	Chlorine, Total Residu	1D Conc	0.019	.05	10/4/2010
February 2011	001	Nitrogen, Ammonia (NH3	30D Conc	3.0	12.2	2/1/2011
February 2011	001	Nitrogen, Ammonia (NH3	7D Conc	4.5	12.2	2/1/2011
February 2011	001	Nitrogen, Ammonia (NH3	30D Qty	0.23	.23089	2/1/2011
February 2011	001	Dissolved Oxygen	1D Conc	5.0	4.3	2/7/2011
February 2011	001	Dissolved Oxygen	1D Conc	5.0	4.6	2/28/2011
March 2011	001	Dissolved Oxygen	1D Conc	5.0	4.7	3/7/2011
March 2011	001	Dissolved Oxygen	1D Conc	5.0	4.1	3/14/2011
March 2011	001	Dissolved Oxygen	1D Conc	5.0	4.7	3/28/2011
May 2011	001	Fecal Coliform	30D Conc	1000	1500.	5/1/2011
May 2011	001	Chlorine, Total Residu	1D Conc	0.019	.07	5/2/2011
May 2011	001	Chlorine, Total Residu	1D Conc	0.019	.06	5/16/2011

NOV Bar Code Separator Sheet Template – use this sheet to correct permit number information when errors are found



4PR0003120110802

- Type the correct permit number and date in both lines
- Highlight the upper line
- Change the font to Code3of9High



Environmental
Protection Agency

John R. Kasich, Governor
Mary Taylor, Lt. Governor
Scott J. Nally, Director

August 2, 2011

Richard Cassie, Owner
Suburbans Community MHP
1678 West First
Columbus, OH 43212

**Re: Suburbans Community MHP
NPDES Permit 4PR00031/ OH0054259
Reconnaissance Inspection
Madison County
Notice of Violation**

Dear Mr. Cassie:

On July 18, 2011, I conducted a Reconnaissance Inspection at the Suburbans Community MHP representing Ohio EPA, Central District Office, and Division of Surface Water.

The purpose of the inspection was to evaluate compliance with the terms and conditions of your NPDES permit and to evaluate the operation and maintenance of the plant. The plant odor indicated it had gone septic. In addition the effluent was turbid.

After review of your effluent data, extensive violations were found. At this time your compliance status is considered in "significant non-compliance (SNC)". Once a facility reaches this status, escalated enforcement may be initiated which may include a monetary penalty.

Please contact the Compliance and Assistance unit, Jon van Dommelen at (614) 644-2011, immediately, for plant operation assistance. If you have any questions or comments concerning the enclosed inspection report, or attachments, please contact me at (614) 728-3847 or e-mail at sheree.gossett-johnson@epa.ohio.gov.

Sincerely,



Sheree Gossett-Johnson
Environmental Specialist II
Enforcement and Compliance
Division of Surface Water
Central District Office

SGJ/nsm suburbans mhp 2011

Central District Office
50 West Town Street, Suite 700
P.O. Box 1049
Columbus, OH 43216-1049

614 | 728 3778
614 | 728 3898 (fax)
www.epa.ohio.gov

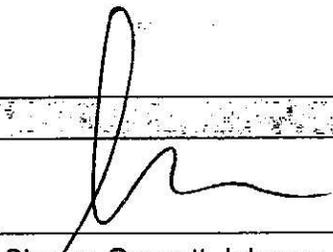
NPDES Compliance Inspection Report

SECTION A: NATIONAL DATA SYSTEM CODING				
Permit #	NPDES #	Inspection Type	Inspector	Facility Type
4PR00031	OH0054259	RI	S	2
Inspection Date	Entry Time	Exit Time	Notice of Violation	Significant Non-Compliance
7/18/2011	2:30	3:30	Yes	Yes

SECTION B: FACILITY DATA	
Name and Location of Facility Inspected	Permit Effective Date
Suburbans Community MHP 8565 Smith Calhoun Plain City, Ohio 43064	9/1/2006
	Permit Expiration Date
	8/31/2011
Name(s) and Title(s) of On-Site Representatives	Phone Numbers
Richard Cassie	(614) 488-1805
Name and Title of Responsible Official	Phone Number
Cassie Richard, Owner	(614) 488-1805

SECTION C: AREAS EVALUATED DURING INSPECTION		
Key: S = Satisfactory, M = Marginal, U = Unsatisfactory, N = Not Evaluated		
U	NPDES Compliance	The effluent analytical data was not in compliance with the permit limits.
U	Operations & Maintenance	The plant odor and appeared to be septic.
S	Facility Site Review	
N	Collection System	
N	Flow Measurement	
U	Receiving Waters	The effluent was turbid, not clear.
N	Laboratory	

Comments:

Signatures			
	7/21/11		7/22/11
Sheree Gossett-Johnson, Inspector Compliance & Enforcement Division of Surface Water Central District Office	Date	Erin Sherer, Reviewer Compliance & Enforcement Supervisor Division of Surface Water Central District Office	Date

Compliance Data for Suburbans Community MHP between 5/1/2010 to 5/30/2011

Summary

Permit Effluent Limit Violations: 75
 Permit Effluent Code Violations: 0
 Permit Effluent Frequency Violations: 0
 Compliance Schedule Violations: 0

Limit Violations						
Reporting Period	Station	Parameter	Limit Type	Limit	Reported Value	Violation Date
July 2010	001	Nitrogen, Ammonia (NH3	30D Conc	3.27	5.55	7/1/2010
July 2010	001	Nitrogen, Ammonia (NH3	30D Qty	0.55	9243	7/1/2010
July 2010	001	Nitrogen, Ammonia (NH3	7D Conc	4.90	6.3	7/15/2010
July 2010	001	Nitrogen, Ammonia (NH3	7D Qty	0.82	1.0492	7/15/2010
August 2010	001	Nitrogen, Ammonia (NH3	30D Conc	3.27	12.5	8/1/2010
August 2010	001	Nitrogen, Ammonia (NH3	7D Conc	4.90	14.	8/1/2010
August 2010	001	Nitrogen, Ammonia (NH3	30D Qty	0.55	2.08175	8/1/2010
August 2010	001	Nitrogen, Ammonia (NH3	7D Qty	0.82	2.33156	8/1/2010
August 2010	001	Total Suspended Solids	7D Qty	3.0	3.16426	8/8/2010
August 2010	001	Total Suspended Solids	7D Conc	18	19.	8/8/2010
August 2010	001	Nitrogen, Ammonia (NH3	7D Conc	4.90	11.	8/15/2010
August 2010	001	Nitrogen, Ammonia (NH3	7D Qty	0.82	1.83194	8/15/2010
September 2010	001	Nitrogen, Ammonia (NH3	30D Conc	3.27	13.45	9/1/2010
September 2010	001	Nitrogen, Ammonia (NH3	7D Conc	4.90	17.2	9/1/2010
September 2010	001	Nitrogen, Ammonia (NH3	30D Qty	0.55	2.23996	9/1/2010
September 2010	001	Nitrogen, Ammonia (NH3	7D Qty	0.82	2.86449	9/1/2010
September 2010	001	Nitrogen, Ammonia (NH3	7D Conc	4.90	9.7	9/15/2010
September 2010	001	Nitrogen, Ammonia (NH3	7D Qty	0.82	1.61544	9/15/2010
October 2010	001	Nitrogen, Ammonia (NH3	30D Conc	3.27	6.2	10/1/2010
October 2010	001	Nitrogen, Ammonia (NH3	7D Conc	4.90	9.	10/1/2010

October 2010	001	Nitrogen, Ammonia (NH3	30D Qty	0.55	1.03255	10/1/2010
October 2010	001	Nitrogen, Ammonia (NH3	7D Qty	0.82	1.49886	10/1/2010
January 2011	001	Total Suspended Solids	30D Conc	12	33.75	1/1/2011
January 2011	001	Total Suspended Solids	30D Qty	2.0	5.62073	1/1/2011
January 2011	001	CBOD 5 day	30D Conc	10	12.3	1/1/2011
January 2011	001	CBOD 5 day	30D Qty	1.7	2.04844	1/1/2011
January 2011	001	CBOD 5 day	7D Conc	15	22.2	1/8/2011
January 2011	001	CBOD 5 day	7D Qty	2.5	3.69719	1/8/2011
January 2011	001	Total Suspended Solids	7D Conc	18	120.	1/22/2011
January 2011	001	Total Suspended Solids	7D Qty	3.0	19.9848	1/22/2011
March 2011	001	Total Suspended Solids	30D Conc	12	21.	3/1/2011
March 2011	001	Total Suspended Solids	30D Qty	2.0	3.49734	3/1/2011
March 2011	001	CBOD 5 day	30D Conc	10	24.825	3/1/2011
March 2011	001	CBOD 5 day	7D Conc	15	25.5	3/1/2011
March 2011	001	CBOD 5 day	30D Qty	1.7	4.13436	3/1/2011
March 2011	001	CBOD 5 day	7D Qty	2.5	4.24677	3/1/2011
March 2011	001	Total Suspended Solids	7D Conc	18	28.	3/8/2011
March 2011	001	Total Suspended Solids	7D Qty	3.0	4.66312	3/8/2011
March 2011	001	CBOD 5 day	7D Conc	15	18.3	3/8/2011
March 2011	001	CBOD 5 day	7D Qty	2.5	3.04768	3/8/2011
March 2011	001	Total Suspended Solids	7D Conc	18	21.	3/15/2011
March 2011	001	Total Suspended Solids	7D Qty	3.0	3.49734	3/15/2011
March 2011	001	Nitrogen, Ammonia (NH3	7D Conc	10.20	11.	3/15/2011
March 2011	001	Nitrogen, Ammonia (NH3	7D Qty	1.7	1.83194	3/15/2011
March 2011	001	Total Suspended Solids	7D Conc	18	22.	3/22/2011
March 2011	001	Total Suspended Solids	7D Qty	3.0	3.66388	3/22/2011
March 2011	001	CBOD 5 day	7D Conc	15	42.2	3/22/2011
March 2011	001	CBOD 5 day	7D Qty	2.5	7.02799	3/22/2011
April 2011	001	Total Suspended Solids	30D Conc	12	19.75	4/1/2011
April 2011	001	Total Suspended Solids	7D Conc	18	24.	4/1/2011
April 2011	001	Total Suspended Solids	30D Qty	2.0	3.28917	4/1/2011

April 2011	001	Total Suspended Solids	7D Qty	3.0	3.99696	4/1/2011
April 2011	001	Nitrogen, Ammonia (NH3	30D Conc	6.80	7.25	4/1/2011
April 2011	001	Nitrogen, Ammonia (NH3	30D Qty	1.1	1.20742	4/1/2011
April 2011	001	CBOD 5 day	30D Conc	10	26.2	4/1/2011
April 2011	001	CBOD 5 day	7D Conc	15	43.9	4/1/2011
April 2011	001	CBOD 5 day	30D Qty	1.7	4.36335	4/1/2011
April 2011	001	CBOD 5 day	7D Qty	2.5	7.31111	4/1/2011
April 2011	001	Total Suspended Solids	7D Conc	18	22	4/8/2011
April 2011	001	Total Suspended Solids	7D Qty	3.0	3.66388	4/8/2011
April 2011	001	CBOD 5 day	7D Conc	15	21.6	4/8/2011
April 2011	001	CBOD 5 day	7D Qty	2.5	3.59726	4/8/2011
April 2011	001	Total Suspended Solids	7D Conc	18	20	4/22/2011
April 2011	001	Total Suspended Solids	7D Qty	3.0	3.3308	4/22/2011
April 2011	001	CBOD 5 day	7D Conc	15	29.1	4/22/2011
April 2011	001	CBOD 5 day	7D Qty	2.5	4.84631	4/22/2011
May 2011	001	Nitrogen, Ammonia (NH3	30D Conc	3.27	6.85	5/1/2011
May 2011	001	Nitrogen, Ammonia (NH3	30D Qty	0.55	1.1408	5/1/2011
May 2011	001	CBOD 5 day	30D Conc	10	10.025	5/1/2011
May 2011	001	Nitrogen, Ammonia (NH3	7D Conc	4.90	7.1	5/8/2011
May 2011	001	Nitrogen, Ammonia (NH3	7D Qty	0.82	1.18243	5/8/2011
May 2011	001	CBOD 5 day	7D Conc	15	21.8	5/8/2011
May 2011	001	CBOD 5 day	7D Qty	2.5	3.63057	5/8/2011
May 2011	001	Nitrogen, Ammonia (NH3	7D Conc	4.90	6.6	5/22/2011
May 2011	001	Nitrogen, Ammonia (NH3	7D Qty	0.82	1.09916	5/22/2011