



\*4GC0340020110811\*

2011/08/11

4GC03400

NEW BLOOM CARROLL MIDDLE SCHOOL



Environmental  
Protection Agency

John R. Kasich, Governor  
Mary Taylor, Lt. Governor  
Scott J. Nally, Director

August 11, 2011

Roger Mace  
New Bloom Carroll Middle School  
5240 Plum Road Northwest  
Carroll, OH 43112

**Re: Construction Storm Water Inspection at Bloom Carroll Middle School  
Fairfield County  
Permit Number: 4GC03400 \*AG**

Dear Mr. Mace:

This letter is written regarding a storm water inspection conducted by Greg Mann and Daelann Farnlacher of the Ohio EPA at New Bloom Carroll Middle School located at 69 South Beaver Street in Carroll Ohio on August 2, 2011. The purpose of the inspection was to evaluate compliance with the General Storm Water Permit associated with construction activities. During the inspection, our staff noted the following issues associated with construction activities at this site:

**Sediment and Erosion Control:**

- During the inspection our staff noted geothermal well drilling activity on the site. Our staff was informed that the drilling fluid was being reused and not discharged off site. This is an acceptable method of handling drilling fluid, however, please be advised that any release of drilling fluids is not authorized by this permit (See Figure 1).
- It was noted that a centralized sediment basin was installed on the site. The basin seemed to be functioning as intended with appropriate outlet structure installed. Please continue to maintain the basin to keep it functioning as intended (See Figure 2).
- All other storm water controls were in place and functioning as intended.

If you have any questions regarding this letter or the inspection, please do not hesitate to contact me at our Central District Office at 614-728-3844 or email at [harry.kallipolitis@epa.state.oh.us](mailto:harry.kallipolitis@epa.state.oh.us).

Sincerely,

Harry Kallipolitis  
Storm Water Coordinator  
Division of Surface Water  
Central District Office

c: Jeff Bohne, Water Quality Supervisor, DSW / CDO

HK/nsm New Bloom Middle School 8-2-2011

Central District Office  
50 West Town Street, Suite 700  
P.O. Box 1049  
Columbus, OH 43216-1049

614 | 728 3778  
614 | 728 3898 (fax)  
[www.epa.ohio.gov](http://www.epa.ohio.gov)






Figure 1

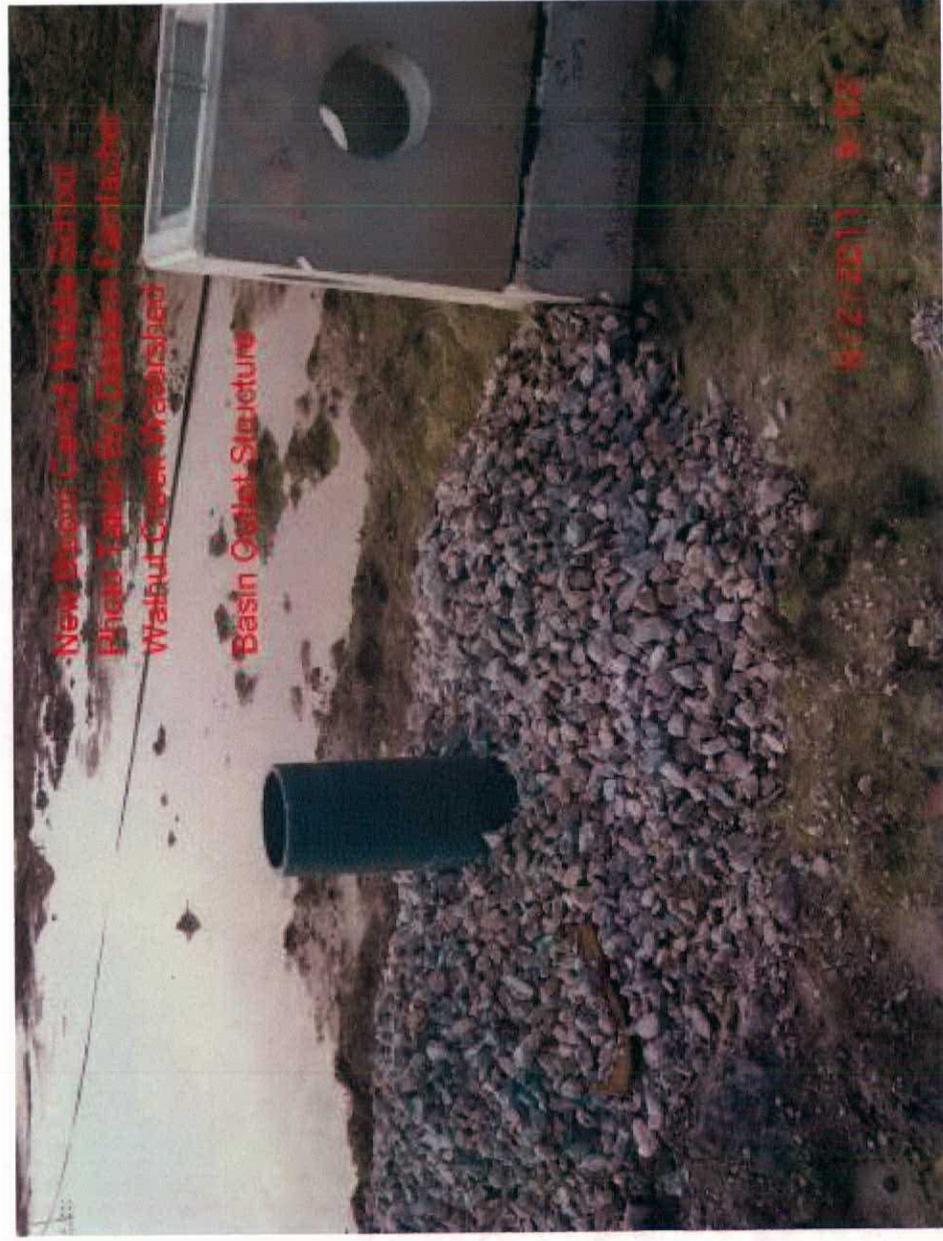


Figure 2






Figure 1

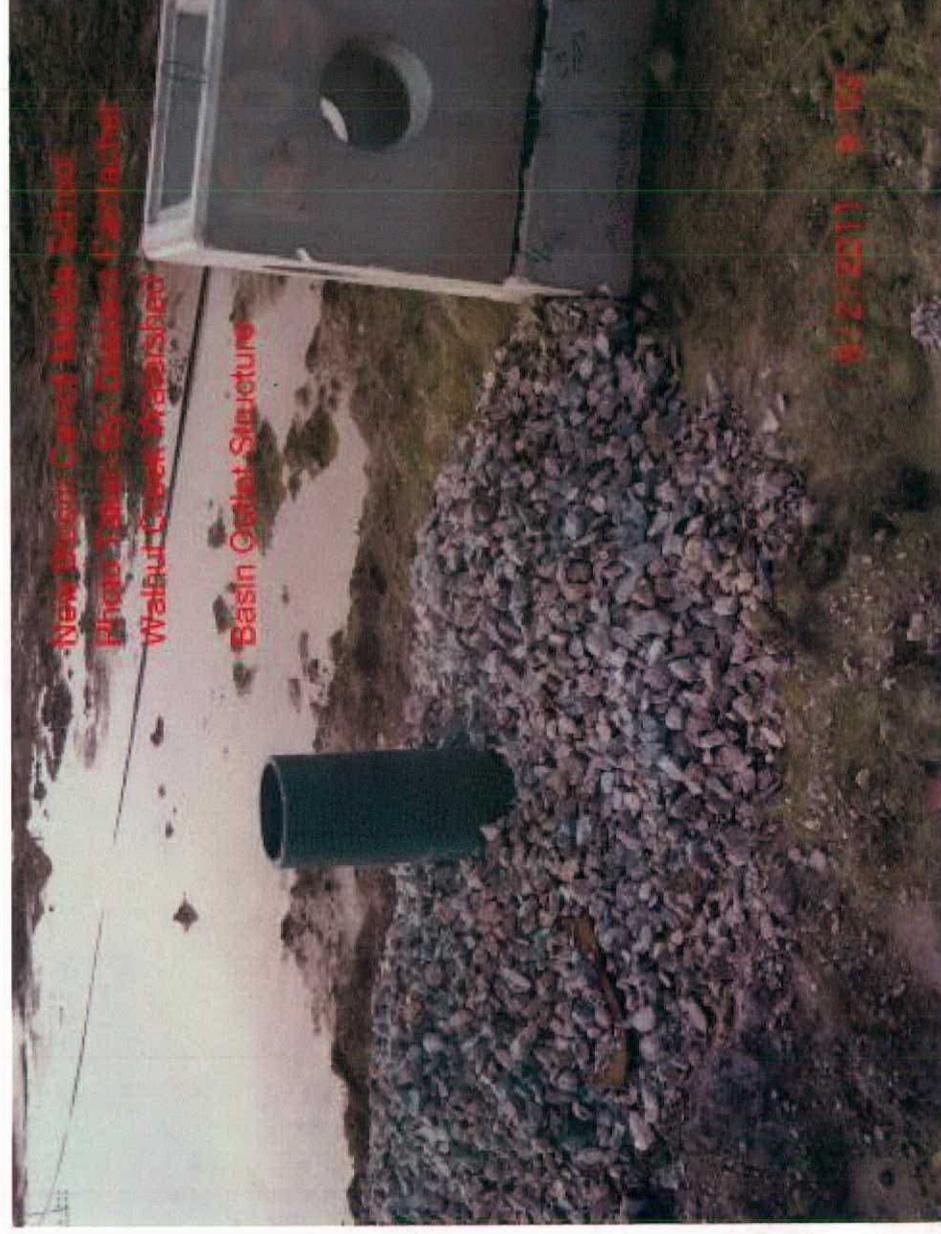


Figure 2

