



4GC0340820110711

2011/07/11

4GC03408

NEWARK HIGH SCHOOL



Environmental
Protection Agency

John R. Kasich, Governor
Mary Taylor, Lt. Governor
Scott J. Nally, Director

July 11, 2011

Dave Altepeter
85 East Main Street
Newark, OH 43055

**Re: Construction Storm Water Inspection at Newark High School / Licking County
Permit Number: 4GC03408*AG**

Dear Mr. Altepeter:

This letter is written regarding a storm water inspection conducted by Greg Mann and Daelann Farnlacher of the Ohio EPA at Newark High School located at 85 East Main Street in Newark Ohio on June 24, 2011. The purpose of the inspection was to evaluate compliance with the General Storm Water Permit Associated with Construction Activities. During the inspection, our staff noted the following issues associated with construction activities at this site:


Sediment and Erosion Control:

- Our staff noted sediment build up around storm sewer inlets which must be maintained. In addition there were inlets not properly protected to minimize sediment laden discharges. Please ensure all inlet protections are properly maintained and functioning as intended (see Figure 1 and 2).
- Please be aware the General Permit states that a sediment pond is required for all disturbed areas within a common drainage area exceeding ten (10) acres. Based on the preliminary site assessment, it appears that a centralized sediment basin will be required for this site. Please indicate in your response letter if the ten (10) acre condition of the permit has been exceeded and consequently include the construction schedule addressing the installation of a sediment pond for this site. All sediment impoundments must be sized with a sediment storage volume of sixty-seven (67) cubic yards per acre of drainage for the dewatering zone and thirty seven (37) cubic yards per acre of disturbance for the sediment settling zone. Please refer to the following link for assistance: <http://www.dnr.state.oh.us/water/rainwater/default/tabid/9186/default.aspx>.

Dave Altepeter
Page -2-

If you have any questions regarding this letter or the inspection, please do not hesitate to call me at our Central District Office at (614) 728-3844 or email at harry.kallipolitis@epa.state.oh.us. In addition, please provide a written response (**email preferred**) to the action items addressed above within ten days from receipt of this letter. A follow up inspection will be conducted to ensure the minimum conditions of the General Permit have been met.

Sincerely,



Harry Kallipolitis
Storm Water Coordinator
Division of Surface Water
Central District Office

Enclosure

c: Jeff Bohne, Water Quality Supervisor, DSW/CDO

HK/nsm Newark High School 6-24-11

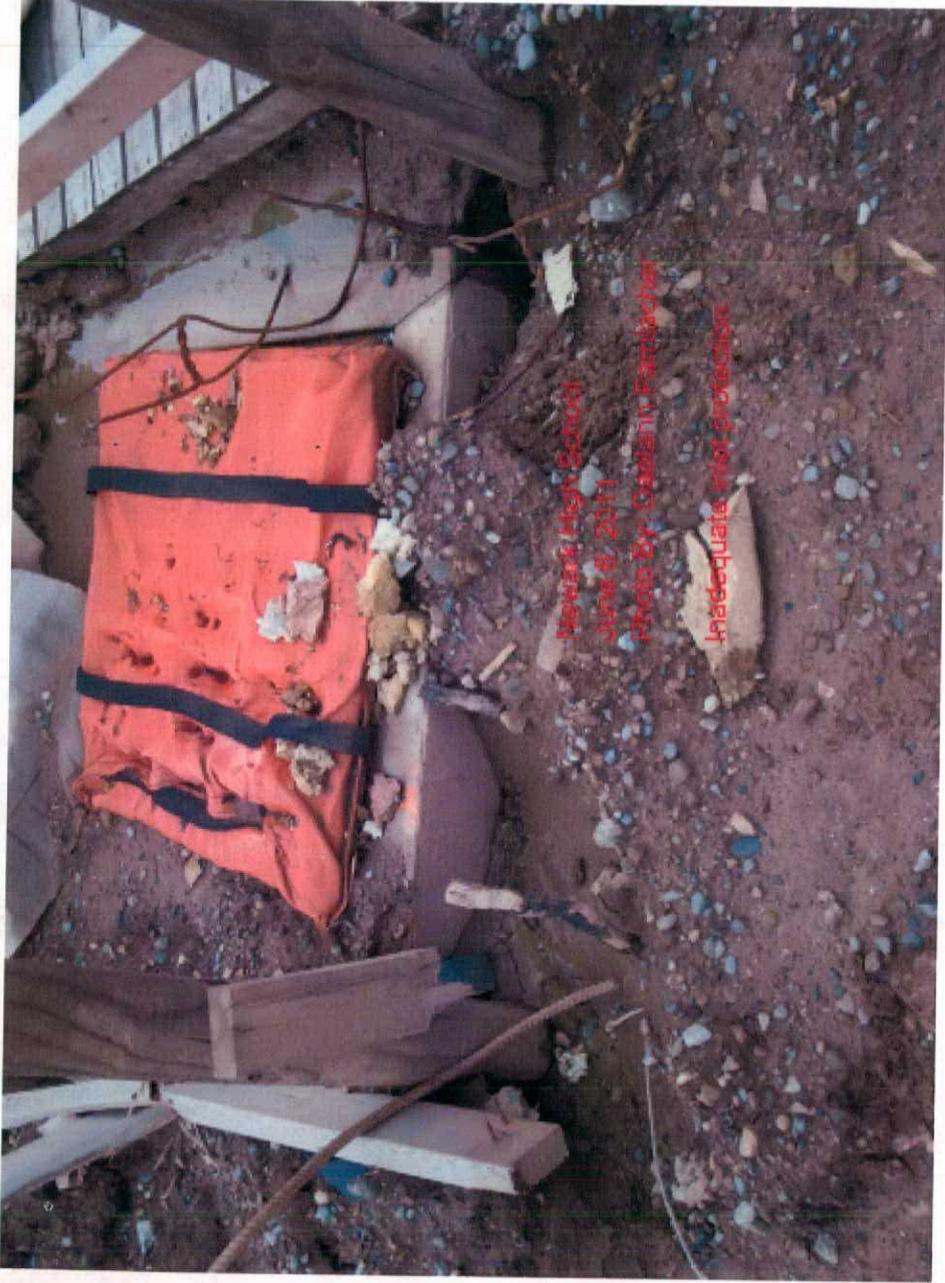


Figure 2

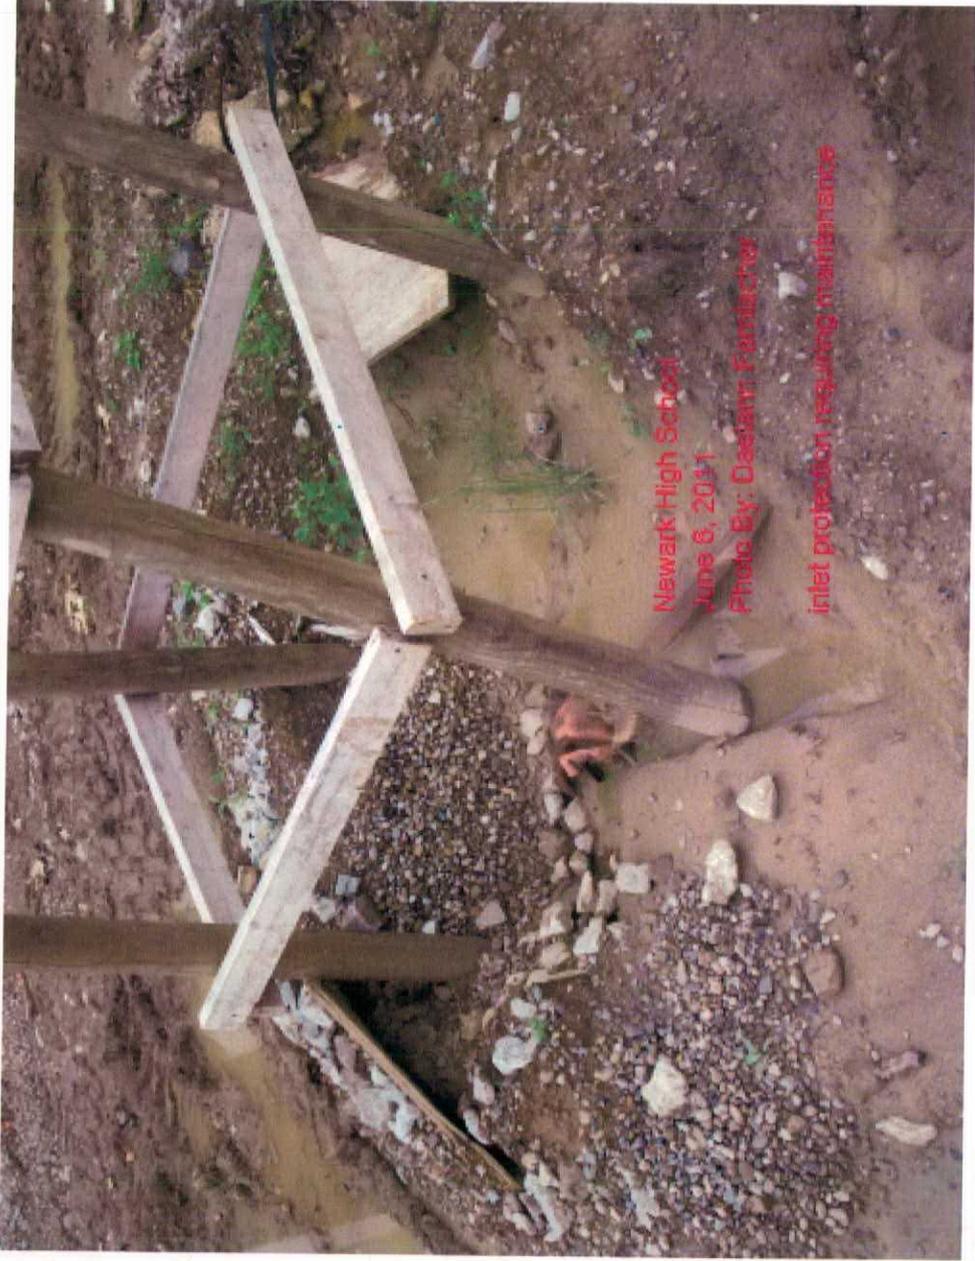


Figure 1

