

**Environmental
Protection Agency**

Ted Strickland, Governor
Lee Fisher, Lt. Governor
David L. Lusk, Director

June 30, 2010

RE: STARK COUNTY
EAST BRANCH CREEK BASIN
CITY OF LOUISVILLE
LOUISVILLE HIGH SCHOOL
ADDITIONS AND RENOVATIONS

Mr. David Redd
504 East Main Street
Louisville, OH 44641

Dear Mr. Redd:

On June 9, 2010, Ohio EPA conducted an inspection of the Additions and Renovations to Louisville High School project located at 1201 South Nickelplate Street, City of Louisville, Nimishillen Township, Stark County (site). Ohio EPA records indicate that the site is covered by the General National Pollutant Discharge Elimination System (NPDES) Permit for Storm Water Associated with Construction Activity (General Storm Water Permit), permit No. 3GC04824*AG. I was accompanied by Chris Moody of Ohio EPA. The inspection documented the following:

- No inlet protection has been installed on-site. Install inlet protection in accordance with the site's storm water pollution prevention plan (SWP3).
- No sediment basin has been installed on-site. Mr. Terry Friedl of C.T. Taylor Construction stated that the sediment basin was being excavated on an as-needed basis due to the fact that the cut material is used as fill for a building pad. Install the sediment basin immediately in accordance with the site's SWP3.
- Silt fence has been improperly installed around one topsoil stock pile. Remove and reinstall silt fence in accordance with the site's SWP3. A second topsoil stock pile was observed not to have any erosion or sediment controls. Silt fence must be installed around the topsoil pile as shown in the site's SWP3. Mr. Friedl stated that that the topsoil pile in question would be removed by the week ending 06/12/2010.
- No copies of BMP inspection reports were on-site. Please fax a copy of your most recent inspection report to my attention at (330) 487-0769. Retain future copies of site inspection reports on-site at all times.

Mr. David Redd
Louisville High School Additions and Renovations
June 30, 2010
Page 2

A written report detailing how the above deficiencies will be addressed must be submitted to Ohio EPA within seven days of receiving this letter. The above deficiencies must be addressed within 14 days of receiving this letter. Should you have any questions regarding this matter, please contact me at your earliest convenience at (330) 963-1128.

Sincerely,

A handwritten signature in black ink, appearing to read 'Sean Green', with a stylized flourish at the end.

Sean Green
Assistant to the District Engineer
Division of Surface Water

SG/mt

cc: Julie Berbari, Stark County SWCD
Anthony Ignazio, Scaparotti Construction Group
Terry Friedl, C.T. Taylor Construction



Figure 1. Sediment laden water was observed flowing into existing storm sewer inlets.



Figure 2. No inlet protection has been installed on-site.



Figure 3. No sediment basin has been installed on-site.



Figure 4. Sediment laden water is flowing across the planned sediment basin and into existing storm sewers.

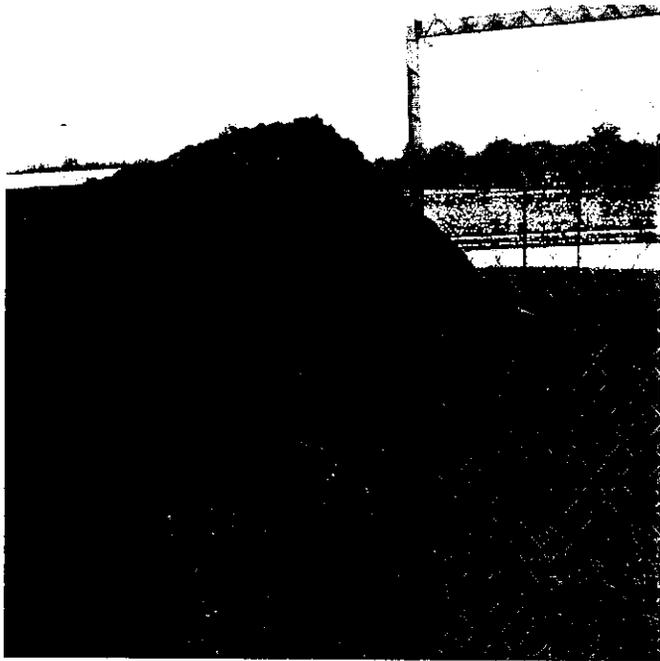


Figure 5. A small topsoil pile was observed to not have any erosion controls.