



**Environmental
Protection Agency**

John R. Kasich, Governor
Mary Taylor, Lt. Governor
Scott J. Nally, Director

July 8, 2011

RE: SUMMIT COUNTY
CITY OF HUDSON
ATTERBURY BOULEVARD
CONSTRUCTION STORM WATER

Thomas Sheridan
City of Hudson
51 South Main Street
Hudson, OH 44236

and

Jeffrey Busch
Fabrizi Trucking and Paving Company Inc.
389 Columbia Road
Valley City, OH 44280

Dear Mr. Sheridan and Mr. Busch:

On June 22, 2011, I performed an inspection at the above-referenced site to determine compliance with the Ohio EPA General Storm Water National Pollutant Discharge Elimination System (NPDES) Permit for Construction Activities #3GC04827*AG. Our records indicate that the City of Hudson was granted coverage under the NPDES permit on March 4, 2010. Our records further indicate that Fabrizio Trucking and Paving Company Inc. submitted a Co-Permittee Notice of Intent on June 22, 2010.

During my inspection, I documented the following deficiencies:

1. Storm drain inlet protection has not been provided as required by the NPDES permit (Figures 1 and 2). Please see the *Rainwater and Land Development Manual* (Ohio Department of Natural Resources, 2006), available on-line at <http://www.dnr.state.oh.us/tabid/9186/default.aspx>, for the specifications for an appropriate form of inlet protection.
2. I was unable to locate a designated concrete washout area. According to the NPDES permit, water used to wash out concrete trucks is considered waste water and must be kept onsite in a designated containment area. Please install a concrete washout before conducting work with concrete.

Please provide me with a letter of response indicating the actions you will take to address the deficiencies noted above. Your response, along with a copy of the Storm Water Pollution Prevention Plan (SWP3), must be submitted to the Ohio EPA **no later than July 21, 2011**. If corrective actions are not completed by this date, please include a schedule that outlines when action will be taken. It is Ohio EPA's expectation that all of these deficiencies will be addressed within 10 days of receipt of this letter.

THOMAS SHERIDAN
JEFFREY BUSCH
JULY 8, 2011
PAGE 2

Finally, please fax a copy of your most recent storm water inspection report to my attention at (330) 487-0769 or via e-mail at michelle.hummel@epa.state.oh.us. The NPDES permit requires you to inspect all storm water best management practices once every 7 days and within 24 hours of a 0.5-inch or greater rainfall. The results of these inspections must be documented as indicated in Part III.G.2.i of the NPDES permit.

If you have any questions regarding this matter, please contact me at your earliest convenience at (330) 963-1128.

Sincerely,



Michelle Hummel
Assistant to the District Engineer
Division of Surface Water

MH:bo

pc: Jeff Shiray, MS4 Program Manager, City of Hudson
Ed Ratchford, Construction Inspector, City of Hudson
William Currin, Mayor, City of Hudson
Cindy Fink, Summit SWCD

ec: Phil Rhodes, DSW, NEDO



Figure 1 – No inlet protection is present.

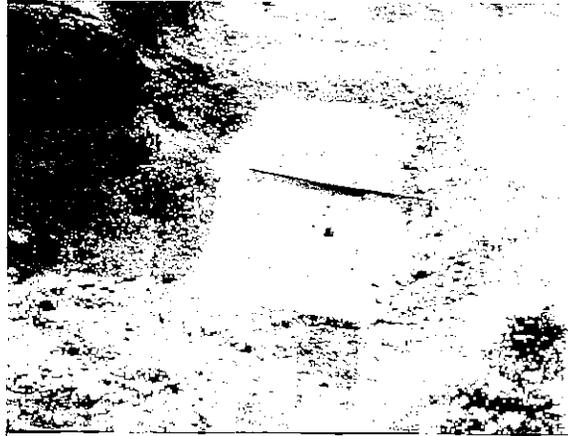


Figure 2 – No inlet protection is present.