

**Environmental  
Protection Agency**

, Governor  
, Lt. Governor  
, Director

July 16, 2010

RE: WAYNE COUNTY  
APPLE CREEK BASIN  
CITY OF WOOSTER  
CAMPUS CENTER RECREATION CENTER

Ms. Laurie L. Stickelmaier  
207 Galpin Hall  
Wooster, Ohio 44691

Dear Ms. Stickelmaier:

On July 13, 2010, Ohio EPA conducted a follow-up inspection of the Campus Center Recreation Center, Phase 1, located at 1267 Beall Avenue, City of Wooster, Killbuck Township, Wayne County (site). Ohio EPA records indicate that the site is covered by the General National Pollutant Discharge Elimination System (NPDES) Permit for Storm Water Associated with Construction Activity (General Storm Water Permit), permit No. 3GC04852\*AG. I was accompanied by Adam Bogner of BCMC Inc. The inspection documented the following:

**Current issues:**

- Installation of the sediment basin has not been completed. Mr. Bogner stated that the timeline for the completion of the sediment basin is the month ending July 2010.
- Offsite tracking continues to be an issue. A significant amount of offsite tracking was observed along Gasche Street to the north of University Street (Figure 1). This is most likely due to construction activities associated with the installation of the sediment basin. Storm sewer inlets were observed at the intersection of Gasche Street and University Street (Figure 2). If offsite tracking in this area continues to be a problem, a revision will need to be made to the site's storm water pollution prevention plan (SWP3) to include these inlets.

**Issues from previous inspection that have been addressed:**

- Topsoil stockpiles, both on-site (Figure 3) and offsite (Figure 4) have silt fence installed around their perimeters and have been temporarily stabilized.
- Inlet protection has been installed on the site's storm sewer inlets. Maintain inlet protection in accordance with the site's SWP3.

Ms. Laurie L. Stickelmaier  
Campus Center Recreation Center  
July 16, 2010  
Page 2

- The construction entrance has been reinstalled and observed to be in working condition. Maintain the construction entrance in accordance with the site's SWP3.
- The concrete washout pit has been properly reinstalled (Figure 5). Maintain the concrete washout pit in accordance with the site's SWP3.
- SWP3 inspections are being conducted weekly or after a rainfall event of 0.5 inches or larger. Records are being kept on-site.

A written report detailing how the above deficiencies will be addressed must be submitted to Ohio EPA within seven days of receiving this letter. The above deficiencies must be addressed within 14 days of receiving this letter. Should you have any questions regarding this matter, please contact me at your earliest convenience at (330) 963-1128.

Sincerely,



Sean Green  
Assistant to the District Engineer  
Division of Surface Water

SG/mt

cc: Adam Bogner, BCMC Inc.



Figure 1. A significant amount of offsite tracking was observed along Gasche St. north of University St.



Figure 2. Storm sewer inlets were observed at the intersection of Gasche St and University St.

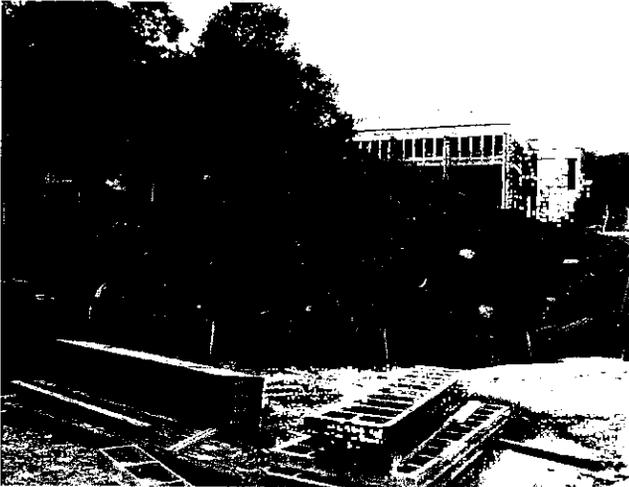


Figure 3. The on-site topsoil stockpile has silt fence installed around it and has been temporarily stabilized.



Figure 4. The offsite topsoil stockpile has silt fence installed around it and has been temporarily stabilized.



Figure 5. The concrete washout pit has been properly reinstalled.