




Environmental
Protection Agency

John R. Kasich, Governor
Mary Taylor, Lt. Governor
Scott J. Nally, Director

OH3501203

FLORIDA, VILLAGE OF

6/22/2011

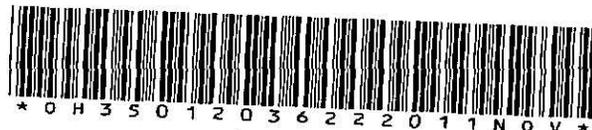

Re: Henry County
Village of Florida
Community Public Water System
PWS ID# OH 3501203
STU ID# 3554991

June 22, 2011

Mr. Bruce Meyer, President
Board of Public Affairs
Village of Florida
206 East High Street
Napoleon, Ohio 43545

Failure to report chlorine residual free/combined daily at the plant tap & distribution system

Dear Mr. Meyer:

Notice of Violation

In violation of OAC 3745-83-01 (F)(2), the public water system failed to report free or combined chlorine residual daily in the distribution system. There were 10 days during the month of May in which the analysis was not performed.

OAC Rule 3745-83-01 (C) (1) requires all community public water systems to maintain a minimum chlorine residual of at least two-tenths mg/l free chlorine or one mg/l combined chlorine measured at representative points throughout the distribution system.

Failure to take action to address this violation may result in enforcement action being taken.


Notice of Deficiency

The public water system failed to report free or combined chlorine residual daily at the plant tap. There were seven (7) days during the month in which the analysis was not performed.

Mr. Bruce Meyer, President
June 22, 2011
Page 2

If you have any questions regarding this letter, or any other matter involving your water system, please feel free to contact me at 419-373-3101 or via e-mail to Chris.Riddle@epa.state.oh.us.

Sincerely,

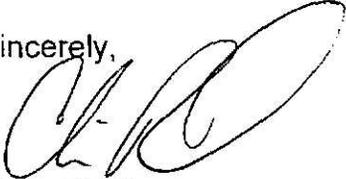

Chris Riddle
Environmental Specialist 2
Division of Drinking and Ground Waters

//lr

pc: Henry County Health Department
~~DDAGW-NWDO File~~