




Environmental
Protection Agency

John R. Kasich, Governor
Mary Taylor, Lt. Governor
Scott J. Nally, Director

OH6900812

OTTOVILLE VILLAGE WATER

6/15/2011

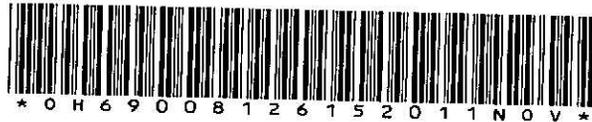

Re: Putnam County
Ottoville Village Water PWS
Community Public Water System
PWS ID# OH6900812
STU ID# 6957584

June 15, 2011

Mr. Steve Wittler
Village of Ottoville
150 Park Drive
P. O. Box 488
Ottoville, Ohio 45876

**Notice of Violation – Monthly Report – Chlorine Residual Distribution
Notice of Deficiency – Monthly Report – Chlorine Residuals – Plant Tap**

Dear Mr. Wittler:

Notice of Violation

The Plant – Distribution Monthly Operation Report (EPA Form 5002) reported free chlorine residual of less than two-tenths milligrams per liter (mg/l) and combined chlorine residual of less than one mg/l in the distribution system May 1, 2, 3, 6, 7, 10, 11, 12, 18, and 30.

OAC Rule 3745-83-01(C)(1) requires all community public water systems to maintain a minimum chlorine residual of at least two-tenths mg/l free chlorine or one mg/l combined chlorine measured at representative points throughout the distribution system.

Failure to take action to address this violation may result in enforcement action being taken.

Notice of Deficiency

The Plant – Distribution Monthly Operation Report (EPA Form 5002) reported free chlorine residual of less than two-tenths milligrams per liter (mg/l) and combined chlorine residual of less than one mg/l on May 11, 16, and 30 at the plant tap. Investigate the cause of this deficiency and take measures to correct it.

Mr. Steve Wittler
June 15, 2011
Page Two

If you have any questions regarding this letter, or any other matter involving your water system, please feel free to contact me at 419-373-3101 or via e-mail to chris.riddle@epa.state.oh.us.

Sincerely,



Chris Riddle
Environmental Specialist 2
Division of Drinking and Ground Waters

/cs

pc: Putnam County Health Department
NWDO-BDAGW:File