



State of Ohio Environmental Protection Agency

Northwest District Office

347 North Dunbridge Rd.
Bowling Green, OH 43402-9398

TELE: (419) 352-8461 FAX: (419) 352-8468
www.epa.ohio.gov

Ted Strickland, Governor
Lee Fisher, Lieutenant Governor
Chris Korleski, Director

Re: Richland County
Crestwood Hills C&R Association
Community Water System
PWS ID #7000812


June 8, 2010

OH7000812

CRESTWOOD HILLS C AND R ASSOCIATION

6/8/2010

Mr. Dean Blamer
Crestwood Hills C&R Association
1984 Hout Road
Mansfield, Ohio 44905

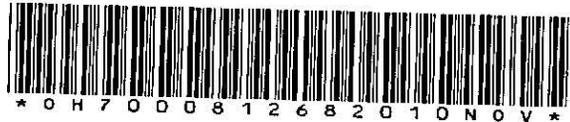

Dear Mr. Blamer:

The April 2010, Drinking Water Operation Report (EPA 5002) received for your public water system does not meet the requirements as set forth in OAC Rule 3745-83-01.

Ohio Administrative Code, Rule 3745-83-01 requires that each community and major non-community water system maintain a minimum of 0.2 mg/l free chlorine residual or 1.0 mg/l combined chlorine residual measured at representative points throughout the distribution system.

Free and combined chlorine residuals are required to be conducted at the plant tap and in the distribution system daily (seven days per week) according to OAC Rule 3745-83-01. Your operational report shows this is not being done. Please correct this violation on your next monthly operating report.

If you have any questions regarding this letter, please contact me at (419) 373-3105.

Yours truly,

Curtis A. Eldridge
Division of Drinking and Ground Waters

/cs

pc: Richland County Health Department
'DDAGW',NWDO-File_3

