



State of Ohio Environmental Protection Agency

Northwest District Office

347 North Dunbridge Road  
Bowling Green, OH 43402-9398

TELE: (419) 352-8461 FAX: (419) 352-8468  
www.epa.state.oh.us

Ted Strickland, Governor  
Lee Fisher, Lieutenant Governor  
Chris Korleski, Director

Re: Richland County  
Crestwood Hills C&R Assoc.  
Community Water System  
PWS ID# OH7000812

May 29, 2008

OH7000812

CRESTWOOD HILLS C AND R ASSOCIATION

5/29/2008

Mr. Dean Blamer  
Crestwood Hills C&R Association  
1984 Hout Road  
Mansfield, Ohio 44905



Dear Mr. Blamer:

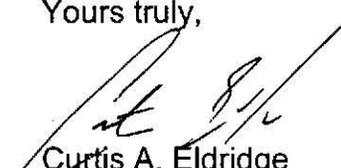
The March and April 2008, Drinking Water Operation Reports (EPA 5002) received for your public water system do not meet the requirements as set forth in Ohio Administrative Code (OAC) Rule 3745-83-01.

OAC Rule 3745-83-01 requires that each community and major non-community water system maintain a minimum of 0.2 mg/l free chlorine residual or 1.0 mg/l combined chlorine residual measured at representative points throughout the distribution system.

Free and combined chlorine residuals are required to be conducted at the plant tap and in the distribution system daily (seven days per week) according to OAC Rule 3745-83-01. Your operational report shows this is not being done. Please correct this violation on your next monthly operating report.

If you have any questions regarding this letter, please contact me at (419) 373-3105.

Yours truly,

  
Curtis A. Eldridge  
Division of Drinking and Ground Waters

/cs

pc: Tony Weirich, McGhee's Technical Services  
Richland County Health Department  
DDAGW, NWDO File \