




Environmental
Protection Agency

John R. Kasich, Governor
Mary Taylor, Lt. Governor
Scott J. Nally, Director

OH7400011

ATTICA VILLAGE

10/19/2011

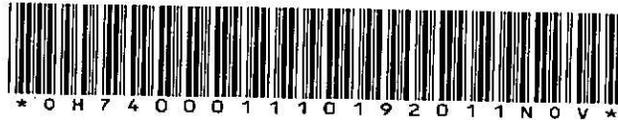

Re: Seneca County
Village of Attica
Community Water System
PWS OH7400011

October 19, 2011

Mr. Greg Martin
Village of Attica
20 South Main Street
P. O. Box 564
Attica, Ohio 44807-9012

Subject: Orthophosphate Monitoring Violation - September 2011

Dear Mr. Martin:

In violation of rules 3745-83-01[(G)(5) & (H)] and 3745-81-87(C)(2)(c), the public water system failed to monitor at least biweekly for orthophosphate during September 2011. Orthophosphate monitoring was completed on September 7, 2011, for one of the two requisite samples.

In violation of rules 3745-83-01(H) & 3745-81-87(C)(1), the public water system failed to monitor orthophosphate, total alkalinity, and pH at least two (2) samples from two (2) distribution system taps during each 6-month period since March 12, 2009.

Failure to monitor for orthophosphate is a monitoring violation that requires a tier 3 public notification in accordance with rule 3745-81-32(D)(1)(a). The public water system must provide notice as soon as practical, but no later than one year after the public water system learns of the violation. The following forms of delivery must be used in order to reach all persons served.

Mail or other direct delivery to each customer receiving a bill and to other service connections to which water is delivered by the public water system; and, any other method reasonably calculated to reach other persons regularly served by the public water system. The consumer confidence report (CCR) may be used as a vehicle for the notice if the CCR is provided to persons served within one year after the public water system learns of the violation.

Mr. Greg Martin
October 19, 2011
Page 2

If the public water system fails to correct its violations, then the director may enforce the safe drinking water regulations to attain compliance. An enforcement action may include civil penalties of not more than \$25,000 per day per violation in accordance with RC §§6109.33, or administrative penalties in accordance with rule 3745-81-04.

If you have any questions regarding this letter, or any other matter involving your water system, you may contact me at (419) 373-3048, or by email [Ralph.Baker@epa.state.oh.us].

Sincerely,




Ralph J. Baker
Engineer
Division of Drinking and Ground Waters

/llr

pc: DDAGW, NWDO →
Gary Weis, Village of Attica

ec: Ralph Baker, DDAGW, NWDO



Division of Drinking and Ground Waters
Water Plant/Distribution System
Monthly Operating Report (MOR)

PWS ID / Name:	OH7400011 / ATTICA VILLAGE
Plant ID / Name:	7462192 / ATTICA VILLAGE
Reporting Lab Certification Number:	746
Reporting Month / Year:	9 / 2011
Submission Date:	10/8/11

Routine Schedule	Start Date	End Date
4 samples per MN between 1/1 and 12/31	10/01/10	

Date	Copper (mg/L)	Chlorine Dioxide (mg/L)	Exceed	Chlorite (mg/L)	Exceed	Chlorine Residual (Free) (mg/L)	Chlorine Residual (Combined) (mg/L)	Distribution											
								Lowest		Chlorite / Chlorine Dioxide (mg/L)				Residence Time In Distribution					
								Chlorine Residual (Free) (mg/L)	Chlorine Residual (Combined) (mg/L)	Chemical		Type		FIRST CUSTOMER (FC)					
										Chlorite	Chlorine Dioxide	Routine	Followup	-0-hrs	+ 6 hrs	+ 12 hrs	Avg (AT)	Max (AT)	
09/01/2011						2.1	0.1	2.1	0.2										
09/02/2011						2	0.3	0.8	0.3										
09/03/2011						2.1	0.1	2.1	0.1										
09/04/2011						2.1	0.2	0.6	0.1										
09/05/2011						2.3	0.2	1	0.3										
09/06/2011						2.1	0.2	0.3	0.1										
09/07/2011						2.3	0.2	2.7	0.1										
09/08/2011						2.3	0.3	1.9	0.2										
09/09/2011						2.4	0.2	1.6	0.4										
09/10/2011						2.2	0.1	1.6	0.1										
09/11/2011						2.1	0.2	0.8	0.2										
09/12/2011						2.1	0.2	1.4	0.1										
09/13/2011						2.1	0.2	0.9	0.3										
09/14/2011						2.1	0.2	0.6	0.2										
09/15/2011						2.2	0.2	1.6	0.1										
09/16/2011						2.2	0.2	0.6	0.2										
09/17/2011						2	0.2	0.6	0.1										
09/18/2011						2.2	0.2	0.8	0.2										
09/19/2011						1.7	0.2	1.4	0.1										
09/20/2011						1.8	0.3	1.3	0.3										
09/21/2011						1.6	0.2	1.2	0.3										
09/22/2011						1.5	0.2	0.4	0.2										
09/23/2011						1.5	0.3	0.4	0.2										
09/24/2011						1.5	0.3	1	0.2										
09/25/2011						1.3	0.2	0.6	0.1										
09/26/2011						1.4	0.1	0.4	0.1										
09/27/2011						1.4	0.2	0.3	0.3										
09/28/2011						1.6	0.3	0.5	0.2										
09/29/2011						0.9	0.3	0.6	0.2										
09/30/2011						1.6	0.2	0.4	0.2										
Min.						0.9	0.1	0.3	0.1										
Max.						2.4	0.3	2.7	0.4										
Avg.						1.89	0.21	1.0167	0.19										

Form Submitted by: gary weis

From: Baker, Ralph
Sent: Monday, October 17, 2011 3:18 PM
To: Gary Weis (voawater@bright.net)
Subject: Plan Approval Corrosion Recommendation

Has the distribution system monitoring been completed in accordance with the plan approval (3/12/2009) and rule 3745-81-87(C)(1)? Orthophosphate, total alkalinity, and pH monitoring must be at least 2 samples from 2 taps (not consecutive days) during each 6-month monitoring period. If so, email the data.



Baker, Ralph

From: voawater@bright.net
Sent: Tuesday, October 18, 2011 9:35 AM
To: Baker, Ralph
Subject: Re: Plan Approval Corrosion Recommendation

Ralph

I thought this stopped with passing lead and copper. Will start sampling right away.

Gary super