




**Environmental
Protection Agency**

John R. Kasich, Governor
Mary Taylor, Lt. Governor
Scott J. Nally, Director

OH8748112

STICKEL AMLC NO.2

7/26/2011



Re: Wood County
TNC - AMLC
Stickel 2 AMLC
PWS ID# OH8748112
STU ID# 8759999

July 26, 2011

Mr. Dale Stickel
8555 Devils Hole Road
Bowling Green, Ohio 43402

Dear Mr. Stickel:

Subject: Notice of Violation for Failure to Respond to a Significant Deficiency

This letter is notification that the Stickel 2 AMLC has not complied with requirements issued during this Agency's last survey performed on June 16, 2011, in violation of rule 3745-81-60 of the Ohio Administrative Code. **The PWS was notified in correspondence dated June 22, 2011, to respond in writing no later than 30 days, with time frames for:**

1. OAC Rule 3745-9-05(P) states "A well shall have a well cap or seal to prevent the entrance of water, dirt, animals, insects, or other foreign matter. The top of the casing at its finished height shall be cut so that the surface will fit flush with the well cap and provide a tight seal. The well cap or seal shall fit securely to the top of the well casing, be secured with screws or other appropriate connections, and vent to the atmosphere...Electrical conduit connections on the well cap or seal shall be threaded and sealed to prevent the entrance of insects and water." The well does not have the appropriate conduit seal on the cap. Install a cap that includes a conduit connection that meets OAC Rule 3745-0-05(P).
2. OAC Rule 3745-9-05(T) states "A vent shall be provided on all well caps and seals...A well vent shall be self-draining, screened with a non-corroding mesh screen of fifteen to thirty mesh, pointed downward at or above the top of the casing or pitless unit. A vent shall terminate not less than twelve inches above ground surface." The well does not have an appropriate vent on the cap. Install a cap with a vent that meets the specifications identified in OAC 3745-9-05(T).
3. OAC Rule 3745-9-05(O)(2) states, "The finished grade shall be sloped for surface water runoff away from the well." The finished grade must be sloped away from the well.


Mr. Dale Stickel
July 26, 2011
Page Two

4. Public notice has not been posted for the failure to monitor for Nitrate during 2007 and 2008. The public notice form and validation form have been enclosed. Post the public notice and complete and return the verification form.

The water system must respond in writing within 15 days from the date of this letter with the required information. Failure to comply may result in further enforcement action.

If you have any questions regarding this letter, or any other matter involving your water system, contact me at 419-373-3101.

Sincerely,

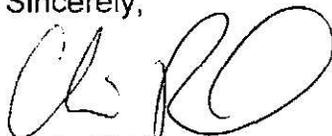

Chris Riddle
Environmental Specialist 2
Division of Drinking and Ground Waters

/cs

Enclosures

pc: Gene Phillips, Ohio Department of Health
OEPA Central Office, DDAGW
◀DDAGW, NWDO File▶

ec: NWDO Follow-up File