



State of Ohio Environmental Protection Agency

Northeast District Office

2110 East Aurora Rd.
Twinsburg, Ohio 44087

TELE: (330) 963-1200 FAX: (330) 487-0769
www.epa.state.oh.us

Ted Strickland, Governor
Lee Fisher, Lieutenant Governor
Chris Korleski, Director

November 3, 2008

RE: ROBIN INDUSTRIES
ELASTO-TEC DIVISION
HOLMES COUNTY
3PR00211

Mr. Richard Jurjevic
Senior Engineer
P.O. Box 287
3500 State Route 39
Berlin, Ohio 44610

Dear Mr. Jurjevic:

On October 24, 2008, this writer conducted a compliance evaluation inspection of your facility. You accompanied me during the visit. Below you will find a summary of the inspection.

The sanitary sewage treatment system was also inspected. At the time the inspection the following was noted:

- 1) The contents of the aeration tank exhibited a dark brown color. This sometimes is an indicator of old sludge in the system, which may need to be wasted.
- 2) A 2 to 3 inch layer of floating solids completely covered the clarifier. The skimmer was not removing these solids. A heavy build up of solids has accumulated behind the clarifier influent baffle. The solids were overflowing onto the surface of the clarifier. The v notched effluent weir was almost completely plugged with solids. A heavy accumulation of solids was present in the effluent trough.
- 3) Maintenance records for the sewage treatment plant could not be found. Please be advised that Ohio Administrative Code 3745-7-09 requires that these records be kept by your company. A copy of this code is attached for your reference.

A review of your compliance history for the time period of July 2007 through September 2008 indicates the following violations:

Numeric Violations

Station	Parameter	Limit Type	Limit	Reported Value	Violation Date
001	Total Suspended Solids	30D Qty	0.0682	.10765	7/1/2008
001	Total Suspended Solids	1D Qty	0.103	.10765	7/3/2008
002	Residue, Total Dissolv	1D Qty	13.6	2902898	7/3/2008

Station	Parameter	Limit Type	Limit	Reported Value	Violation Date
001	Nitrogen, Ammonia (NH3)	30D Conc	1.0	1.65	8/1/2008
001	Nitrogen, Ammonia (NH3)	30D Qty	0.0056	.01268	8/1/2008
002	Residue, Total Dissolv	1D Qty	13.6	6756520	8/21/2008
001	Nitrogen, Ammonia (NH3)	1D Conc	1.5	1.65	8/28/2008
001	Nitrogen, Ammonia (NH3)	1D Qty	0.0085	.01268	8/28/2008
002	Residue, Total Dissolv	1D Qty	13.6	8070482	9/26/2008

Frequency Violations

Station	Parameter	Sample Frequency	Expected	Reported	Violation Date
001	Residue, Total Dissolv	1/Month	1	0	08/01/2008
002	Flow Rate	1/2Weeks	1	0	07/15/2008
002	Chlorine, Total Residu	1/2Weeks	1	0	07/15/2008
002	pH	1/2Weeks	1	0	07/15/2008
002	Flow Rate	1/2Weeks	1	0	08/01/2008
002	Chlorine, Total Residu	1/2Weeks	1	0	08/01/2008

If you should have any questions, feel free to contact this writer at (330) 963-1136.

Sincerely,




Philip P. Rhodes, P. E.
Environmental Engineer
Division of Surface Water

PPR/mt

Attachments

File: Industrial/Permit Compliance

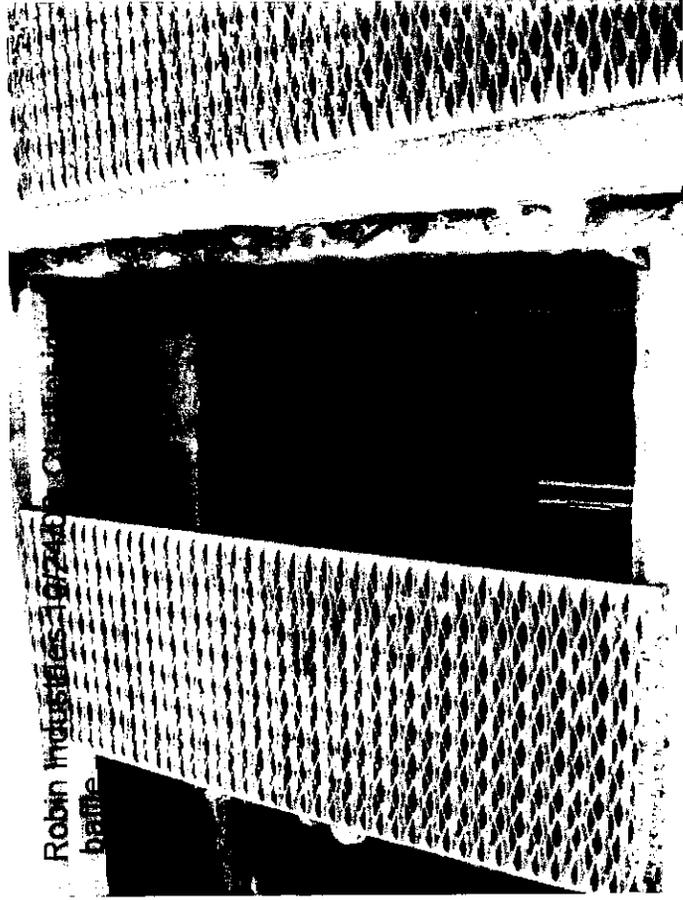

Robin Industries 107240
baffle



Robin Industries 107240 Chamber