



State of Ohio Environmental Protection Agency

Northeast District Office

2110 East Aurora Rd.
Twinsburg, Ohio 44087

TELE: (330) 963-1200 FAX: (330) 487-0769
www.epa.state.oh.us

Ted Strickland, Governor
Lee Fisher, Lieutenant Governor
Chris Korleski, Director

July 12, 2007

RE: HOLMES COUNTY
WASHINGTON TOWNSHIP
IRON PONY SALOON
14641 S.R. 3
NPDES 3PR00158

Mr. Chris Tyler
Iron Pony Saloon
14641 S.R. 3
Lakeville, OH 44638

Dear Mr. Tyler:

On July 10, 2007, this office conducted a compliance evaluation inspection of the wastewater treatment system serving the above referenced facility. Present during the inspection were this writer and Kraig Bucklew of the Holmes County Health Department.

At the time of the inspection, the system was producing what appeared to be a satisfactory quality effluent. The mixed liquor in the aeration tank was a good color and the settling tank effluent was clear. There was, however, an excessive amount of solids on the surface of the clarifier (See Figure 1).

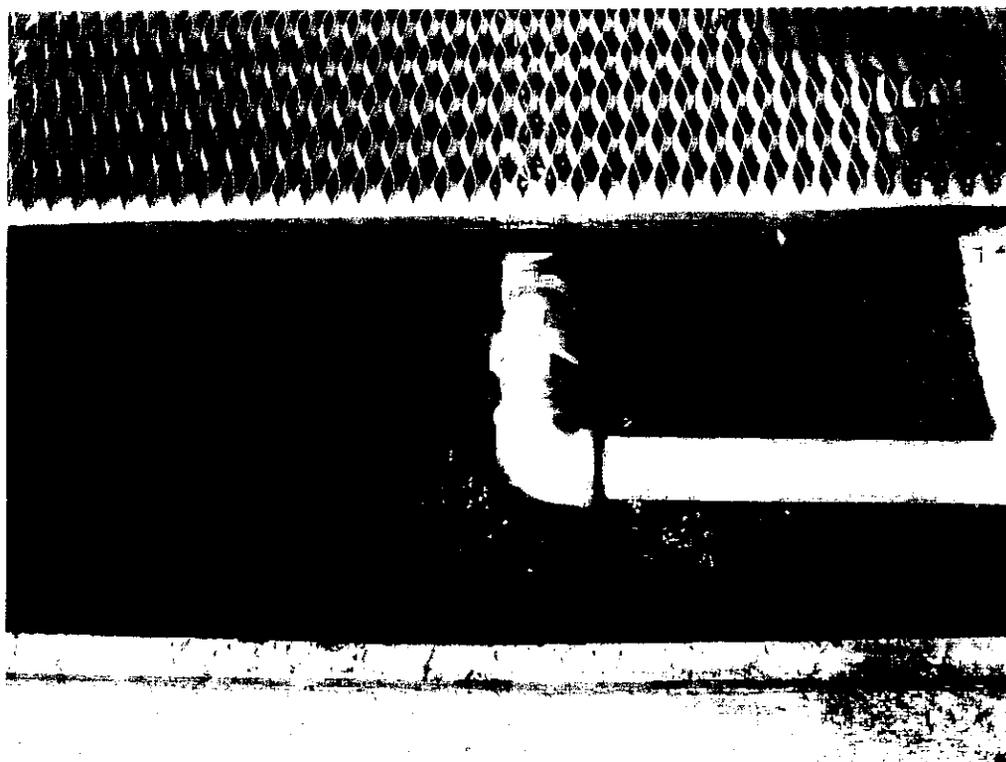



Figure 1 – Solids on clarifier surface

Mr. Chris Tyler
Iron Pony Saloon
July 12, 2007
Page 2

Overall, the plant was in very good operation and maintenance condition. Included with this letter is a list on National Pollutant Discharge Elimination System (NPDES) permit violations covering the period August 2006 through May 2007.

Overall, the results of the inspection were satisfactory. Should you have any questions or comments regarding this letter, please contact this office at (330) 963-1197.

Sincerely,



Dean W. Stoll, P.E.
Environmental Engineer
Division of Surface Water

DWS/mt

enclosure

cc: Kraig Bucklew, Holmes County Health Department
Kevin Dean

File: Semi-Public/Iron Pony Saloon

Permit No	Reporting Period	Station	Reporting Code	Parameter	Limit Type	Limit	Reported Value	Violation Date
3PR00158*BD	August 2006	001	50060	Chlorine, Total Residu	1D Conc	0.019	.11	8/15/2006
3PR00158*BD	October 2006	001	00400	pH	1D Conc	9.0	9.06	10/25/2006
3PR00158*BD	November 2006	001	00400	pH	1D Conc	9.0	9.05	11/22/2006
3PR00158*BD	February 2007	001	00530	Total Suspended Solids	30D Conc	12	22.	2/1/2007
3PR00158*BD	February 2007	001	00610	Nitrogen, Ammonia (NH3)	30D Conc	1.5	4.4	2/1/2007
3PR00158*BD	February 2007	001	80082	CBOD 5 day	30D Conc	10	13.	2/1/2007
3PR00158*BD	February 2007	001	00530	Total Suspended Solids	7D Conc	18	22.	2/22/2007
3PR00158*BD	February 2007	001	00610	Nitrogen, Ammonia (NH3)	7D Conc	2.3	4.4	2/22/2007
3PR00158*BD	March 2007	001	00300	Dissolved Oxygen	1D Conc	5.0	4.95	3/1/2007
3PR00158*BD	March 2007	001	00530	Total Suspended Solids	30D Conc	12	100.	3/1/2007
3PR00158*BD	March 2007	001	00530	Total Suspended Solids	7D Conc	18	100.	3/1/2007
3PR00158*BD	March 2007	001	00530	Total Suspended Solids	30D Qty	0.32	1.70325	3/1/2007
3PR00158*BD	March 2007	001	00530	Total Suspended Solids	7D Qty	0.48	1.70325	3/1/2007
3PR00158*BD	March 2007	001	00610	Nitrogen, Ammonia (NH3)	30D Conc	1.5	18.9	3/1/2007
3PR00158*BD	March 2007	001	00610	Nitrogen, Ammonia (NH3)	7D Conc	2.3	18.9	3/1/2007
3PR00158*BD	March 2007	001	00610	Nitrogen, Ammonia (NH3)	30D Qty	0.04	.32191	3/1/2007
3PR00158*BD	March 2007	001	00610	Nitrogen, Ammonia (NH3)	7D Qty	0.06	.32191	3/1/2007
3PR00158*BD	March 2007	001	80082	CBOD 5 day	30D Conc	10	27.	3/1/2007
3PR00158*BD	March 2007	001	80082	CBOD 5 day	7D Conc	15	27.	3/1/2007
3PR00158*BD	March 2007	001	80082	CBOD 5 day	30D Qty	0.26	.45988	3/1/2007
3PR00158*BD	March 2007	001	80082	CBOD 5 day	7D Qty	0.40	.45988	3/1/2007
3PR00158*BD	April 2007	001	00610	Nitrogen, Ammonia (NH3)	30D Conc	1.5	3.07	4/1/2007
3PR00158*BD	April 2007	001	00610	Nitrogen, Ammonia (NH3)	7D Conc	2.3	3.07	4/1/2007