



State of Ohio Environmental Protection Agency

Northeast District Office

2110 East Aurora Rd.  
Twinsburg, Ohio 44087

TELE: (330) 963-1200 FAX: (330) 487-0769  
www.epa.state.oh.us

Ted Strickland, Governor  
Lee Fisher, Lieutenant Governor  
Chris Korleski, Director

August 13, 2009

RE: HOLMES COUNTY  
WASHINGTON TOWNSHIP  
KAUFMAN'S TRAILER PARK  
TR 466

Christine Kaufman  
P.O. Box 366  
Nashville, OH 44661

Dear Ms. Kaufman:

On August 11, 2009, this office conducted an inspection of the wastewater treatment system serving the above referenced facility. Present during the inspection were this writer and Kraig Bucklew of the Holmes County Health Department.

The existing sewage treatment system consists of a trash trap followed by a 6,000 gpd extended aeration treatment plant with a dosing chamber, surface sand filter and chlorine contact tank.

At the time of the inspection, the contents of the aeration tank were septic. One surface sand filter bed was plugged with solids and wastewater was ponded on the sand filter. The second sand filter bed was in good condition; however, the overflow that was cut into the sand filter wall must be filled in. There was evidence that the filter has overflowed, as the ground was eroded in this area. The dosing chamber control box has been knocked over, most likely from horses that are kept in the pasture. The treatment plant must be fenced off to prevent further damage to the system. The top of the tablet chlorinator was missing.

A review of your discharge monitoring reports covering the period November 2008 through April 2009 revealed the following effluent violations:

Reporting Period	Station	Parameter	Limit Type	Limit	Reported Value	Violation Date
March 2009	001	Dissolved Oxygen	1D Conc	6.0	4.86	3/5/2009
March 2009	001	Dissolved Oxygen	1D Conc	6.0	4.61	3/11/2009
March 2009	001	Dissolved Oxygen	1D Conc	6.0	4.32	3/16/2009
March 2009	001	Dissolved Oxygen	1D Conc	6.0	4.86	3/23/2009

Should you have any questions or comments regarding this letter, please contact this office at (330)963-1197.

Sincerely,


Dean W. Stoll, P.E.  
Environmental Engineer  
Division of Surface Water

DWS/mt

Enclosures

Pc: Holmes County Health Department, Attn: Kraig Bucklew  
Kevin Dean


File: Semi-Public/J.R.'s Rolling Wheels Estates

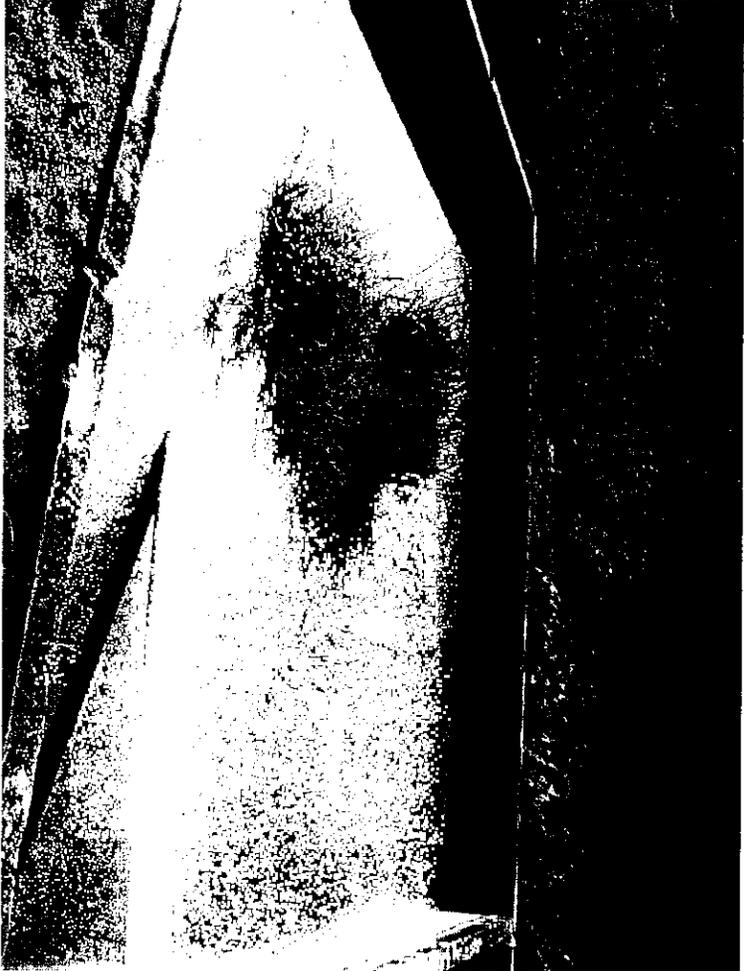

Surface sand filter beds.



Dosing chamber control box.

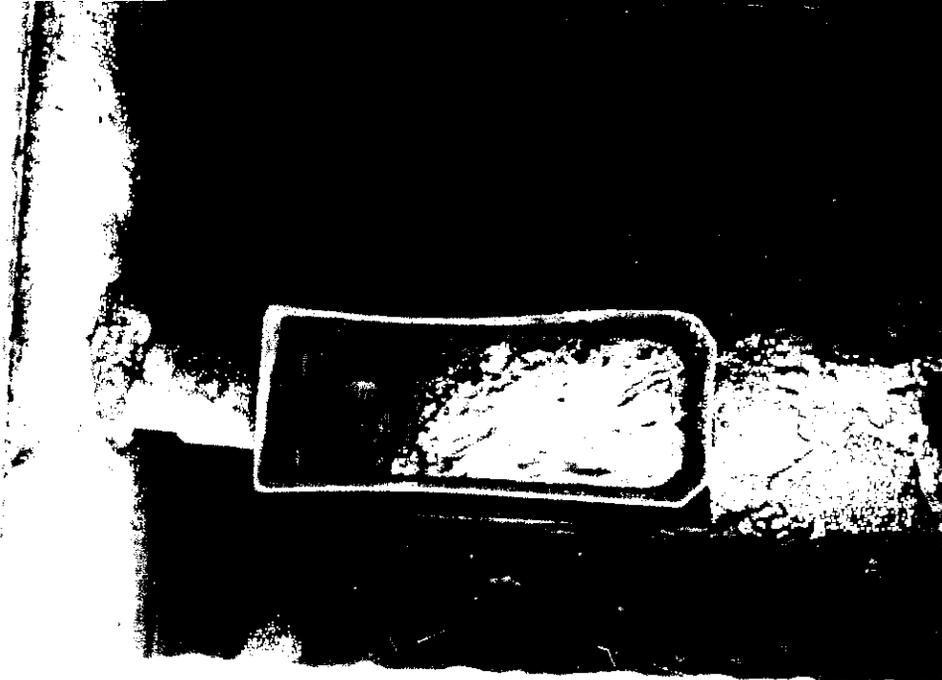

Tablet chlorinator.