



State of Ohio Environmental Protection Agency

Northeast District Office

2110 East Aurora Rd.
Twinsburg, Ohio 44087

TELE: (330) 963-1200 FAX: (330) 487-0769
www.epa.state.oh.us

Ted Strickland, Governor
Lee Fisher, Lieutenant Governor
Chris Korleski, Director

June 19, 2009

**RE: Stark County
Sugar Creek Township
Camp Wanake
9463 Manchester Ave.
NPDES #3PR00308**

Philip White
Camp Wanake
9463 Manchester Ave.
Beach City, OH 44608

Dear Mr. White:

An inspection of the sewage treatment plant serving Camp Wanake was conducted by this writer on June 18, 2009.

At the time of the inspection, the mixed liquor in the aeration tank was a dark brown color, indicative of a properly operating biological system. The sludge blanket in the clarifier was within eight inches of the water surface elevation.

The dosing chamber was operating during the inspection and was dosing clear water to the surface sand filter beds. The sand filter beds were in good condition, but did contain some vegetation that needs to be removed. The sand filter distribution box is leaking and needs to be repaired.

The contents of the chlorine contact tank were clear. However, the tablet dechlorinator did not contain any dechlorination tablets.

A review of your discharge monitoring reports (DMRs) covering the period July 2008 through April 2009 revealed the following effluent violations:

Reporting Period	Station	Parameter	Limit Type	Limit	Reported Value	Violation Date
September 2008	001	Total Suspended Solids	30D Conc	12	38.	9/1/2008
September 2008	001	Total Suspended Solids	7D Conc	18	38.	9/8/2008
April 2009	001	Total Suspended Solids	30D Conc	12	20.	4/1/2009
April 2009	001	Total Suspended Solids	7D Conc	18	20.	4/15/2009

Philip White
Camp Wanake
June 19, 2009
Page 2

Should you have any questions or comments regarding this letter, please contact this office at (330) 963-1197.

Sincerely,

A handwritten signature in black ink that reads "Dean Stoll". The signature is written in a cursive style with a large initial "D".

Dean W. Stoll, P.E.
Environmental Engineer
Division of Surface Water


DWS:cl
Enclosure

Pc: Stark County Health Department, Attn: Todd Ascani
Dave Samsa, Wastewater Services

File: Semi-Public/Camp Wanake



Clarifier – note high sludge blanket.

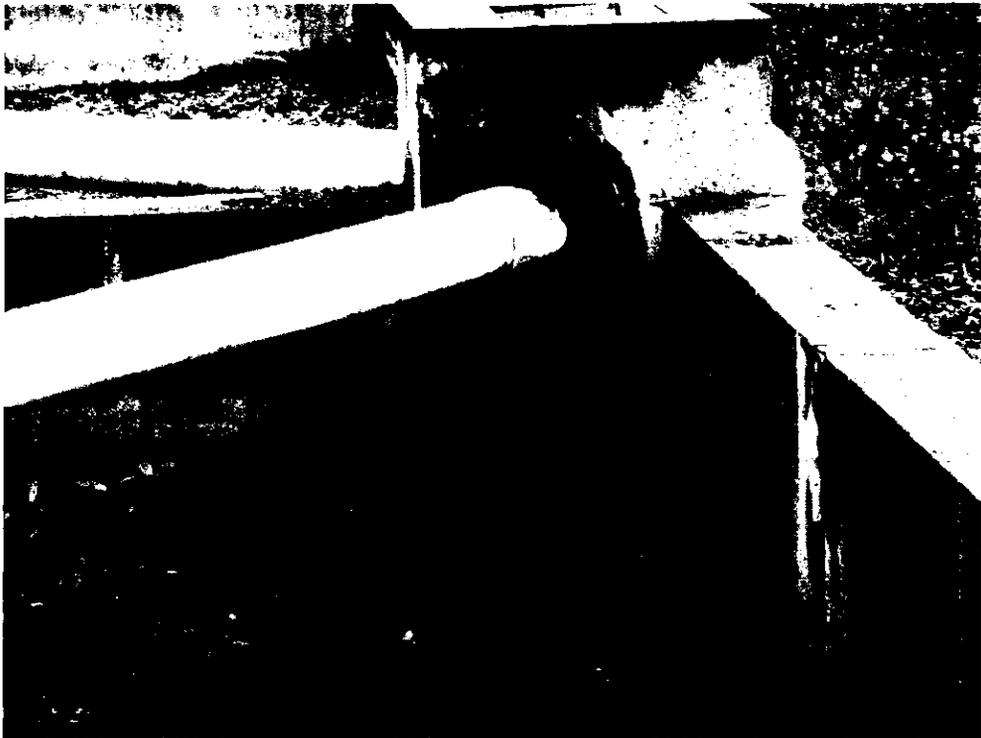

Surface sand filter – note leaking distribution box.