



State of Ohio Environmental Protection Agency

Northeast District Office

2110 East Aurora Rd.
Twinsburg, Ohio 44087

TELE: (330) 963-1200 FAX: (330) 487-0769
www.epa.state.oh.us

Ted Strickland, Governor
Lee Fisher, Lieutenant Governor
Chris Korleski, Director

September 26, 2007

RE: STARK COUNTY
BETHLEHEM TOWNSHIP
RED DOG SALOON
7151 SHERMAN CHURCH
NPDES 3PR00317

Mr. Sonny Turcotte
Red Dog Saloon
7151 Sherman Church Ave. SW
East Sparta, OH 44626

Dear Mr. Turcotte:

On September 19, 2007, this office conducted an inspection of the wastewater treatment system serving the above referenced facility. Present during the inspection was this writer.


The existing sewage treatment system consists of a 3,500-gpd extended aeration package plant with a 750-gallon trash trap, 8,000-gallon aeration tank, dosing chamber, 450-square-foot surface sand filter, and a 107-gallon chlorine contact tank with a tablet chlorinator. The system discharges to an unnamed tributary to the Tuscarawas River.

At the time of the inspection, the mixed liquor in the aeration tank had a good color. The contents of the clarifier were slightly cloudy. Some solids were noted in the clarifier effluent channel. The surface sand filter beds contained a small amount of vegetation that needs to be removed. The tablet chlorinator and dechlorinator only contained one tablet each. Tablets need to be added to these boxes.

A review of your monthly operating reports covering the period September 2006 through August 2007 revealed the following effluent violations:

| Reporting Period | Station | Parameter | Limit Type | Limit | Reported Value | Violation Date |
|------------------|---------|-------------------------|------------|-------|----------------|----------------|
| March 2007 | 001 | Nitrogen, Ammonia (NH3) | 30D Conc | 3.0 | 18.4875 | 3/1/2007 |
| March 2007 | 001 | Nitrogen, Ammonia (NH3) | 30D Qty | 0.04 | .05706 | 3/1/2007 |
| March 2007 | 001 | Nitrogen, Ammonia (NH3) | 7D Conc | 4.5 | 39.9 | 3/8/2007 |
| March 2007 | 001 | Nitrogen, Ammonia (NH3) | 7D Qty | 0.06 | .07551 | 3/8/2007 |
| March 2007 | 001 | Nitrogen, Ammonia (NH3) | 7D Conc | 4.5 | 18.5 | 3/22/2007 |
| August 2007 | 001 | Total Suspended Solids | 30D Conc | 12 | 15.5 | 8/1/2007 |
| August 2007 | 001 | Total Suspended Solids | 1D Conc | 18 | 31. | 8/13/2007 |

Mr. Sonny Turcotte
Red Dog Saloon
September 26, 2007
Page 2

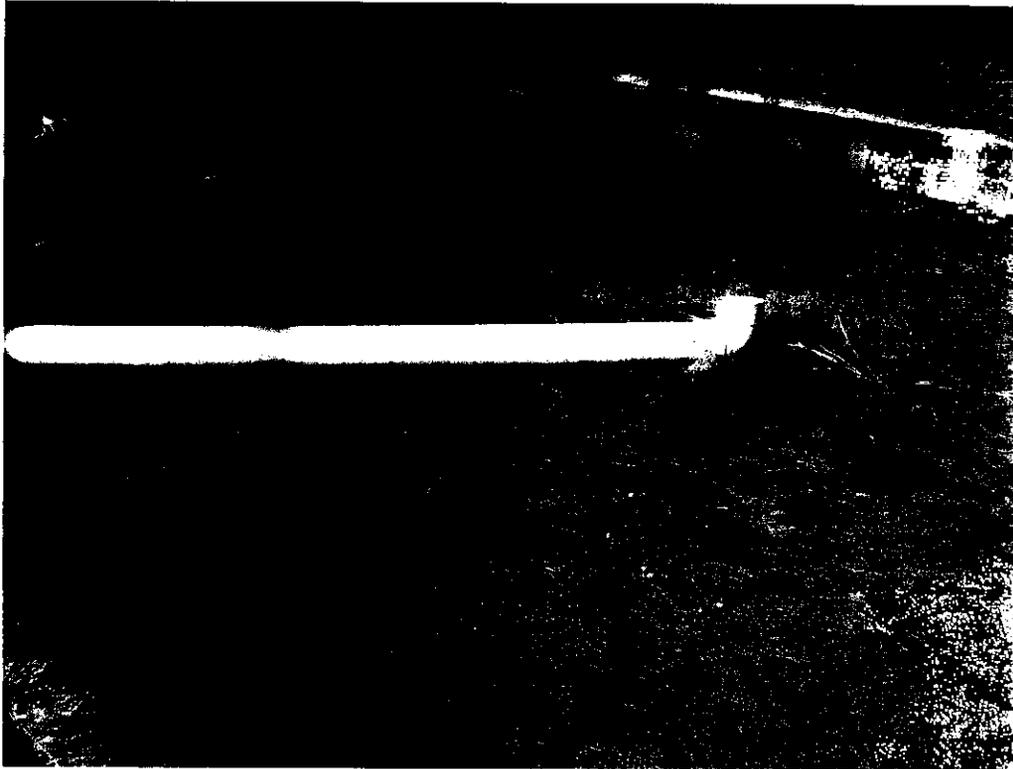

Surface sand filter




Effluent channel following clarifier

Mr. Sonny Turcotte
Red Dog Saloon
September 26, 2007
Page 3

Overall, the results of the inspection were satisfactory. Should you have any questions or comments regarding this letter, please contact this office at (330) 963-1197.

Sincerely,

A handwritten signature in black ink that reads "Dean Stoll". The signature is written in a cursive style with a large initial "D" and a stylized "S".

Dean W. Stoll, P.E.
Environmental Engineer
Division of Surface Water

DWS/mt

cc: Todd Ascani, Stark County Health Department

File: Semi-Public/Red Dog Saloon