




John R. Kasich, Governor  
Mary Taylor, Lt. Governor  
Scott J. Nally, Director

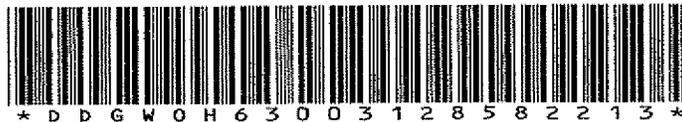

**NOTICE OF VIOLATION – ACTION REQUIRED**

January 14, 2013

Mr. John Keyes  
Oakwood Village Water  
228 North First Street  
P.O. Box 457  
Oakwood, Ohio 45873

Paulding County  
Oakwood Village Water  
Community PWS  
PWS ID: OH6300312

Dear Mr. Keyes:

In accordance with Ohio Administrative Code (OAC) Rule 3745-83-01(C)(1), community water systems are required to maintain a minimum chlorine residual of at least 0.2 mg/L free or 1.0 mg/L combined chlorine throughout the distribution system.

The Monthly Operation Report (EPA Form 5002) for the November 2012 monitoring period reported free chlorine residual of less than two-tenths milligrams per liter (mg/l) and combined chlorine residual of less than one mg/l in the distribution system on twelve days, a violation of OAC Rule 3745-83-01(C)(1).

If you have any questions, please contact me at (419) 373-3101 or via e-mail at [chris.riddle@epa.ohio.gov](mailto:chris.riddle@epa.ohio.gov).

Sincerely,

Chris Riddle  
Division of Drinking and Ground Waters

/cg

pc: DDAGW - NWDO

