

**Environmental
Protection Agency**

John R. Kasich, Governor
Mary Taylor, Lt. Governor
Scott J. Nally, Director

April 22, 2011

Re: Jefferson County
Tiltonsville WWTP
Compliance Evaluation Inspection
Correspondence (PWW)

Mayor and Council
Village of Tiltonsville
P.O. Box 127
Tiltonsville, Ohio 43963

Dear Mayor and Council:

On April 12, 2011, I conducted a Compliance Evaluation Inspection at the Village of Tiltonsville Wastewater Treatment Plant (WWTP). The purpose of the inspection was to determine compliance with terms and conditions of National Pollutant Discharge Elimination System (NPDES) permit number 0PB00085*ED and to evaluate the wastewater treatment systems performance.

I reviewed the self-monitoring data from August 1, 2008 through April 1, 2011. The following numerical limit violations occurred:


Station	Reporting Code	Parameter	Limit Type	Limit	Reported Value	Violation Date
001	00400	pH	1D Conc	9.0	9.3	11/30/2009
001	00400	pH	1D Conc	6.5	6.4	6/30/2010

The permit requires the village to report noncompliance as directed by Part III.12.E of the permit which shall contain information listed in Part III.12.B and Part III.12.C. Please provide noncompliance notification in the event that a limit has been exceeded. The following web link contains a template form for noncompliance notification: <http://www.epa.ohio.gov/dsw/permits/permits.aspx>. The form could then be e-mailed or sent hard copy to my attention.

Only one of five blowers were in operation during the inspection. Many of the blowers have been recently modified to incorporate grease fittings. The Village plans to modify the piping with the addition of flanges for easier maintenance. The Village also plans to add stainless steel guy wires to provide stability to the air lines. With warmer weather approaching, efforts to complete these maintenance activities shall be expedited assuring sufficient aeration for treatment.

The facility's synthetic lagoon liners are tearing at the seams. Numerous tears were noticed just above the water line. I recommend that the tears be inventoried and that the Village contact a contractor to assess what repairs/patches can be made.

Reported flow for Tiltonsville WWTP is shown below:

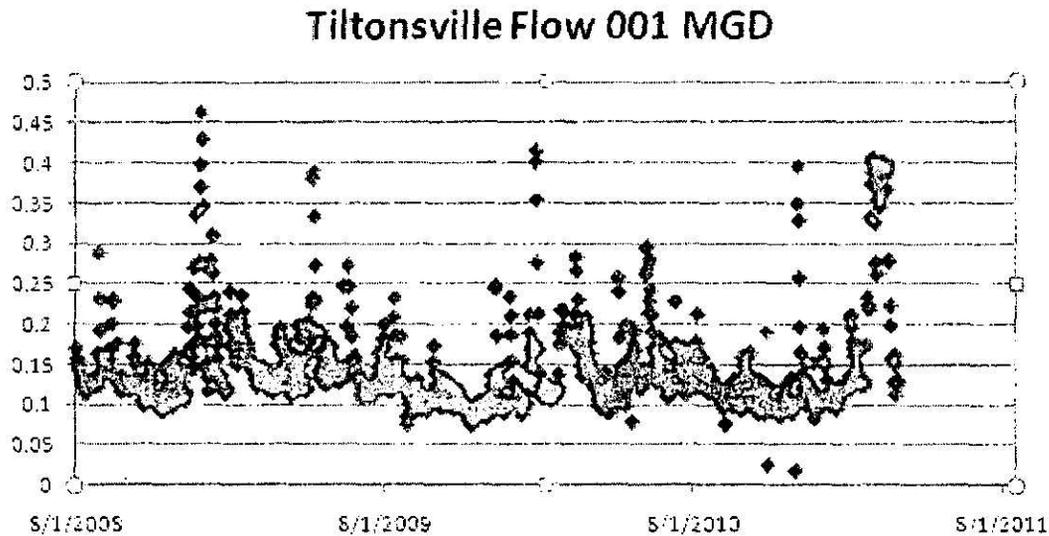

A copy of my inspection report is enclosed. The assistance and cooperation received during the inspection was appreciated. If you have any questions, please feel free to contact me at (740) 380-5272.

Sincerely,

Aaron Pennington
District Representative
Division of Surface Water

AP/dh

Enclosures

NPDES Compliance Inspection Report

A. NATIONAL DATA SYSTEM CODING

Permit No.	NPDES No.	Date	Inspection Type	Inspector	Facility Type
OPB00085*ED	OH0090891	April 12, 2011	CEI	S	I

B. FACILITY DATA

Name & Location of Facility Inspected	Entry Time	Permit Effective Date
Tiltonsville WWTP Old Route 7 North of Warrenton Terminal Tiltonsville, OH	~11:15 a.m.	August 1, 2008
	Exit Time	Permit Expiration Date
	~12:20 p.m.	July 31, 2013

Name(s) & Title(s) of On-Site Representative(s)	Phone Number(s)
Carl Sgalla, Operator	(740) 317-1945
Name, Address, & Title of Responsible Official	Phone Number
Mayor and Council PO Box 127 Tiltonsville, OH 43963	(740) 859-4692

C. AREAS EVALUATED DURING INSPECTION

<u>S</u> Permit	<u>S</u> Flow Measurement	<u>N/A</u> Pretreatment
<u>S</u> Records/Reports	<u>M</u> Laboratory	<u>N/A</u> Compliance Schedules
<u>M</u> Operations & Maintenance	<u>S</u> Effluent/Receiving Waters	<u>S</u> Self-Monitoring Program
<u>M</u> Facility Site Review	<u>S</u> Sludge Storage/Disposal	<u> </u> Other
<u>S</u> Collection System		

(S = Satisfactory; M = Marginal; U = Unsatisfactory; N = Not Evaluated; N/A = Not Applicable)

D. SUMMARY OF FINDINGS/COMMENTS (attach additional sheets if necessary)

See Cover Letter


 Aaron M. Pennington, Inspector, Ohio EPA, Southeast District Office

4-15-2011
 Date


 Timothy M. Campbell, Reviewer, Ohio EPA, Southeast District Office

4/22/11
 Date

E. PERMIT VERIFICATION

Inspection Observations Verify the Permit	YES	NO	N/A	N/E
a. Correct name & mailing address of permittee	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
b. Correct name & location of receiving waters	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
c. Product(s) & production rates conform with permit application (industries)	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
d. Flows & loadings conform with NPDES permit	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
e. Treatment processes are as described in permit application/briefing memo	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
f. New treatment process(es) added since last inspection	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
g. Notification given to state of new, different, or increased discharges	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
h. All discharges are permitted	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
i. Number & location of discharge points are as described in permit	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

Comments:

New air blowers and distribution installed in 2005, installed two new submersible pumps at Tiltonville Lift Station ~3 years ago.

F. COMPLIANCE SCHEDULES/VIOLATIONS

	YES	NO	N/A	N/E
a. Any significant violations since the last inspection	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
b. Permittee is taking actions to resolve violations	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
c. Permittee has compliance schedule	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
d. Compliance schedule contained in: _____	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
e. Permittee is meeting compliance schedule	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>

Comments:

G. OPERATION AND MAINTENANCE

Treatment Facility Properly Operated & Maintained	YES	NO	N/A	N/E
a. Standby power available: Generator: <input type="checkbox"/> Dual Feed: <input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
b. Adequate alarm system available for power or equipment failures	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
c. All treatment units in service other than backup units	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
d. Sufficient operating staff provided: # of shifts: <u>1</u> Days/Week: <u>5</u>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
e. Operator holds unexpired license of class required by permit. Class: <u>I</u>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
f. Copy of certificate of Operator of Record displayed on-site	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
g. Minimum operator staffing requirements fulfilled (OAC 3745-7)	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
h. Routine & preventive maintenance schedule/performed on time	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
i. Any major equipment breakdown since last inspection	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
j. Operation & maintenance manual provided & maintained	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
k. Any plant bypasses since last inspection	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
l. Regulatory agency notified of bypasses: On MORS: <input type="checkbox"/> 800 No.: <input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
m. Any hydraulic and/or organic overloads experienced since last inspection	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

Comments:

Minimum staffing is 1.5 hrs/week :3days/week for Class I. Three of Five blowers were out do to repairs.

Record Keeping	YES	NO	N/A	N/E
a. Log book provided	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
b. Log book kept on-site	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
c. Log book contains the following:	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
1. Identification of treatment works	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
2. Date/Time of arrival/departure of ORC	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
3. Daily record of operation and maintenance activities	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
4. Laboratory results (unless documented on bench sheets)	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
5. Identification of person making log entries	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
d. Is the ORC submitting written notification to Ohio EPA and permittee when a collection system overflow, treatment plant bypass or effluent limit violation has occurred.	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>

Comments:

Collection System	YES	NO	N/A	N/E
a. Percent combined system. Percent: _____	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
b. Any collection system overflows since last inspection: CSO: <input type="checkbox"/> SSO: <input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
c. Regulatory agency notified of overflow (SSOs)	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
d. CSO O&M plan provided and implemented	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
e. CSOs monitored and reported in accordance with permit	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
f. Portable pumps used to relieve system	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
g. Lift station alarm systems provided and maintained	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
h. Are lift stations equipped with permanent standby power or equivalent	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
i. Is there an inflow/infiltration problem (separate sewer system), or were there any major repairs to collection system since last inspection	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
j. Any complaints received since last inspection of basement flooding	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
k. Are any portions of the sewer system at or near capacity	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

Comments:

No Overflows in the past 2-3 years. Some I/I is reported, yet the collection system exhibits capacity to transport the flow to treatment.

H. SLUDGE MANAGEMENT

	YES	NO	N/A	N/E
a. Sludge adequately disposed. Method: _____	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
b. If sludge is incinerated, where is ash disposed of? _____	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
c. Is sludge disposal contracted? Name: _____	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
d. Has amount of sludge generated changed significantly since last inspection	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
e. Adequate sludge storage provided at facility	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
f. Land application sites monitored and inspected per state rules	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
g. Records kept in accordance with state rules	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
h. Any complaints received in last year regarding sludge	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
i. Is sludge adequately processed (digestion, dewatering, pathogen control) in accordance with Ohio EPA rules	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>

Comments:

Lagoon (sludge was pressed in 05 and LA by Synagro). Accumulation was reported as smaller than anticipated.

I. SELF-MONITORING PROGRAM

Part 1 – Flow Measurement	YES	NO	N/A	N/E
a. Primary flow measuring device properly operated & maintained. Type of device: <input checked="" type="checkbox"/> Ultrasonic & parshall flume <input type="checkbox"/> Calculated from influent <input type="checkbox"/> Weir <input type="checkbox"/> Other <input type="checkbox"/> Ultrasonic & weir specify: _____	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
b. Calibration frequency adequate. Date of last calibration: <u>4/7/2010</u>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
c. Secondary instruments (totalizers, recorders, etc.) properly operated and maintained	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
d. Flow measurement equipment adequate to handle expected ranges of flows	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
e. Actual flow discharged is measured	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
f. Flow measuring equipment inspection frequency: <input type="checkbox"/> Daily <input type="checkbox"/> Monthly <input type="checkbox"/> Weekly <input type="checkbox"/> Other				

Comments:

Calibration is scheduled in the upcoming couple weeks. Annual Calibrations

Part 2 - Sampling	YES	NO	N/A	N/E
a. Sampling location(s) are as specified by permit	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
b. Parameters and sampling frequency agree with permit	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
c. Permittee uses required sampling method	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
d. Sample collection procedures are adequate	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
i. Samples refrigerated during compositing	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
ii. Proper preservation techniques used	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Conform with 40 CFR 136.3	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
e. Monitoring records (e.g., flow, pH, D.O., etc.) maintained for a minimum of three years including all original strip chart recordings (e.g., continuous monitoring instrumentation, calibration, & maintenance records)	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
f. Adequate records maintained of sampling date, time, exact location, etc.	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

Comments:

Chain of Custody should be maintained for reportable samples

Part 3 – Laboratory, General	YES	NO	N/A	N/E
a. Written Standard Operating Procedures (SOPs) for all analysis performed on-site	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
b. EPA approved analytical testing procedures used (40 CFR 136.3)	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
c. If alternate analytical procedures are used, proper approval has been obtained	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
d. Analysis being performed more frequently than required by permit	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
e. If (c) is yes, are results reported in permittee's self-monitoring report	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
f. Commercial laboratory used: 1. Parameters analyzed by commercial lab: <u>Low level Hg, O&G, TSS, NH3, Fecals, CBOD5</u> 2. Lab name: <u>MASI, and Mingo Junction WWTP</u>				

Comments:

General Lab Criteria

Facility: Village of Tiltonville WWTP

Criteria	Standard Methods Requirement	Acceptable?	Rating
Balance		<input type="checkbox"/> Yes <input type="checkbox"/> No	NR
• Standard Weights	• Either NIST Class s or ASTM/ANSI Class 1 weights ^{1,2}	<input type="checkbox"/> Yes <input type="checkbox"/> No	
• Calibration Frequency/ Documentation	• Calibration verification required at least once each day the balance is used ³	<input type="checkbox"/> Yes <input type="checkbox"/> No	
• Cleanliness, air movement, vibration	• Cleanliness of balance is a must and air movement and vibration needs to be kept to a minimum ¹	<input type="checkbox"/> Yes <input type="checkbox"/> No	
• Other	• Service and recalibrate annually (manufacturer representative or comparable) ¹	<input type="checkbox"/> Yes <input type="checkbox"/> No	
	• Must be able to measure to 0.1 grams ⁴	<input type="checkbox"/> Yes <input type="checkbox"/> No	
	• Instrument manual available	<input type="checkbox"/> Yes <input type="checkbox"/> No	
		<input type="checkbox"/> Yes <input type="checkbox"/> No	
Comments:			

Criteria	Standard Methods Requirement	Acceptable?	Rating
Boiling Oven (Suspended Solids)		<input type="checkbox"/> Yes <input type="checkbox"/> No	NR
• Temperature Recordkeeping	• Temperature recorded with each use ⁴	<input type="checkbox"/> Yes <input type="checkbox"/> No	
	• Log book maintained ⁶	<input type="checkbox"/> Yes <input type="checkbox"/> No	
• Calibration Frequency/ Documentation	• Thermometer calibrated annually with NIST traceable thermometer ^{1,2} . Correction factor posted on thermometer/equipment ¹	<input type="checkbox"/> Yes <input type="checkbox"/> No	
• Other	• Thermometer temperature in 0.1°C increments ⁵	<input type="checkbox"/> Yes <input type="checkbox"/> No	
	• Acceptable temperature range is 103° – 105°F ⁴	<input type="checkbox"/> Yes <input type="checkbox"/> No	
	• Instrument manual available	<input type="checkbox"/> Yes <input type="checkbox"/> No	
Comments:			

Criteria	Standard Methods Requirement	Acceptable?	Rating
pH Meter		<input type="checkbox"/> Yes <input type="checkbox"/> No	A
• Calibration Frequency/ Documentation	• Calibration verification required for testing over long period of time (e.g. 12 hrs.), or after a large number of samples (every 10 samples) ³	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
	• Log book maintained ⁹	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
• Minimum of 2 point calibration	• Calibration per manufacturer specification and calibration buffers must bracket anticipated result ⁷	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
• Slope Documentation/ Acceptability	• Slope acceptable range indicated on benchsheet ²	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
• Buffer Expiration Date	• Buffers must not be expired	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
• Other	• Instrument manual available	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
	• Teflon covered magnetic stirrer or equivalent for mixing ^B	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Comments:			

General Lab Criteria

Criteria	Standard Methods Requirement	Acceptable?	Rating
Dissolved Oxygen Meter			
• Calibration Method	• Air or known DO calibration method ¹⁰	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	A
	• Calibration per manufacturer specification ¹⁰	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
• Calibration Frequency/ Documentation	• Logbook maintained ⁹	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
	• Calibration verification required at least once each day the meter is used. ³	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
• Other	• Small to no bubble present under membrane (must be smaller than the lead in number 2 pencil) ¹¹	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
	• Instrument manual available	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Comments:			

Criteria	Standard Methods Requirement	Acceptable?	Rating
Incubator (CBOD/E-Coli)			
• Temperature Recordkeeping	• Temperature checked/recorded twice daily for each shelf in use ¹	<input type="checkbox"/> Yes <input type="checkbox"/> No	NR
	• Temperature checked/recorded daily ² (CBOD)	<input type="checkbox"/> Yes <input type="checkbox"/> No	
	• Acceptable temperature range (CBOD) is 20°C ±1.0° ¹²	<input type="checkbox"/> Yes <input type="checkbox"/> No	
	• Acceptable temperature range (E-Coli) is 35°C ±0.5° ²²	<input type="checkbox"/> Yes <input type="checkbox"/> No	
	• Logbook maintained ⁹	<input type="checkbox"/> Yes <input type="checkbox"/> No	
• Temperature Calibration/ Documentation	• Thermometer calibrated annually with NIST traceable thermometer ^{1,2}	<input type="checkbox"/> Yes <input type="checkbox"/> No	
	• Temperature correction information posted on incubator ¹	<input type="checkbox"/> Yes <input type="checkbox"/> No	
• E-Coli can use multiple tubes (five 20 ml or ten 10 mg), or mfg's multi-well tray	• E-coli Ultraviolet lamp (365 nm wave length, 6 W bulb) ²³	<input type="checkbox"/> Yes <input type="checkbox"/> No	
• Other	• Instrument manual available	<input type="checkbox"/> Yes <input type="checkbox"/> No	
	• Temperature Log (thermometer reads to 0.1 Celsius) ⁵	<input type="checkbox"/> Yes <input type="checkbox"/> No	
Comments:			

Criteria	Standard Methods Requirement	Acceptable?	Rating
Refrigerator			
• Temperature Recordkeeping	• Temperature Log (thermometer reads to 0.1 Celsius) ⁵	<input type="checkbox"/> Yes <input type="checkbox"/> No	NR
• Temperature Calibration/ Documentation	• Thermometer calibrated annually with NIST traceable thermometer ^{1,2}	<input type="checkbox"/> Yes <input type="checkbox"/> No	
• Other	• Thermometer held in water bath ¹	<input type="checkbox"/> Yes <input type="checkbox"/> No	
	• Refrigerator temperature ±6° Celsius ¹³	<input type="checkbox"/> Yes <input type="checkbox"/> No	
	• Do not store volatile solvents, food, or beverages ¹⁴	<input type="checkbox"/> Yes <input type="checkbox"/> No	
Comments:			

Criteria	Standard Methods Requirement	Acceptable?	Rating
Chlorine Meter			
• Calibration Frequency/ Documentation	• pH/millivolt meter read to 0.1 mV ¹⁵	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	A
	• Calibration verification required for testing over long period of time (e.g. 12 hrs.), or after a large number of samples (every 10 samples) ³	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
• Calibration Method	• Calibration using three iodate solutions 0.2, 1.0, 5.0 milliliters	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	

General Lab Criteria

	or calibration per manufacturer specification ¹⁶			
• Slope Documentation/ Acceptability	• Standards used for calibration not expired	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	
	• Calibration curve (acceptable slope)	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	
• Other	• Electrode free of deposits and foreign material	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	
	• Log book being maintained ⁹	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	
	• Instrument manual available	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	
Comments:				

Criteria	Standard Methods Requirement	Acceptable?		Rating
Ammonia Meter		Acceptable?		NR
• Calibration Frequency/ Documentation	• Calibration verification required for testing over long period of time (e.g. 12 hrs.), or after a large number of samples (every 10 samples) ³	<input type="checkbox"/> Yes	<input type="checkbox"/> No	
	• Log book being maintained ⁹	<input type="checkbox"/> Yes	<input type="checkbox"/> No	
• Slope Acceptability	• Verify calibration slope is acceptable (per mfg. spec.)	<input type="checkbox"/> Yes	<input type="checkbox"/> No	
• Calibration Method	• Standards used for calibration (3 ammonia solutions of 10 mg/l, 1 mg/l, and 0.1 mg/l) or per mfg. spec. ¹⁷	<input type="checkbox"/> Yes	<input type="checkbox"/> No	
	• Standards used for calibration not expired	<input type="checkbox"/> Yes	<input type="checkbox"/> No	
• Other	• Electrode free of deposits and foreign material	<input type="checkbox"/> Yes	<input type="checkbox"/> No	
	• Teflon covered magnetic stirrer or equivalent for mixing ¹⁸	<input type="checkbox"/> Yes	<input type="checkbox"/> No	
	• Instrument manual available	<input type="checkbox"/> Yes	<input type="checkbox"/> No	
Comments:				

Criteria	Standard Methods Requirement	Acceptable?		Rating
Sample Collection/Handling		Acceptable?		M
• Sample Labeling	• Samples container labeled (description, date, time, preservative added, initialed) ¹⁹	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	
• Chain of Custody	• Chain of custody (description, date, time, signature) ¹⁹	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	
• Other	• Composite samples refrigerated during sample collection ¹⁴	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	
	• Equipment blanks utilized ¹⁴	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	
	• SOP for cleaning of sampling equipment	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	
	• Log book being maintained ⁹	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	
Comments: Grab samples are taken. Chain of Custody form should be developed for the transfer of reportable samples.				

Criteria	Standard Methods Requirement	Acceptable?		Rating
Desiccator		Acceptable?		NR
• General Criteria	• Properly working seals	<input type="checkbox"/> Yes	<input type="checkbox"/> No	
	• Desiccant fresh (blue color)	<input type="checkbox"/> Yes	<input type="checkbox"/> No	
• Documentation	• Log book being maintained ⁹	<input type="checkbox"/> Yes	<input type="checkbox"/> No	
Comments:				

General Lab Criteria

Criteria	Standard Methods Requirement	Acceptable?	Rating
Bench Sheets			
<ul style="list-style-type: none"> • General Criteria 	• Date(s) ²	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	M
	• Analyst initials ²	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
	• Blue or black ink pen ²	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	
	• Calibration information ²	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	
	• Equations, calculations, units for all measurements, notations, and results present ²	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
	• Corrections, single line through, initialed and dated ²	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	
Comments: Ink should be used for reporting on bench sheets and corrections should not erase former entries.			

Criteria	Standard Methods Requirement	Acceptable?	Rating
Hot Water Bath (Fecal Coliform/E. Coli)			
<ul style="list-style-type: none"> • Temperature Recordkeeping 	• Temperature Log (thermometer reads 0.2° C) ²¹	<input type="checkbox"/> Yes <input type="checkbox"/> No	NR
	• Incubator temperature 44.5° C ±0.2° ^{21/24}	<input type="checkbox"/> Yes <input type="checkbox"/> No	
<ul style="list-style-type: none"> • Temperature Calibration/ Documentation 	• Thermometer calibrated annually with NIST traceable thermometer ^{1,2}	<input type="checkbox"/> Yes <input type="checkbox"/> No	
	• Log book being maintained ⁹	<input type="checkbox"/> Yes <input type="checkbox"/> No	
<ul style="list-style-type: none"> • Water Level 	• Thermometer total immersion or partial (line on thermometer to ID immersion depth) ^{1,5}	<input type="checkbox"/> Yes <input type="checkbox"/> No	
Comments:			

Criteria	Standard Methods Requirement	Acceptable?	Rating
Autoclaves/Steam Sterilizers			
<ul style="list-style-type: none"> • All apparatus utilized is adequately sterilized before use 	• Sterilizing temperature 121° C ²⁵	<input type="checkbox"/> Yes <input type="checkbox"/> No	NR
	• 10 to 30 minutes time based on material being sterilized ²⁶	<input type="checkbox"/> Yes <input type="checkbox"/> No	
<ul style="list-style-type: none"> • Documentation 	• Verify the autoclave temperature weekly by using a maximum registering thermometer (MRT) to confirm that 121°C has been reached as measured in the exhaust ¹	<input type="checkbox"/> Yes <input type="checkbox"/> No	
	• Date, contents, sterilization time and temperature, total time in autoclave, and analyst's initials should be recorded each time the autoclave is used ¹	<input type="checkbox"/> Yes <input type="checkbox"/> No	
<ul style="list-style-type: none"> • Temperature Calibration/ Documentation 	• Thermometer calibrated annually with NIST traceable thermometer ^{1,2}	<input type="checkbox"/> Yes <input type="checkbox"/> No	
	• Log book being maintained ⁹	<input type="checkbox"/> Yes <input type="checkbox"/> No	
<ul style="list-style-type: none"> • Performance Checks 	• Test monthly for efficacy using a biological such as commercially available <i>Geobacillus stearothermophilus</i> in spore strips, suspensions, or capsules ¹	<input type="checkbox"/> Yes <input type="checkbox"/> No	
Comments:			

General Lab Criteria

Criteria	Standard Methods Requirement	Acceptable?	Rating
Final Effluent Temperature Monitoring			
<ul style="list-style-type: none"> • General Criteria 	<ul style="list-style-type: none"> • Thermometer calibrated annually with NIST traceable thermometer^{1,2} 	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	A
	<ul style="list-style-type: none"> • Thermometer reads in increments of at least 0.1°C⁵ 	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
	<ul style="list-style-type: none"> • Log book being maintained² 	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Comments: Uses an electronic meter			

Number of Criteria Rated:	Acceptable	4
	Marginal	2
	Unacceptable	0
	Total Number of Areas Rated	6

Acceptable Ratings – No action required (recommend SOP's written or updated, perform DMRQA's for all onsite analysis, recommend voluntary lab analyst certification, written response not required).	
Marginal Ratings – Improvements required, written response required (recommend SOP's be written or updated, recommend they perform DMRQA's for all onsite analysis, recommend voluntary lab analyst certification, require deficiencies to be addressed in written response).	
Unsatisfactory Rating – Improvements required, written response required, NOV issued (recommend SOP's be written or updated, recommend they perform DMRQA's for all onsite analysis, recommend voluntary lab analyst certification, require deficiencies to be addressed in written response to NOV).	
Consider recommending PAI Audit from DES when:	>60% of ratings are Marginal >45% of ratings are a combination of Marginal or Unacceptable >30% of ratings are Unacceptable

General Lab Criteria

Notation of Referenced Method

1	Method 9020-B, Item 4	14	Method 1060A, Item 1
2	Method 1020-A, Item 1	15	Method 4500-CI I, Item 2
3	Method 1020-B, Item 10	16	Method 4500-CI I, Item 4
4	Method 2540-B, Item 2	17	Method 4500-NH3 D, Item 4
5	Method 2550-B, Item 1	18	Method 4500-NH3 D, Item 2
6	Method 1020-B, Item 1	19	Method 1060-B, Item 2
7	Method 4500-H B, Item 4	20	Method 1060-B, Item 1
8	Method 4500-H B, Item 2	21	Method 9222D, Item 1
9	Method 1020-B, Item 2	22	Method 9223 B, Item 2
10	Method 4500-O B, Item 3	23	Method 9223 B, Item 3
11	Method 4500-O G, Item 3	24	Method 1603, Item 2
12	Method 5210-B, Item 5	25	Method 9030-B, Item 3
13	CFR 136.3, Table II	26	Method 9020 B, Table IV

Equipment Logbook Content – All maintenance performed on a piece of equipment should be documented in the logbook. This should include parts replacement and routine maintenance activities. Entries should include date, maintenance performed and initials of person making entry.

Preservation and Holding Times						
Parameter	Container	Min. Sample Size (mL)	Sample Type	Preservation	Maximum Storage Time	
					Recommended	Regulatory
BOD / CBOD	P, G	1000	G, C	Refrigerate ≤6°C	6h	48h
TSS	P, G	200	G, C	Refrigerate ≤6°C	7 d	7 d
pH	P, G	50	G	Analyze immediately	0.25h	0.25 h
NH3-N	P, G	500	G, C	Analyze as soon as possible or add H ₂ SO ₄ to pH <2, Refrigerate ≤6°C	7 d	28 d
TRC	P, G	500	G	Analyze immediately	0.25h	0.25 h
DO (electrode)	G, BOD Bottle	300	G	Analyze immediately	0.25h	0.25 h
Temperature	P, G	--	G	Analyze immediately	0.25h	0.25 h
Metals, general	P, G	1000	G, C	For dissolved filter immediately and add HNO ₃ to pH <2	6 months	6 months
Purgeables by purge and trap	G (PTFE lined lid)	40 (X2)	G	HCl to pH <2, Refrigerate ≤6°C	7 d	14 d
Base/Neutrals and acids	G (solvent rinsed or baked)	1000	G, C	Refrigerate ≤6°C	7 d	7 days until extraction 40 days after extraction
Pesticides	G (PTFE lined lid)	1000	C	Refrigerate ≤6°C	7 d	7 days until extraction 40 days after extraction
Fecal Coliform / E-Coli	G, P (Sterilized)	100	G	Refrigerate ≤10°C If chlorine present, add sodium thiosulfate tablet	6 hrs transport. Start analysis within 2 hrs of receipt in lab.	
Oil and Grease	G	1000	G	HCl or H ₂ SO ₄ to pH <2, Refrigerate ≤6°C	28 d	28 d

General Lab Criteria

Approved Standard Methods	
CBOD / BOD 5 Day	Std Methods 5210-B
Ammonia, Selective Electrode Method	Std Methods 4500-NH3 D
Total Residual Chlorine, DPD Colorimetric Method	Std Methods 4500-Cl G
Total Suspended Solids, Dried at 103-105°C	Std Methods 2540-D
Dissolved Oxygen, Membrane Electrode Method	Std Methods 4500-O G
pH, Electrometric Method	Std Methods 4500-H+ B
Fecal Coliform, Membrane Filter Procedure	Std Methods 9222D
Escherichia Coli, Enzyme Substrate Test	Std Method 9223B
Escherichia Coli Membrane Filtration Procedure	EPA Method 1603
Oil and Grease	USEPA 1664A or Std Methods 5520B
Metals, general	USEPA 200, Std Methods 3111B or C, or 3120B
Volatiles (Purgeables by purge and trap)	USEPA 6210, Std Methods 624
Semi-Volatiles (Base/Neutrals and acids)	USEPA 6410, Std Methods 625
Pesticides	USEPA 6410 and 6630, Std Methods 608