




E
P
J
P
S

OH7901912

TCMSD-RIDGEWOOD PWS

9/12/2011

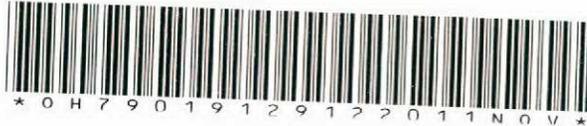

September 12, 2011

RE: Tuscarawas County
TCMSD Ridgewood
Community Water System
PWS ID#OH7901912
STU ID#OH7959281

Mr. Charles D. Williams
9944 Wilkshire Boulevard
Bolivar, Ohio 44612

Notice of Violation

Dear Mr. Williams:

Ohio EPA received your July and August Monthly Operating Reports for the Ridgewood public water system, but there were several inconsistencies with the free chlorine residual noted in both the plant tap and distribution system.

July MOR, received August 8, 2011:

Your public water system is in violation of the Ohio Administrative Code (OAC) Rule 3745-83-01(C)(1) for failure to maintain a 0.2 mg/L free or 1 mg/L combined chlorine residual. There were 9 instances in the distribution system and 2 at the plant tap where this situation occurred for the month.

August MOR, received September 7, 2011:

Your public water system is in violation of the Ohio Administrative Code (OAC) Rule 3745-83-01(C)(1) for failure to maintain a 0.2 mg/L free or 1 mg/L combined chlorine residual. There were 18 instances in the distribution system and 2 at the plant tap where this situation occurred for the month.

Our phone conversation on September 12, 2011, revealed the issue was a weak chlorine solution due to storing the bulk chlorine container on the loading dock where the sun and elements may have caused the chlorine to dissipate. Since that time, a new chlorine solution has been acquired and used with free residuals being maintained above 1.0 mg/L and a combined residual at or below 0.5 mg/L.

TCMSD Ridgewood
September 12, 2011
Page 2

If you have any questions, please contact me at (740) 380-5229.

Sincerely,



Russell Flagg, REHS
Environmental Specialist
Division of Drinking and Ground Waters

RF/cb

cc: Central Office/DDAGW, Toni Buchanan
Tuscarawas County Health Department
Jamie Wilkins, SEDO