



City of Cleveland
Frank G. Jackson, Mayor

Department of Public Health
Division of Air Quality
75 Erieview Plaza, Suite 200
Cleveland, Ohio 44114-1839
216/664-2297 • Fax: 216/420-8047
www.clevelandhealth.org

**SERVING OHIO EPA AS AGENCY 13
FOR CUYAHOGA COUNTY**

**CERTIFIED MAIL 7003 1010 0004 2923 6912
RETURN RECEIPT REQUESTED**

June 17, 2011

Scott Moon
Mayfield Road Center, LLC dba Sunoco/Hop-in
P.O. Box 1565
Lawrenceville, GA 30046

FACILITY ID: 13-18-30-6226

NOTICE OF VIOLATION: Failure to pass Air-to-Liquid Ratio Stage II testing

Dear Mr. Moon:

On June 1, 2011, the Cleveland Division of Air Quality (CDAQ) inspected Sunoco/Hop-in located at 5332 Mayfield Road in Lyndhurst. This letter serves as notification that you are operating sources in violation of the following applicable air statutes, air regulations, or air permit conditions.

Sunoco/Hop-in failed to successfully pass an Air-to-Liquid Ratio test for all gasoline grades on pump #7 on June 1, 2011. This testing is required pursuant to Ohio Administrative Code (OAC) Rule 3745-21-09(DDD)(2). The failure to successfully pass the testing requirements in OAC Rule 3745-21-09(DDD)(2) while causing, allowing or permitting the transfer of gasoline from a stationary storage tank into a motor vehicle are also violations of OAC Rule 3745-21-09(DDD)(1)(c) and Ohio Revised Code Sections 3704.05(G).

Unless you undertake some type of corrective action with respect to the above noted violations, you will remain in non-compliance. CDAQ requests that Sunoco/Hop-in make the necessary repairs to the vapor control equipment, and conduct a re-test of the Air-to-Liquid Ratio and submit the results within thirty (30) days to the following enforcement representative:

Valerie Shaffer
Cleveland Division of Air Quality
75 Erieview Plaza 2nd Floor
Cleveland, Ohio 44114-1839



If there is insufficient time to correct the alleged violations within this timeframe, your response must include a timeline for correcting the alleged violations.

Violations of Ohio air pollution laws and /or permit terms and conditions are subject to the penalties stipulated in Ohio Revised Code Section 3704.99(A), which allows fines of not more than twenty-five thousand dollars or imprisonment for not more than one year, or both, for each violation.

CDAQ issues this letter with Ohio EPA's concurrence. The failure to mention any specific violation does not excuse any violations of local, state and federal laws or regulations regarding air pollution control. Violations of air pollution control laws may be pursued in local court or referred to Ohio EPA or U.S. EPA for further enforcement action. Should you have any questions, please call Valerie Shaffer at (216) 664-6292. All correspondence with CDAQ must include the Ohio EPA facility identification number for Sunoco/Hop-in: 13-18-30-6226.

Sincerely,

Linda Kimmy

Linda Kimmy
Field Enforcement Manager

LK/vls

cc: Charles Hill, Sunoco/Hop-in
John Paulian, Ohio EPA Central Office
William MacDowell, U.S. EPA Region V
Facility File and L:\Data\Facilities\1318306226\2011-06-01 NOV.docx

St WO 299075, Jun 30th, 2011

CERTIFICATE OF STORAGE TANK SYSTEM TESTING

Crompco, LLC
1815 Gallagher Road
Plymouth Meeting, PA 19462

Phone: (610) 278-7203
Fax: (610) 278-7621



Work Order #299075	Client Information	Location #00018762
Date: Thu Jun 30th, 2011 Reason: Compliance Retest Compliance: Yes	Majors Management(Heather Hamrick) Invoice #307530 Permit# P.O.#	Major Management Sunoco Service Station 5332 Mayfield Road Lyndhurst, OH 44124 County: Cuyahoga State ID: 18001881
Testing was conducted in accordance with all applicable portions of Federal, NFPA, and local regulations.		
Vapor Recovery - Stage II		
Test	Result	
Air to Liquid Ratio	Pass	
Miscellaneous Inspections		
Test	Result	
Shear Valve	Fail	
Comments		
The Regular unleaded shear valve located in dispenser #1/2 fails to shut down product flow when tripped.		

A handwritten signature in black ink, appearing to be "Gerry Ford", written over a rectangular box.

Gerry Ford
API Worksafe Safety Key# 24953270

St WO 299075, Jun 30th, 2011

Crompeco, LLC
1815 Gallagher Road
Plymouth Meeting, PA 19462

Sumoco Service Station
Phone: (610) 278-7203
FAX: 610-278-7621

5332 Mayfield Road
Lyndhurst, OH 44124
State ID: 18001881

Facility/Agency Copy
Site #00018762 / WO #299075
Thu Jun 30th, 2011

Air / Liquid Test

Check One: <input type="checkbox"/> VacuSmart <input type="checkbox"/> Roots Meter <input checked="" type="checkbox"/> TriTester Model 2.96	***TriTester Model 2.96 ONLY*** Test equipment passed the bulb test (held vacuum for at least 30 seconds) prior to performing the A/L test. <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A TriTester Serial#: 0435076 TriTester Calibration Due Date: 2011-08-25		
---	---	--	--

Stage II Manufacturer: Dresser Waynevac	CARB Executive Order: G-70-153-AD	Allowable Flow Rate range: 6 - 10	Allowable A/L range: 0.9 - 1.1
---	---	---	--

Result: <input checked="" type="checkbox"/> Pass <input type="checkbox"/> Fail <input type="checkbox"/> Incomplete <input type="checkbox"/> Inconclusive	Failed Fueling Points:	Site-Wide Nozzle Model: (All, or the majority of the nozzles on site are the make and model listed below. Any deviations will be noted in the results) OPW - 12vw-0400
---	-------------------------------	--

Fuel Point	Grade	Nozzle Model (if different then the Site-Wide model above)	Flow Rate	A/L Ratio	Result
7	Regular	OPW - 12vw-0400	7.66	1.00	P
7	Plus	OPW - 12vw-0400	8.93	0.99	P
7	Super	OPW - 12vw-0400	8.53	1.01	P
7	Ultra	OPW - 12vw-0400	7.21	1.02	P

St WO 299075, Jun 30th, 2011

Crompeco, LLC
 1815 Gallagher Road
 Plymouth Meeting, PA 19462

Sunoco Service Station
 Phone: (610) 278-7203
 FAX: 610-278-7621

5332 Mayfield Road
 Lyndhurst, OH 44124
 State ID: 18001881

Facility/Agency Copy
 Site #00018762 / WO #299075
 Thu Jun 30th, 2011

Dispenser Shear Valve Inspection

Overall Result:			
F			
Gasoline Shear Valves that do not operate properly:			
1/2			
Gasoline Shear Valves that are not installed/mounted properly:			
Dispenser #	Product	Operating Properly	Installed/Mounted Properly
1/2	Regular	No	Yes
1/2	Ultra	Yes	Yes
3/4	Regular	Yes	Yes
3/4	Ultra	Yes	Yes
5/6	Regular	Yes	Yes
5/6	Ultra	Yes	Yes
7/8	Regular	Yes	Yes
7/8	Ultra	Yes	Yes



GROMPCO

Date: 2011-06-01

Work Order #: 299075

Location #: 00018762



Remote Fill



Dry Brake



ATG



Emergency Stop



Riser



Anode



Extractor



Road



Block



Fill



STP



CP Junction Box



Fixed Reference Cell



Stage 1 w/ Extractor



CP Test Station



Flapper Direction



Tank



Circuit Breaker



Interstitial



Temp Well Installed



Compass



Manway



Vent



Containment Sump



Monitor



Well



DW Fill



Overfill Alarm



Dispenser






Rectifier



Drop Tank



Remote Dry Brake

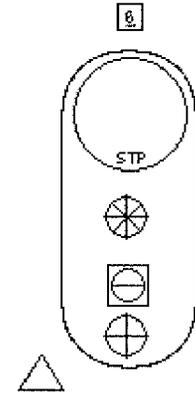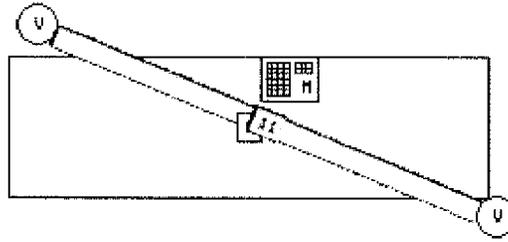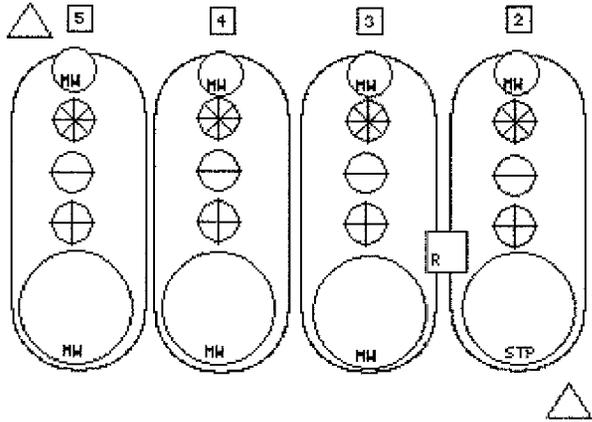

SI WO 299075, Jun 30th, 2011

St WO 299075, Jun 30th, 2011

Crompco, LLC
1815 Gallagher Road
Plymouth Meeting, PA 19462

Sunoco Service Station
Phone: (610) 278-7203
FAX: 610-278-7621

5332 Mayfield Road
Lyndhurst, OH 44124
State ID: 18001881

Facility/Agency Copy
Site #00018762 / WO #299075
Thu Jun 30th, 2011

Site Diagram Labels

- 1: Block - store
- 2: Tank - reg master
- 3: Tank - reg
- 4: Tank - reg
- 5: Tank - reg
- 6: Tank - ultra
- 7: Dispenser - 1-2
- 8: Dispenser - 3-4
- 9: Dispenser - 5-6
- 10: Dispenser - 7-8
- 11: Block - Vents manifolded together above ground across roof line

St WO 299075, Jun 30th, 2011

Verification for Wo#: 299075

Quantity Sold	Part Name	Manufacturer	Part #	Description
---------------	-----------	--------------	--------	-------------

Service Details

Scope of Work Performed	Comments
-------------------------	----------

- A/L
- Shear Valve
- Station Log

Gallons Pumped: Additional Labor Hours:

Site Arrival Time: Site Depart Time:

Confirmation

By signing this verification you are agreeing that Crompeco LLC performed various compliance testing and/or repairs and replaced parts as listed above.

Printed Name **Email Signature**

Signature captured

Refused to sign

No one available to sign

SENDER: COMPLETE THIS SECTION

- Complete items 1, 2, and 3. Also complete item 4 if Restricted Delivery is desired.
- Print your name and address on the reverse so that we can return the card to you.
- Attach this card to the back of the mailpiece, or on the front if space permits.

1. Article Addressed to:

Attn: Scott Moon
Mayfield Road Center, LLC
P.O. Box 1565
Lawrenceville, GA 30046

COMPLETE THIS SECTION ON DELIVERY

- A. Signature
 Bill [Signature] Agent
 Addressee
- B. Received by (Printed Name) *B. Smith* C. Date of Delivery *10-23-11*
- D. Is delivery address different from item 1? Yes
If YES, enter delivery address below: No

3. Service Type
 Certified Mail Express Mail
 Registered Return Receipt for Merchandise
 Insured Mail C.O.D.

4. Restricted Delivery? (Extra Fee) Yes

2. Article Number
(Transfer from service label)

7003 1010 0004 2923 6912