



City of Cleveland
Frank G. Jackson, Mayor

Department of Public Health
Division of Air Quality
1925 St. Clair Avenue
Cleveland, Ohio 44114-2080
216/664-2297 • Fax: 216/420-8047
www.clevelandhealth.org

**SERVING OHIO EPA AS AGENCY 13
FOR CUYAHOGA COUNTY**

**CERTIFIED MAIL 7002 2030 0001 1807 8191
RETURN RECEIPT REQUESTED**

10/8/08

Ed Jakab
Meyer Products, LLC
18513 Euclid Ave.
Cleveland, OH 44112-1084

**FACILITY ID: 13-18-00-1982
NOTICE OF VIOLATION (NOV) FOLLOW-UP LETTER**

Dear Mr. Jakab:

On 5/7/08, the Cleveland Division of Air Quality (CDAQ) issued a NOV requesting that Meyer Products, LLC (Meyer's) submit the required quarterly and semi-annual deviation reports for L001, P006, P008 and Z004, the annual solvent emissions report for L001, excursion report(s) for P008, and a corrective action plan to assure the allowable temperature specifications for L001 are met. Additionally, CDAQ requested Meyer's to provide the manufacturer's documentation along with a PTI modification request for P008.

CDAQ is in receipt of quarterly and semi-annual deviation reports for L001, P006, P008 and Z004, the annual solvent emissions report for L001 and a corrective action plan to assure the allowable temperature specifications for L001 dated 5/30/08. On 10/3/08 CDAQ witnessed the operation of L001 and observed the chiller temperature maintaining an acceptable -16°Fahrenheit (minimum -10°F specified in PTI #13-3379).

The corrective action plan was received and appropriate steps were taken to bring the source into compliance. CDAQ has determined that no further enforcement action is warranted at this time, but reserves its right to take such action in the future if necessary.

CDAQ issues this letter with Ohio EPA's concurrence and does not excuse any violations of local, state and federal laws or regulations regarding air pollution control. Violations of air pollution control laws may be pursued in local court or referred to Ohio EPA or U.S. EPA for further enforcement action. Should you have any questions, please call Dave DeChant at 216-664-3213. All correspondence with CDAQ must include the Ohio EPA facility identification number for Meyer Products, LLC: 13-18-00-1982.

Sincerely,

Valencia White
Field Enforcement Manager, CDAQ

VW/dd



CLEVELAND DIVISION OF AIR QUALITY

1925 ST. CLAIR AVENUE • CLEVELAND, OH 44114-2080

Page 2

R: 04/06/2004

cc: Michael Javaras, Meyer Products, LLC
Denise Angus, Meyer Products, LLC
Paul Jack, Castle Bay, Inc.
Richard Nemeth and Michael J. Krzywicki, CDAQ
John Paulian, Ohio EPA Central Office
Lisa Holscher, U.S. EPA Region V
Facility File and L:\Data\Facilities\1318001982\2008-04-18 NEAR.doc



18513 Euclid Avenue
Cleveland, Ohio 44112-1084
216-486-1313
Fax 216-486-1321
www.meyerproducts.com
E-mail info@meyerproducts.com

July 11, 2008

9/15 - POSTED
WRITTEN UPDATE

George Baker
Chief of Enforcement
Cleveland Department of Public Health
Division of Air Quality
1925 St. Clair Avenue NE
Cleveland, Ohio 44114

Subject: Final Corrective Action on L001

Dear Mr. Baker,

I am pleased to announce that the final corrective actions are now in place on unit L001. Meyer's HVAC contractor successfully repaired this unit after placing several calls to the original equipment manufacturer (OEM). This unit is now holding a consistent -20°F temperature. I have included a photograph of this temperature reading that was taken earlier this morning while the machine was under full operation.

I trust this last final repair to unit L001 closes all violations noted by the Cleveland Department of Air Quality during its inspection on April 23, 2008.

Please feel free to contact me directly should you have any questions about this letter or any of its contents.


Sincerely,

MEYER PRODUCTS

Michael Javaras
Michael Javaras

Director of Operations

cc: Andy Outcalt, Meyer Products
Paul Jack, Castle Bay Inc.
Dave DeChant, CDAQ

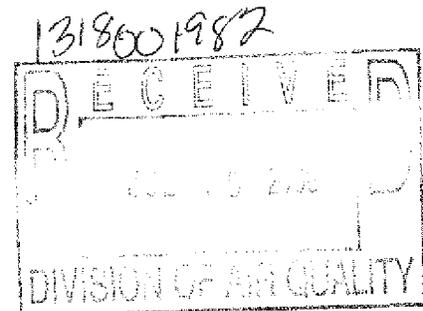

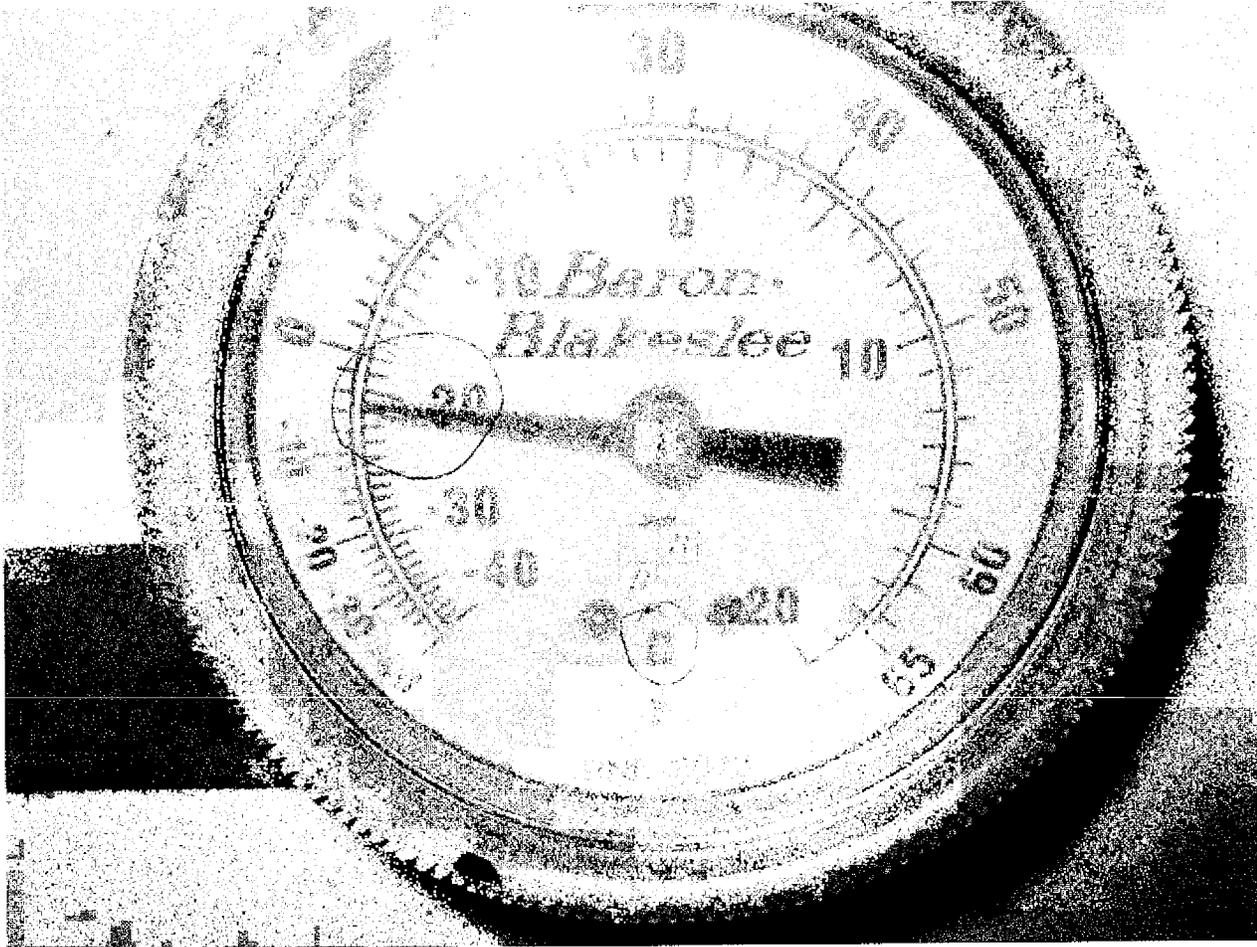


Photo 1. Temperature of the refrigerant operating in unit L001 on July 11, 2008 at 8:30 a.m. Note the temperature is slightly colder than the -20°F stated in the above text.

-25°F

Meyer

A Subsidiary of The Louis Berkman Work Products Company
Meyer * Swenson