



City of Cleveland
Frank G. Jackson, Mayor

Department of Public Health
Division of Air Quality
75 Erieview Plaza, Second Floor
Cleveland, Ohio 44114-1839
216/664-2297 • Fax: 216/420-8047
www.clevelandhealth.org

**SERVING OHIO EPA AS AGENCY 13
FOR CUYAHOGA COUNTY**

**CERTIFIED MAIL : 7010 1870 0000 6591 2267
RETURN RECEIPT REQUESTED**

September 26, 2011

Joseph Elabd
Food Express and Gas, Inc.
12307 St. Clair Avenue
Cleveland, Ohio 44108

**FACILITY ID: 13-18-00-7497
NOTICE OF VIOLATION FOLLOW-UP LETTER**

Dear Mr. Elabd:

On August 15, 2011, the Cleveland Division of Air Quality (CDAQ) issued a Notice of Violation requiring Food Express and Gas, Inc. to:

1. Submit either a Permit-to-Install/Operate (PTIO) application or a Permit-By-Rule notification form for Emission Unit (EU) G001.
(PBR notification received August 12, 2011)
2. Perform an Air/Liquid (A/L) ratio, and Static Leak test, and submit the test results
(Tests performed August 18, 2011, and received test results)
3. Submit a copy of a Stage II compliance specialist certificate.
(Received September 26, 2011)
4. Submit a copy of records of maintenance.
(Received September 26, 2011)
5. Submit 2010 and 2011 city permit fees.
(Received September 15, 2011)

The corrective action plan was received and appropriate steps were taken to bring the source into compliance. CDAQ has determined that no further enforcement action is warranted at this time, but reserves its right to take such action in the future if necessary.

CDAQ issues this letter with Ohio EPA's concurrence and does not excuse any violations of local, state and federal laws or regulations regarding air pollution control. Violations of air pollution control laws may be pursued in local court or referred to Ohio EPA or U.S. EPA for further enforcement action.



Should you have any questions, please call Bryan Sokolowski at (216) 420-7663. All correspondence with CDAQ must include the Ohio EPA facility identification number for Food Express and Gas, Inc.: 13-18-00-7497.

Sincerely,

A handwritten signature in cursive script that reads "Linda Kimmy".

Linda Kimmy
Field Enforcement Manager, CDAQ

LK/BS

cc: John Paulian, Ohio EPA Central Office
William MacDowell, U.S. EPA Region V
Facility File and L:\Data\Facilities\1318007497\2011-8-1 NEAR.docx

SENDER: COMPLETE THIS SECTION

- Complete items 1, 2, and 3. Also complete item 4 if Restricted Delivery is desired.
- Print your name and address on the reverse so that we can return the card to you.
- Attach this card to the back of the mailpiece, or on the front if space permits.

1. Article Addressed to:

Joseph Elabd
Food Express and Gas, Inc.
12307 St Clair Avenue
Cleveland, Ohio 44108

2. Article Number
(Transfer from st)

7010 1870 0000 6591 2267

13-18-00-7497

COMPLETE THIS SECTION ON DELIVERY

A. Signature

X

- Agent
- Address

B. Received by (Printed Name)

C. Date of Delivery

D. Is delivery address different from item 1?
If YES, enter delivery address below:

- Yes
- No

3. Service Type

- Certified Mail
- Registered
- Insured Mail
- Express Mail
- Return Receipt for Merchand
- C.O.D.

4. Restricted Delivery? (Extra Fee)

- Yes



Environmental Compliance Technologies


This is to certify that

Rammze Elabd

has completed the Facility Stage II Training Program and has demonstrated his his knowledge by successfully completing an examination of the subject material with a score of greater than seventy percent.

DATE: 8/11/2011

CERTIFICATION #: S2T-08112011-02

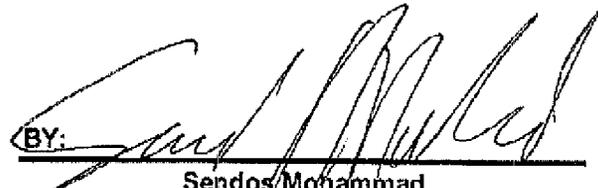BY: 
Sendos Mohammad
Trainer



Cleveland Local Air Agency
 Agency 13 - Cuyahoga
 Phone: 216/ 664-2297



Technical Guidance Document

Company Name:
 Address:

GAS USA - ST. CLAIR
12307 ST. CLAIR AVE.
CLEVELAND, OH 44109


Mo./Year: SEPT. - 2011

Weekly Inspection - Vapor Recovery System

* Place initials of the inspector in the spaces provided *

	Week 1							Week 2							Week 3							Week 4							Week 5											
	Sun	Mon	Tues	Wed	Thur	Fri	Sat	Sun	Mon	Tues	Wed	Thur	Fri	Sat	Sun	Mon	Tues	Wed	Thur	Fri	Sat	Sun	Mon	Tues	Wed	Thur	Fri	Sat	Sun	Mon	Tues	Wed	Thur	Fri	Sat					
Hoses - not crimped, severed, or flattened, etc...				✓								✓							✓									✓												
Nozzles - shut-off device working, spout not loose, cracked				✓								✓							✓									✓												
Nozzle Bellows / Vapor Shroud - good condition				✓								✓							✓									✓												
Swivels - working properly, no vapor/liquid leaks				✓								✓							✓									✓												
Dispenser - no liquid/vapor leaks				✓								✓							✓									✓												
Breakaways - securely attached, not leaking vapor/liquid				✓								✓							✓									✓												
Equipment Verification - no missing labels or stickers				✓								✓							✓									✓												
Underground Tanks - all caps in place, cap seals okay				✓								✓							✓									✓												
Tank Area - spill bucket drained; PV vent cap in place				✓								✓							✓									✓												

Note repairs, maintenance, and service performed (Include date, time, type of repair, etc...):

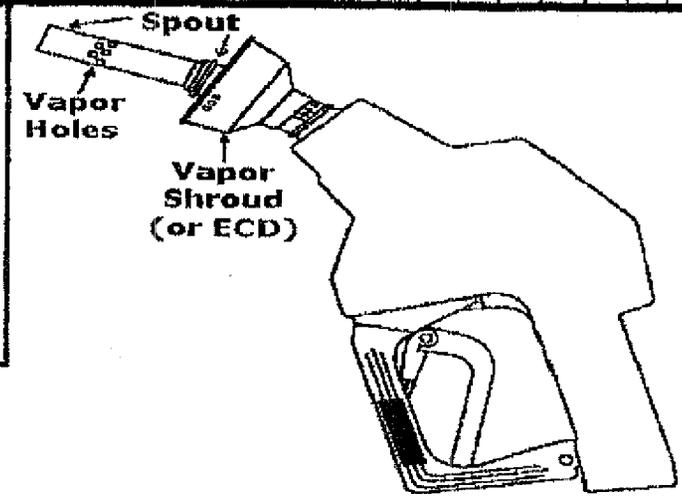

**This form is a technical guidance document only and does not constitute legal advice. Compliance with the law is the facility owner and operator's responsibility.



Cleveland Local Air Agency
 Agency 13 - Cuyahoga
 Phone: 216/ 664-2297



Technical Guidance Document

Company Name:
 Address:

GAS USA ST. CLAIR
12307 ST. CLAIR AVE.
CLEVELAND, OH 44108

Mo./Year: Aug -2011


Weekly Inspection - Vapor Recovery System

* Place initials of the inspector in the spaces provided *

	Week 1							Week 2							Week 3							Week 4							Week 5						
	Sun	Mon	Tues	Wed	Thur	Fri	Sat	Sun	Mon	Tues	Wed	Thur	Fri	Sat	Sun	Mon	Tues	Wed	Thur	Fri	Sat	Sun	Mon	Tues	Wed	Thur	Fri	Sat	Sun	Mon	Tues	Wed	Thur	Fri	Sat
Hoses - not crimped, severed, or flattened, etc...						✓							✓																						
Nozzles - shut-off device working, spout not loose, cracked						✓							✓																						
Nozzle Bellows / Vapor Shroud - good condition						✓							✓																						
Swivels - working properly, no vapor/liquid leaks						✓							✓																						
Dispenser - no liquid/vapor leaks						✓							✓																						
Breakaways - securely attached, not leaking vapor/liquid						✓							✓																						
Equipment Verification - no missing labels or stickers						✓							✓																						
Underground Tanks - all caps in place, cap seals okay						✓							✓																						
Tank Area - spill bucket drained; PV vent cap in place						✓							✓																						

Note repairs, maintenance, and service performed (include date, time, type of repair, etc...):

8-5-11
 Dispenser #3 out of service
 circuit board repair
 8/9/11
 #3 REPAIRED

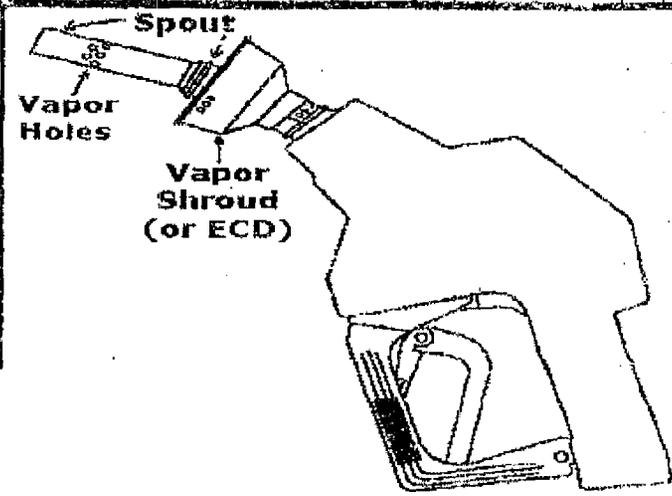

**This form is a technical guidance document only and does not constitute legal advice. Compliance with the law is the facility owner and operator's responsibility.